

# HEALTH/LIFE SAFETY GLOSSARY

## For Existing Public School Buildings in Illinois

[Excluding Chicago Public Schools-Part 180.10(b)]



and



In cooperation with



**Fiscal Year 2019  
School Year 2018-2019**

## TABLE OF CONTENTS

Building Codes for Pre-K through 12 Illinois Public Schools (excluding CPS) .....	4
Administrative and General Building Requirements .....	6
Arts and Crafts Rooms .....	12
Auditoriums .....	13
Automotive Shops.....	14
Boiler Room.....	16
Cafeteria.....	17
Classrooms .....	18
Corridors.....	18
Elevators and Conveying Systems .....	20
Exterior Items .....	20
Fire Escape Stairs .....	21
Greenhouses .....	21
Gym and Multipurpose Rooms.....	22
Home Economics and Family Services Rooms .....	22
Industrial Technology Labs and Metal Working Shops.....	23
Kitchens.....	23
Library and Media Centers .....	24
Music Practice Rooms .....	26
Photo Developing Labs .....	26
Science Laboratories .....	26
Shower and Locker Rooms .....	27
Stages (Large), Dressing Rooms and Other Accessory Areas .....	28
Stages (Small) .....	29
Stages With Storage Underneath.....	30
Stairwells .....	30
Storage, Supply Rooms and Closets .....	31
Swimming Pools .....	32
Teacher's Workrooms and Lounges.....	33
Toilets .....	34
Woodworking Shops.....	34
Appendix A – Code References and Acronyms.....	36
Appendix B – The Storage/Handling of Flammable and Combustible Liquids and Other Chemicals.....	38
Appendix C – Fire Alarm Inspection, Testing, and Maintenance .....	39
Appendix D – Fire Extinguisher Installation Matrix .....	41
Appendix E – Periodic Inspection and Testing of Proscenium Curtains .....	42
Appendix F – Periodic Testing of Emergency Lighting Equipment.....	43
Appendix G – Dead End Travel Matrix .....	44
Appendix H – Wall-Mounted Alcohol-Based Hand-Rub Dispensers.....	45
Appendix I – Decorative Vegetation.....	46
Appendix J – Manual Fire Alarm Pull Stations.....	47
Appendix K - Health/Life Safety Annual Inspection Checklist .....	48
Appendix L – Interior Wall, Ceiling and Floor Finish .....	58
Appendix M – Clearance from Sprinkler Heads .....	62
Appendix N – Door Locking Hardware .....	63
Appendix O – Part 175 Fire-Rated Separations.....	65
Appendix P – Part 185 Fire Separation Requirements.....	78
Appendix Q - Part 180 Fire Rated Separations.....	103

**NOTE: This glossary is to be used as a guide only. The user should always confirm requirements in the applicable code, standard or ISBE Parts 175, 180 or 185.**

**NOTE: For buildings approved for design after July 1, 1965, but before March 25, 1995 Part 175.110 states: “Buildings with approved automatic sprinkler systems may be designed with the area limitations, reduced fire resistance requirements and distance-to-exit limitations provided for such buildings by any one of the accepted model codes listed herein.”**

## Building Codes for Pre-K through 12 Illinois Public Schools (excluding CPS)

(Part 180.Appendix A)

BUILDING CODES	RETROACTIVE CODES
<b>2015 IBC.</b> For new construction contracted for design <b>on or after July 1, 2016</b>	Retroactive 2015 IFC/IPMC requirements apply to construction contracted for design <b>on or after July 1, 2016.</b>
For construction contracted for design <b>before July 1, 2016</b> , allows compliance with IBC 2009, IBC 2006, IBC 2003, BOCA 96, BOCA 93, Part 175 or Part 185.	Retroactive ICC 300-12 requirements apply to <b>bleachers</b> contracted for design <b>on or after July 1, 2016.</b>
<b>2009 IBC.</b> For new construction contracted for design <b>on or after January 1, 2010 but before July 1, 2016.</b>	Retroactive 2009 IFC/IPMC requirements apply to construction contracted for design <b>on or after January 1, 2010 but before July 1, 2016.</b>
For construction contracted for designed <b>before January 1, 2010</b> , allows compliance with IBC 2006, IBC 2003, BOCA 96, BOCA 93, Part 175, or Part 185.	Retroactive ICC 300-07 requirements apply to <b>bleachers</b> contracted for design <b>on or after January 1, 2010, but before July 1, 2016.</b>
<b>2006 IBC.</b> For construction contracted for design <b>on or after September 25, 2007 but before January 1, 2010.</b>	Retroactive 2006 IFC/IPMC requirements apply to construction contracted for design <b>on or after September 25, 2007 but before January 1, 2010.</b>
For construction contracted for design before September 25, 2007, allows compliance with IBC 2003, BOCA 96, BOCA 93, Part 175, or Part 185.	Retroactive ICC 300-02 requirements apply to <b>bleachers</b> contracted for design <b>on or after October 3, 2005 but before January 1, 2010.</b>
<b>2003 IBC.</b> For construction contracted for design <b>on or after October 3, 2005 but before September 25, 2007.</b>	Retroactive 2003 IFC/IPMC requirements apply to facilities designed <b>on or after October 3, 2005 but before September 25, 2007.</b>
For construction contracted for design <b>before October 3, 2005</b> , allows compliance with BOCA 96, BOCA 93, Part 175 or Part 185.	Retroactive ICC 300-02 requirements apply to <b>bleachers</b> contracted for design <b>on or after October 3, 2005 but before January 1, 2010.</b>
<b>1996 BOCA.</b> For construction contracted for design <b>on or after July 6, 1998 but before October 3, 2005.</b>	Retroactive 96 BOCA Fire Prevention/PM Code requirements apply to construction contracted for design <b>on or after July 6, 1998 and before October 3, 2005.</b>
For construction contracted for designed <b>before October 3, 2005</b> , allows compliance with BOCA 93, Part 175 or Part 185.	NFPA 102-1995 requires biennial by architect or engineer for <b>bleachers</b> contracted for design <b>on or after July 6, 1998 and before October 3, 2005.</b>
<b>1993 BOCA.</b> For construction contracted for design <b>on or after March 24, 1995 and before July 6, 1998.</b>	Retroactive 93 BOCA Fire Prevention/PM Code requirements apply to facilities contracted for design <b>before July 6, 1998.</b>
For construction designed <b>before March 24, 1995</b> , allows compliance with Part 175 or Part 185.	NFPA 102-1992 requires biennial by architect or engineer for <b>bleachers</b> contracted for design <b>on or after July 6, 1998.</b>

<b>Part 175.</b> For construction contracted for design <b>on or after July 1, 1965 but before March 24, 1995.</b>	Retroactive 93 BOCA Fire Prevention/PM Code requirements apply to facilities contracted for design <b>before July 6, 1998</b> unless Part 175 has something more stringent in those buildings contracted for design on or after July 1, 1965 but before March 24, 1995.
For construction contracted for design <b>before July 1, 1965</b> , allows compliance with Part 185.	Retroactive 93 BOCA Fire Prevention Code (Section 106.4) inspection requirements may be applied to <b>bleachers</b> contracted for design <b>on or after July 1, 1965 but before March 24, 1995</b> where an approved agency or individual shall conduct the inspections and provide a written report regarding compliance with NFPA 102 – 1967.
<b>Part 185.</b> For construction contracted for design <b>before July 1, 1965.</b>	Retroactive 93 BOCA Fire Prevention/PM Code requirements apply to facilities contracted for design <b>before July 6, 1998</b> unless Part 185 has something more stringent in those buildings contracted for design before July 1, 1965.
For construction contracted for design <b>before July 1, 1965</b> , requires compliance with Part 185.	Retroactive 93 BOCA Fire Prevention Code (Section 106.4) inspection requirements may be applied to <b>bleachers</b> contracted for design <b>before July 1, 1965</b> ; an approved agency or individual shall conduct the inspections and provide a written report re: compliance with NFPA 102 –1957.

**Facility:** In accordance with Part 180.30, “facility” means land, buildings, structures and improvements other than buildings, and permanent, fixed equipment attached to or incorporated in any building owned or used for school purposes by a school district subject to this Part. This definition excludes facilities owned by a school district but not used for public school purposes, which shall be subject to local building codes” [and the Office of the State Fire Marshal’s adoption of NFPA 101-*Life Safety Code*]

Private facilities serving special education students where the public school district has certified that it is unable to serve said students—Health and Life Safety Code no longer applies; under Section 401.220(a), the Office of the State Fire Marshal will enforce its fire code and the local enforcement authority will enforce its local building code.

If the private organization is located in a public school building that is owned or leased by the school district and the program serves public school students, that facility must comply with the ISBE Health/Life Safety Code.

If a private organization leases from a public school district building, but does not serve public school students, that facility (the area of the building where the private organization is housed only) must comply with the OSFM’s adoption of NFPA 101-*Life Safety Code* and the locally adopted code.

## ADMINISTRATION and GENERAL BUILDING REQUIREMENTS

### 1. Safety Reference Plans (180.330)

A complete set of up-to-date safety reference plans should be available at each school and should include a site plan, schematic floor plans, utility information, and an attic plan.

### 2. School Safety Drills (105 ILCS 128)

During each academic year, schools must conduct the following drills: Three (3) evacuation drills to prepare for fire incidents (with at least one with local fire official present), one (1) bus evacuation drill that includes instruction in safe bus riding practices for all students, one (1) shelter-in-place drill to prepare for tornado incidents, and one (1) law enforcement drill to prepare for lock-downs, shootings, bomb threats, or hazardous materials or other incidents. **Fire:** Upon the participation of the local fire service, the appropriate local fire official shall certify that the school evacuation drill was conducted. If the fire official does not select one of the four (4) offered dates in October or set another date by mutual agreement, the requirement that the school include the local fire service in one of its mandatory school evacuation drills shall be waived. **Law Enforcement:** During each calendar year, the appropriate local law enforcement agency shall contact the appropriate school administrator to request to participate in a law enforcement drill and may actively participate on-site in a drill. Upon the participation of a local law enforcement agency in a law enforcement drill, the appropriate local law enforcement official shall certify that the law enforcement drill was conducted.

### 3. Annual Review of Crisis Plans (105 ILCS 128/25; 29 Ill. Adm. Code 1500)

Annual review shall be conducted by the local emergency responders and the school board or designee and shall encompass the components of the plan enumerated in the Act . An annual review report is required to be submitted to the Regional Superintendent to document the review and update of emergency and crisis response plans, protocols, and procedures and the school drill program. Drill Documentation Forms, Annual Review Report Forms and Minimum Component Checklists are provided on the ISBE website.

### 4. Hold-Open Devices (IFC: 703.2; BOCA-F: 303; 175.290; 185.370m)

Hold-open devices are prohibited on all doors described as "self-closing." **IFC only:** Opening protectives shall be maintained in an operative condition in accordance with applicable the edition of NFPA 80 . Hold-open devices and automatic door closers, where provided, shall be maintained. Doors that are automatic-closing (e.g., held open with magnetic hold-open devices) are required to close only upon activation of the assigned smoke detectors or upon power loss. During the period that such device is out of service for repairs, the door it operates shall remain in the closed position. **BOCA-F only:** Fire doors shall be self-closing or automatic closing in accordance with the requirements of the applicable edition of NFPA 80 . Fire doors which are not self-closing and which protect openings in horizontal exits, exits, or exit access corridors required to be of fire resistance rated construction shall be automatic-closing by the actuation of smoke detectors or by loss of power to the smoke detector or the hold-open device. **Part 175/185 only:** Where doors are required to be self-closing such as in opening protectives in enclosures for vertical openings, horizontal exits, limiting wall of open plan buildings, and smoke-stop partitions approved self-closing devices shall be used while the building is occupied or shall be arranged to be automatic-closing upon actuation of the building's fire alarm system.

**5. Unobstructed Exits** (IFC15: 1031.3; IFC09: 1030.3; IFC06: 1028.3; IFC03: 1027.3; BOCA-F: 605)

Safe, reliable and unobstructed means of access travel shall be provided from any location in an occupied room or space to the doorways required as either a part of an exit or which provide a path of travel from a room or space to an exit. Unlatching of doors shall not take more than one motion. Any additional locking devices that impede opening of doors are not permitted. [See Appendix N for more information]

**6. Emergency Lighting Equipment and Illuminated Exit Signs** (IFC15: 1008; IFC15: 1013; IFC09/06/03: 1006; IFC09/06/03 1011; BOCA-F 610.1; BOCA-F: 610.2)

Rooms and spaces requiring two means of egress shall be equipped with emergency lighting, including assembly areas. In all buildings, rooms or spaces required to have more than one exit or exit access, all required means of egress shall be indicated with approved signs reading "Exit" visible from the exit access and, where necessary, supplemented by directional signs in the exit access corridors indicating the direction and way of egress. All "exit" signs shall be located at exit doors or exit access areas, so as to be readily visible. Sign placement shall be such that any point in the exit access shall not be more than 100 feet from the nearest visible sign. Main exterior exit doors which are obviously and clearly identifiable as exits are not required to have "Exit" signs where approved. Approved self-luminous signs are permitted to be installed in schools. UL 924 is the appropriate standard to reference for internally illuminated, self-luminous, and photoluminous exit signs.

**7. Periodic Testing of Emergency Lighting Equipment and Battery Back-up Exit Signs** (IFC15: 604.6; IPMC: 605.1; BOCA-F96: 611.2; BOCA-F93: 610.1.1; NFPA 70: 700.4)

All required emergency lighting and exit signs using battery back-up power shall be tested for proper operation. Exit signs, exit lights, and emergency lights need to be tested. [See Appendix F for requirements]

**8. Proper Storage and Use of Flammable and Combustible Liquids and Other Chemicals/Portable Gasoline Containers** (IFC15: Part V; IFC09/06/03: 3404.3; BOCA-F: 3203.2; BOCA-PM: 703.2)

Flammable and combustible liquids and other chemicals shall be stored in accordance with applicable codes. Only approved gasoline containers shall be used. Plastic containers meeting the requirements of and used for petroleum products within the scope of one or more of the specifications listed in Appendix B shall be acceptable. Where storage cabinets are utilized to establish the exempt amounts in accordance with the provisions of the BOCA or ICC codes, such cabinets shall comply with the applicable requirements for storage cabinets in BOCA or ICC. [See Appendix B for more general information on storage and use of chemicals and flammable and combustible liquids].

**9. Fire Alarm System** (IFC15/09: 907.2.3; IFC06/03: 907.3.1.1; BOCA-F: 503.5)

All educational occupancies shall be equipped with a fire alarm system. **IFC 15/09 only:** Educational occupancies shall be provided with a fire alarm system except for those with an occupant load of less than 50 persons. **IFC 06/03 only:** Educational occupancies shall be provided with a fire alarm system except for those that contain only one classroom and less than 1,000 ft<sup>2</sup> and are greater than 50 ft from another building. Additionally, any educational occupancy with an occupant load of less than 50 persons is not required to have a fire alarm system. **BOCA-F only:** All educational occupancies shall be provided with a fire alarm system. **175/185 only:** Every school with over 5,000 ft<sup>2</sup> gross area or

with more than one occupied floor level shall be provided with an approved fire alarm system complying with NFPA 72A. A “power on” light for both the operating circuits and supervisory circuits (audible trouble signals) shall be permanently labeled and placed at each of two locations: One in or near the chief custodian’s office and the other in or near the principal’s office or other similar location attended during school hours. For manual pull station locations, see Appendix J.

**10. Fire Alarm Audibility** (IFC09: 907.6.2.1; IFC06/03: 907.3.1.1; IFC: 907.10.2; BOCA-F: 503.5; 175.470e; 185.395d4)

*The inspector should think about fire alarm audibility in the rooms found in a school that normally could be rather noisy. The inspector is not expected to measure sound pressure levels of all alarm notification appliances during the time of inspection, but if there is a concern that the ambient noises of a room might prevent a horn from being heard, there are simple, inexpensive methods that can be used subsequent to the inspection to determine if additional occupant notification devices are required in the room in question.*

The same signal shall be used for drills as for actual alarms.

**11. Unobstructed Manual Fire Alarm Station** (NFPA 72-2013: 17.14.8.2; NFPA 72-2007: 5.13; NFPA 72-2002: 5.12; NFPA 72-1999: 2-8; NFPA 72-1996: 5-8; NFPA 72-1990: 3-2)

Manual fire alarm stations shall be clear and unobstructed and not damaged.

**12. Inspection, Testing and Maintenance of Fire Alarm Systems** (IFC15: 907.8; IFC09: 907.9.5; IFC06/03: 907.20.5; BOCA-F96: 513.1; BOCA-F93: 512.1)

The district shall provide evidence that the fire alarm system is being inspected, tested and maintained in accordance with the applicable edition of NFPA 72 or NFPA 72A. **ICC and BOCA-F96 only:** Service personnel shall be qualified and experienced in the inspection, testing, and maintenance of fire alarm systems. Examples of qualified personnel shall be permitted to include, but shall not be limited to, individuals with the following qualifications: (1) Factory trained and certified (2) National Institute for Certification in Engineering Technologies fire alarm certified (3) International Municipal Signal Association fire alarm certified (4) Trained and qualified personnel employed by an organization listed by a national testing laboratory for the servicing of fire alarm systems. A copy of such records shall be made available to the Regional Superintendent. **BOCA-F 93 and Parts 175, 185only:** All systems shall be under the supervision of qualified persons. These persons shall cause proper tests and inspections to be made at prescribed intervals. The AHJ shall be notified of such testing. (See Appendix C)

**13. Functional Sprinkler System** (225 ILCS 317/30; 23 Ill. Adm. Code 180.250; 41 Ill. Adm. Code 109.11; IFC: 903.5; BOCA-F: 506.1)

Where installed, proof of required maintenance and testing shall be provided to inspector. Inspection and testing shall be performed by a contractor licensed by the Office of the State Fire Marshal.

**14. Clearance Above Storage and Clearance from Sprinkler Heads** (IFC15: 315.3.1; IFC09/06/03: 315.2.1; BOCA-F: 2103.2; BOCA-PM: 705.2.2; NFPA 13)

Storage shall be maintained 2 ft or more below the ceiling in nonsprinklered areas of a building. The clearance between the sprinkler deflector and the top of storage shall be 18 in or greater. If special sprinkler heads are used, (which is not common in educational



occupancies) such as ESFR and Large Drop sprinklers the clearance between the sprinkler deflector and the top of storage shall be 36 in. [See Appendix M]

**15. Functional Standpipe System** (225 ILCS 317/30; IFC: 901.6; BOCA-F: 506.1)

Where installed, proof of required maintenance and testing shall be provided to inspector. Inspection shall be performed annually on pipe and hoses and appropriately tagged. Inspection of standpipes that serve as supply for sprinkler systems shall be inspected and tested by a contractor licensed by the Office of the State Fire Marshal.

**16. Fire Extinguishers** (41 Ill. Adm. Code 251.90; IFC: 906; BOCA-F96: 519; BOCA-F93: 518)

A class ABC fire extinguisher is required to be installed in schools in accordance with NFPA 10. The fire extinguisher must be inspected annually by a contractor licensed by the Office of the State Fire Marshal and the fire extinguisher shall display a current inspection tag. The most commonly used fire extinguisher is a five-pound ABC extinguisher which has a rating of 2A:10B:C. [See Appendix D for requirements]

**17. Safety Glazing** (430 ILCS 60/)

Installations made after January 1, 1973 shall comply with the requirements of the Safety Glazing Materials Act, which requires that only safety glazing meeting the requirements of ANSI Z97.1 be installed in hazardous locations. [From the Act]: "Hazardous locations" means those installations, glazed or to be glazed in commercial and public buildings, known as framed or unframed glass entrance doors; and those installations, glazed or to be glazed in residential buildings and other structures used as dwellings, commercial buildings, and public buildings, known as sliding glass doors, storm doors, shower doors, bathtub enclosures and fixed glazed panels adjacent to entrance and exit doors which because of their location present a barrier in the normal path traveled by persons going into or out of these buildings, and because of their size and design may be mistaken as means of ingress or egress; and any other installation, glazed or to be glazed, where the use of other than safety glazing materials would constitute an unreasonable hazard as the Department of Labor may determine after notice and hearings as required by Sections 6 and 6.1 of this Act. Whether the glazing in such doors, panels, enclosures and other installations is transparent has no relevance towards the meaning of "hazardous locations". The glass should have a small etch or label of sort that identifies "ANSI Z97.1 (year)" if it is in compliance. If wired glass is found in a hazardous location as defined by the act, the ROE Health and Life Safety inspector should note the glazing and the district should follow through to determine if the glazing is in compliance with the Act or if it is even required to comply with the ACT (installed pre-January 1, 1973).

**18. Emergency Shower and Eye Wash Stations** (29 CFR 1910.151c)

Emergency showers and eye wash stations shall be maintained and inspected in accordance with ANSI Z358.1. [See [www.osha.gov](http://www.osha.gov)]

**19. Wall-Mounted Alcohol Hand-Rub Dispensers** (IFC15: 5707.5; IFC09/06: 3405.5)

Per ISBE legal in new and existing buildings, alcohol hand-rub dispensers shall be installed in accordance with the International Fire Code. This applies to all schools. [See Appendix H for requirements]

## **20. Decorative Vegetation (IFC15/09/06: 806)**

Per ISBE legal in new and existing buildings, except in areas protected throughout with sprinklers, natural cut trees shall be prohibited. In sprinklered areas natural cut trees shall be displayed in accordance with Section 806 of the International Fire Code. This applies to all schools. [See Appendix I for requirements]

## **21. Space Heaters (IFC: 603.4; IFC: 603.5; BOCA-F: 308)**

Unvented, fuel-fired heating appliances shall be prohibited. Heating appliances shall be listed. (e.g., UL listed).

## **22. Furnishings and Decorations (See also Corridors-New Artwork) (IFC: Chapter 8; BOCA-F: 306.1; 175.430; 185.290k)**

Definition of Decorative Material: All materials applied over the building interior finish for decorative, acoustical, or other effect (such as curtains, draperies, fabrics, streamers, and surface coverings), and all other materials utilized for decorative effect (such as batting, cloth, cotton, hay, stalks, straw, vines, leaves, trees, moss, and similar items), including foam plastics and materials containing foam plastics. Decorative materials do not include floor coverings, ordinary window shades, interior finish, and materials 0.025 inch (0.64 mm) or less in thickness applied directly to and adhering tightly to a substrate.

### **IFC**

**IFC15 only:** All furnishings and decorations in schools approved for design on or after July 1, 2016 shall comply with the applicable provisions of Chapter 8 of the International Fire Code (2015).

**IFC09 only:** All furnishings and decorations in schools approved for design on or after January 1, 2010 but before July 1, 2016 shall comply with the applicable provisions of Chapter 8 of the International Fire Code (2009).

**IFC06 only:** All furnishings and decorations in schools approved for design before January 1, 2010 but on or after September 25, 2007 shall comply with applicable provisions of Chapter 8 of the International Fire Code (2006).

**IFC03 only:** All furnishings and decorations in schools approved for design before September 25, 2007 but on or after October 3, 2005 shall comply with Chapter 8 of the International Fire Code (2003).

### **BOCA**

**BOCA-F only:** All furnishings and decorations in schools approved for design on or after March 24, 1995 but before October 3, 2005 shall comply with Section F-306 of the BOCA Fire Prevention Code (1996/1993). Electric light bulbs shall not be decorated with paper or other combustible materials unless flame-resistant in accordance with NFPA 701.

### **Part 175**

**175 only:** *(Part 175 does not provide definition of furnishings or decoration or differentiate between the two. This does not include wall and ceiling finishes as described in 175.420).* No furnishings, decorations, wall coverings, paints, etc., shall be used which are of a highly flammable character or which, in the amounts used, will endanger egress due to rapid spread of fire or formation of heavy smoke or toxic gases. Draperies, curtains, loosely attached wall coverings, cloth hangings, and similar materials shall be noncombustible or flameproofed in corridors, exitways, and assembly occupancies. In other areas, up to 10% of the wall area may have combustible coverings and hangings. Methods of flameproofing, tests, and acceptability shall be in accordance with NFPA 701. A flameproofing certificate, identifying agent used, and material protected shall be kept on file in the school. Additionally the requirements of BOCA Fire Prevention Code (1993), Section F-306 also apply to these schools.

## Part 185

**185 only:** (185.220 "Contents": *Those materials, furnishings and equipment located within buildings which are not permanently or rigidly affixed to the building construction. The word "contents," as used in this Part primarily refers to materials or furnishings of a movable nature serving functional, decorative or maintenance purposes. This does include interior finish as described in 185.390j).* All decorative materials shall be noncombustible or flameproof in accordance with these provisions, where located in a required exit; in a required primary path of travel thereto; in an Assembly Occupancy room or space; and in those Educational Occupancy and Special Educational Occupancy rooms or spaces having a capacity of more than 60 persons if unsprinklered and 100 persons, if sprinklered. The flame proofing of decorative materials and the tests for determining the rate of spread of flaming or smoldering combustion shall be carried out in accordance with the NFPA 701-1951 or with other accepted standards. Unless the applied flame proofing has been approved by an accepted testing laboratory as being of a permanent nature, the flame proofed material shall be tested annually and the flame proofing treatment renewed as necessary in a manner acceptable to the Enforcing Authority. A dated certificate, signed by the flame proofing applicator and identifying the flame proofing agent used and the material protected, shall be maintained on file and available for reference at all times. Additionally the requirements of BOCA Fire Prevention Code (1993), Section F-306 also apply to these schools.

### 23. Interior Wall, Ceiling and Floor Finishes

Newly installed interior wall, ceiling, and floor finishes need to comply with the requirements found in Appendix L.

### 24. Extension Cords/Multiple Plug Adaptors (IFC 605.4; IFC 605.5; BOCA-F: 310.4; BOCA-F: 310.5)

Multiplug adaptors not complying with NFPA 70 shall be prohibited. Extension cords and flexible cords shall not be a substitute for permanent wiring. Extension cords and flexible cords shall not be affixed to structures; extended through walls, ceilings or floors or under doors or floor coverings; nor shall such cords be subject to environmental damage or physical impact.

### 25. Electrical Systems (IFC: 605.1; BOCA-F: 310.1)

All identified electrical hazards shall be abated.

### 26. Carbon Monoxide Detection (105 ILCS 5/10-20.57, 41 Ill. Adm. Code 111.230)

All schools must have carbon monoxide detection located within 20 feet of a carbon monoxide emitting device. Schools designed before January 1, 2016 may use carbon monoxide alarms powered by batteries. For public schools designed on or after January 1, 2016, any carbon monoxide alarm installed must be monitored by any required fire alarm system and must be permanently powered by the building's electrical system. Alarms or detectors must be in operating condition and be inspected annually. A school is exempt from the requirements of this requirement if it does not have or is not close to any sources of carbon monoxide. A school must require plans, protocols, and procedures in response to the activation of a carbon monoxide alarm or carbon monoxide detection system. The local school boards are responsible for this program and further clarification for compliance should be taken up with them. OSFM will assist with appropriateness of equipment but will not discuss installation location of CO devices. It is recommended that the local fire department and the school board be contacted regarding protocols, procedures, and response plans for CO activation.

## AGRICULTURAL LABS

*See individual sections for those special processes that might exist in an agricultural lab, i.e. green houses, automotive shops, industrial shops, or science labs*

## ARTS AND CRAFTS ROOMS

*These requirements apply to the larger rooms generally found in high schools or possibly middle schools that have large quantities of art supply storage, kilns, painting using flammable or combustible paints, thinners, etc. This is not meant to apply to elementary classrooms which happen to teach art.*

### **28. Maintenance of Fire-Rated Construction** (IFC: 703; BOCA-F: 303)

Required fire-rated construction shall be maintained. [See Appendix O, P, or Q for requirements]

### **29. Fire Detectors** (175.460a1; 185.395c2B)

A fire detector is required in arts and crafts rooms not protected by an automatic sprinkler system.

### **30. Spray Finishing Operations Using Flammable Finishes** (IFC15: 2404; IFC 09/06: 1504.1; BOCA-F: 1303.1; 175.552; 175.660; 185.460; 185.510a; NFPA 13-Section 6.2.6.4.2 [2013])

Spray finishing operations shall be installed in accordance with applicable codes. Spray finishing operations conducted in buildings used for educational occupancies shall be located in a spray room. Automatic sprinklers are required for protection within spray rooms. Sprinkler protection in spray areas shall be protected against overspray residue so that they will operate quickly in the event of a fire. If sprinkler heads are covered to protect from overspray\* Coverings shall be replaced frequently so that heavy deposits of residue do not accumulate. Sprinklers that have been painted or coated, except by the sprinkler manufacturer, shall be replaced with new listed sprinklers having the same characteristics.

Mechanical ventilation shall be provided as per applicable codes and the system shall meet the requirements for handling flammable vapors. Welding or other spark producing processes shall not be permitted near this area and a sign warning of same should be installed.

#### **\*Note on bags covering sprinklers heads\***

Only cellophane bags having a thickness of  $\leq 0.003$ " or a thin paper bag are permitted to be used. Polypropylene bags such as "Glad", "Baggies", or "Ziploc" bags are included in this prohibition because they shrink prior to development of temperatures needed to ensure sprinkler activation and can interfere with proper operation. True cellophane bags and thin paper bags degrade rather than melt.

### **31. Limited Spraying Spaces** (IFC15: 2404.9; IFC09/06: 1504.9; IFC03: 1504.1.4; BOCA-F: 1303.1)

For Limited Spraying spaces where the aggregate surface area to be sprayed does not exceed 9 ft<sup>2</sup> and spraying is only for touch-up or spot painting and operations are not continuous in nature, sprinkler protection is not required. Mechanical ventilation shall be

provided as per applicable codes and the system shall meet the requirements for handling flammable vapors. Welding or other spark producing processes shall not be permitted near this area and a sign warning of same should be installed. **BOCA-F only:** Section 1303.1 references NFPA 33 (1989/1995) for spray finishing processes. NFPA 33 does not address “Limited Spraying Spaces” except to say “this standard shall not apply to the use of small portable spraying equipment or aerosol products that are not used repeatedly in the same location.” It further clarifies, though that the fundamental safeguards pertaining to cleanliness, care of flammable liquids, dangerous vapor-air or powder-air mixtures (i.e. appropriate ventilation) and sources of ignition should be followed where applicable (i.e. welding in the area and explosion proof fixtures).

**32. Electrical Wiring and Equipment** (IFC15: 2403.2.1; IFC09/06/03: 1503.2; BOCA-F: 1304.5; 175.660f; 185.460d; 185.510a)

Wiring and electrical fixtures used in, or adjacent to, paint spray booths shall comply with the applicable requirements of NFPA 70.

**33. Kiln Exhaust** (IPMC: 403.4; BOCA-PM: 404.4; 175.564d; 185.460b)

An exhaust hood evacuating fumes to the outside must be provided above all kilns unless the manufacturer’s directions indicate otherwise, e.g., downward exhausting kilns. In every case, the fumes may not be exhausted into the building HVAC system.

**34. Kiln Fuel Switch** (175.536b3; 185.440b2)

In rooms or spaces containing fuel-fired equipment, emergency fuel-burner disconnect switches are required. The emergency switch shall be located adjacent to primary entrance door, between 6 ft and 7 ft above the floor; shall be painted red and labeled “Emergency Fuel Burner Switch.” This switch is not required for electric kilns.

**35. Eye Glasses** (105 ILCS 115; 23 Ill. Adm Code 1.420s)

Protective eye devices shall be provided to and worn by all students, teachers, and visitors when participating in or observing dangerous vocational arts and chemical-physical courses of laboratories as specified in 105 ILCS 115/1. Eye protection shall comply with ANSI Z87.1.

**36. Toxic Art Supplies** (105 ILCS 135)

No toxic art supplies are to be used by K through 6<sup>th</sup> grade students. Toxic art supplies to be used by 7<sup>th</sup> through 12<sup>th</sup> grade students are subject to the requirements imposed by 105 ILCS 135.

## **AUDITORIUMS**

**37. Posted Occupant Load** (IFC: 1004.3; BOCA-F: 601.7)

Any assembly occupancy (greater than 50 persons) must have an approved occupancy load sign posted in a visible location, preferably near the main exit or exit access doorway from the room or space.

**38. Number of Exits** (IFC15: 1006; IFC09: 1021; IFC06: 1019; IFC03: 1018; BOCA-F: 604.1; BOCA-F: 606.2; 175.410; 185.360c)

Exits shall not be obstructed and number of exits shall not be reduced.

**39. Means of Egress Arrangement** (IFC15: 1029; IFC09: 1028; IFC06: 1025; IFC03: 1024; BOCA-F: 607.3; 175.310; 185.810)

Means of egress from auditoriums, including aisle and aisle accessway width, and aisle and aisle accessway design shall be designed in accordance with applicable codes.

**40. Illuminated Exit Signs** (IFC15: 1013; IFC09/06/03: 1011; BOCA-F: 610.2)

In all buildings, rooms or spaces required to have more than one exit or exit access, all required means of egress shall be indicated with approved signs reading "Exit" visible from the exit access and, where necessary, supplemented by directional signs in the exit access corridors indicating the direction and way of egress. All "exit" signs shall be located at exit doors or exit access areas, so as to be readily visible. Sign placement shall be such that any point in the exit access shall not be more than 100 ft from the nearest visible sign. Main exterior exit doors which are obviously and clearly identifiable as exits are not required to have "Exit" signs where approved.

**41. Emergency Lighting** (IFC15: 1008; IFC09/06/03: 1006; BOCA-F: 610.1)

All means of egress shall be equipped with emergency lighting, including all assembly areas.

**42. Maintenance of Fire-Rated Construction** (IFC: 703; BOCA-F: 303)

Required fire-rated construction shall be maintained. [See Appendix O, P, or Q for requirements]

**43. Fire Detectors** (185.395c)

**Part 185 only:** Smoke or heat detectors are required in auditoriums areas if the room or area has interior finish with flame spread greater than 75 and is not protected with sprinklers.

## **AUTOMOTIVE SHOPS**

**51. Maintenance of Fire-Rated Construction** (IFC: 703; BOCA-F: 303)

Required fire-rated construction shall be maintained. [See Appendix O, P, or Q for requirements]

**52. Fire Detectors** (175.460a2; 185.395c2B)

Fire detectors are required in automotive shops not protected by an automatic sprinkler system.

**53. Spray Finishing Operations Using Flammable Finishes** (IFC15: 2404; IFC09/06/03: 1504.1; BOCA-F: 1303.1; 175.552; 175.660; 185.460; 185.510a)

Spray finishing operations shall be installed in accordance with applicable codes. Spray finishing operations conducted in buildings used for educational occupancies shall be located in a spray room. Automatic sprinklers are required for protection within spray rooms. Sprinkler protection in spray areas shall be protected against overspray residue so that they will operate quickly in the event of a fire. If sprinkler heads are covered to protect from overspray\* Coverings shall be replaced frequently so that heavy deposits of residue do not accumulate. Sprinklers that have been painted or coated, except by the sprinkler manufacturer, shall be replaced with new listed sprinklers having the same characteristics.

Mechanical ventilation shall be provided as per applicable codes and the system shall meet the requirements for handling flammable vapors. Welding or other spark producing processes shall not be permitted near this area and a sign warning of same should be installed.

**\*Note on bags covering sprinklers heads\***

Only cellophane bags having a thickness of  $\leq 0.003$ " or a thin paper bag are permitted to be used. Polypropylene bags such as "Glad", "Baggies", or "Ziploc" bags are included in this prohibition because they shrink prior to development of temperatures needed to ensure sprinkler activation and can interfere with proper operation. True cellophane bags and thin paper bags degrade rather than melt.

**54. Limited Spraying Spaces** (IFC15: 2404.9; IFC09/06: 1504.9; IFC03: 1504.1.4; BOCA-F: 1303.1)

For limited spraying spaces where the aggregate surface area to be sprayed does not exceed 9 ft<sup>2</sup> and spraying is only for touch-up or spot painting and operations are not continuous in nature, sprinkler protection is not required. Mechanical ventilation shall be provided as per applicable codes and the system shall meet the requirements for handling flammable vapors. Welding or other spark producing processes shall not be permitted near this area and a sign warning of same should be installed. **BOCA-F only:** Section 1303.1 references NFPA 33 (1989/1995) for spray finishing processes. NFPA 33 does not address "Limited Spraying Spaces" except to say "this standard shall not apply to the use of small portable spraying equipment or aerosol products that are not used repeatedly in the same location." It further clarifies, though, that the fundamental safeguards pertaining to cleanliness, care of flammable liquids, dangerous vapor-air or powder-air mixtures (i.e. appropriate ventilation) and sources of ignition should be followed where applicable (i.e. welding in the area and explosion proof fixtures).

**55. Electrical Wiring and Equipment** (IFC15: 2403.2.1; IFC09/06/03: 1503.2; BOCA-F: 1304.5; 175.660f; 185.460d; 185.510a)

Wiring and electrical fixtures used in, or adjacent to, paint spray booths shall comply with the applicable requirements of NFPA 70. Electrical wiring within 10 ft of the floor and 20 ft horizontally of any Spray Booth or Limited Spraying Space shall be designed for Class I-Division 2.

**56. Welding Booth Exhaust** (IPMC: 403.4; BOCA-PM: 404.4; 175.552; 185.460a3)

The air to be exhausted from the welding booth shall be in accordance with applicable code requirements. Such contaminated air must be exhausted to the outside and not re-circulated.

**57. Eye Glasses** (105 ILCS 115; 23 Ill. Adm Code 1.420s)

Protective eye devices shall be provided to and worn by all students, teachers, and visitors when participating in or observing dangerous vocational arts and chemical-physical courses of laboratories as specified in 105 ILCS 115/1. Eye protection shall comply with ANSI Z87.1.

## BLEACHERS AND GRANDSTANDS

See “Building codes for Pre-K through 12 Illinois Public Schools (excluding CPS)” *at the beginning of the Glossary for code references related to the inspection and maintenance of bleachers.*

### **63. Installation, Inspection and Maintenance** (IBC15: 1029.1.1; IBC09/06/03: 3401.1; ICC 300-12/07/02; BOCA-F: 106.4; NFPA 102)

Bleachers or telescoping/folding seating designed on or after July 1, 2016 and installed into an existing building or new construction or outdoor assembly area shall comply with the applicable provisions of the IBC and Chapters 1-4 of ICC 300. Alterations to any existing tiered seating shall conform to the requirements for new construction. Portions of the structure not altered and not affected by the alteration are not required to comply with the requirements for a new structure. All existing tiered seating, including bleachers, folding and telescopic seating and grandstands shall be inspected and evaluated at least once a year by a qualified person in order to verify that the structure is maintained in compliance with the provisions of Chapters 5 of ICC 300. All folding and telescopic seating shall also be inspected to evaluate compliance with the manufacturer's installation and operational instructions, including an inspection during the opening and closing of such seating. This inspection and evaluation shall be performed by a qualified person. **Low seating only:** Tiered seating where the top of footboards, seatboards, aisles and cross aisles are not more than 30 in above the floor or grade below, unless judged by the code official to represent a distinct hazard, are not required to have an annual inspection.

### **64. Combustible Storage and Waste Accumulation** (IPMC 15/09: 308.1; IPMC06/03: 307.1; BOCA-F: 2101.4; BOCA-F: 2101.5)

**IPMC only:** All exterior property and premises, and the interior of every structure, shall be free from an accumulations of rubbish or garbage. **BOCA-F only:** Accumulation of wastepaper, wood, hay, straw, weeds, litter or combustible or flammable waste or rubbish of any type shall not be permitted to remain beneath a grandstand. Spaces underneath grandstand seats shall be kept free of all combustible and flammable materials and shall not be occupied or utilized for anything (such as storage) other than means of egress (if applicable) except where enclosed by not less than 1-hour fire-rated construction. (See *also requirements for Storage Rooms when storage areas are constructed under bleachers or grandstands*)

## BOILER ROOM

### **69. Door Swing** (175.285b; 185.390e2E)

Interior doors to heater and boiler rooms shall open into the room.

### **70. Maintenance of Fire-Rated Construction** (IFC: 703; BOCA-F: 303)

Required fire-rated construction shall be maintained. [See Appendix O, P, or Q for requirements]

### **71. Housekeeping** (IFC15: 315.3.3; IFC: 315.2.3; 41 Ill Adm Code-2120.20)

The boiler room shall be kept free of all material and equipment not necessary to the operations of the heating system. **IFC only:** Combustible storage of any kind is not permitted in boiler rooms.



**72. Fire Detectors** (175.460a6; 185.395c2A)

Fire detectors are required in boiler rooms not protected by an automatic sprinkler system.

**73. Emergency Fuel Burner Switch** (175.536b3; 185.440b2)

In rooms or spaces containing fuel-fired equipment, emergency fuel burner disconnect switches are required. The emergency switch shall be located adjacent to primary entrance door, between 6 ft and 7 ft above the floor; shall be painted red and labeled "Emergency Fuel Burner Switch."

**74. Certificate of Inspection Posted** (430 ILCS 75/11)

Every boiler and each pressure vessel over the minimum capacity must have a current inspection certificate issued by the Office of the Illinois State Fire Marshal posted in the boiler room.

**CAFETERIA (If classified as an Assembly Occupancy)****80. Posted Occupant Load** (IFC: 1004.3; BOCA-F: 601.7)

Any assembly occupancy (greater than 50 persons) must have an approved occupancy load sign posted in a visible location.

**81. Number of Exits** (IFC15: 1006; IFC09: 1021; IFC06: 1019; IFC03: 1018; BOCA-F: 606.2; BOCA-G: 604.1; 175.410; 185.360c)

Exits shall not be obstructed and number of exits shall not be reduced.

**82. Means of Egress Arrangement** (IFC15: 1029; IFC09: 1028; IFC06: 1025; IFC03: 1024; BOCA-F: 607.3; 175.310; 185.810)

Means of egress from cafeterias, including aisle and aisle accessway width, and aisle and aisle accessway design shall be designed in accordance with applicable codes.

**83. Illuminated Exit Signs** (IFC15: 1013; IFC09/06/03: 1011; BOCA-F: 610.2)

In all buildings, rooms or spaces required to have more than one exit or exit access, all required means of egress shall be indicated with approved signs reading "Exit" visible from the exit access and, where necessary, supplemented by directional signs in the exit access corridors indicating the direction and way of egress. All "exit" signs shall be located at exit doors or exit access areas, so as to be readily visible. Sign placement shall be such that any point in the exit access shall not be more than 100 ft from the nearest visible sign. Main exterior exit doors which are obviously and clearly identifiable as exits are not required to have "Exit" signs where approved.

**84. Emergency Lighting** (IFC15: 1008; IFC09/06/03: 1006; BOCA-F: 610.1)

All means of egress shall be equipped with emergency lighting, including all assembly areas.

**85. Maintenance of Fire-Rated Construction** (IFC: 703; BOCA-F: 303)

Required fire-rated construction shall be maintained. [See Appendix O, P, or Q for requirements]

**86. Fire Detectors** (175.460a1; 185.395c2D)

**Parts 175 and 185 only:** Smoke or heat detectors are required in cafeterias if the room or area has interior finish with flame spread greater than 75 and is not protected with sprinklers.

## **CLASSROOMS**

**93. Inside of Classroom Doors Unlocked** (IFC15: 1031.2; IFC09: 1030.2; IFC06/03: 1027; BOCA-F: 605)

Classroom egress doors must be easily and readily openable by pupils from the inside without the use of a key or special knowledge or effort. Bolt locks are not permitted. Unlatching of the door should not require more than one motion. Any additional locking devices that impede opening of doors are not permitted. [See Appendix N for more information]

**94. Maintenance of Fire-Rated Construction** (IFC: 703; BOCA-F: 303)

Required fire-rated construction shall be maintained. [See Appendix O, P, or Q for requirements]. Classroom doors must meet the required fire rating of the corridor wall. If the corridor wall is required to have a fire rating then door closers and latches are required. If the corridor wall is required to have a fire rating then louvers are not permitted in doors unless they are kept closed or will close using an approved automatically closing device.

**95. Door Glass-Vision Panel** (IFC15/09: 703; IFC06: 1027.17.1; IFC03: 1026.17.1, BOCA-F: 303; BOCA-PM: 704; 175.285; 185.370m6Biv)

Classroom vision panels are not required to be present, but if present it must meet applicable codes for the required fire-rating. **185 only:** All interior exit doors which serve as required means of exit for more than 20 persons or are subject to frequent travel in both directions, shall be provided with clear wired glass vision panels not less-than 100 in<sup>2</sup> in area, except those doors that comply with the exception to 185.370m6Biv. (See Appendix O, P, or Q for applicable requirements)

**96. Classroom Door Swing** (IFC15: 1010.1.2.1; IFC: 1008.1.2; BOCA-B: 1017.4; BOCA-F: 608.4; 175.410i; 185.380c10C; 185.380d4A)

**IFC/BOCA only:** Doors shall swing in the direction of egress travel when serving more than 50 persons. **175/185 only:** Doors shall swing in the direction of egress travel when serving more than 20 persons.

**97. Artwork in Classrooms** (IFC15: 807.5.2.3)

**For school buildings constructed on or after July 1, 2016 only:** Artwork and teaching materials shall be limited on walls of classrooms to not more than 50% of the specific wall area to which they are attached.

## **CORRIDORS**

**108. Number of Exits** (IFC15: 1006; IFC09: 1021; IFC06: 1019.1; IFC06: 1027.1; IFC03: 1018.1; IFC03: 1026.1; BOCA-F: 606.2; 175.410; 185.360c)

Exits shall not be obstructed and number of exits shall not be reduced.

**109. Dead-End Travel** (IFC15: 1020.4; IFC09: 1018.4; IFC06: 1017.3; IFC03: 1016.3; BOCA-F: 607.2; 175.410g; 185.380.c9)

All corridors that serve more than one exit shall provide direct connection to such exits. Dead-end corridor shall comply with applicable code depending upon the age of the building. When closed, corridor gates shall comply with this section. (See Appendix G)

**110. Illuminated Exit Signs** (IFC15: 1013; IFC09/06/03: 1011; BOCA-F: 610.2)

In all buildings, rooms or spaces required to have more than one exit or exit access, all required means of egress shall be indicated with approved signs reading "Exit" visible from the exit access and, where necessary, supplemented by directional signs in the exit access corridors indicating the direction and way of egress. All "exit" signs shall be located at exit doors or exit access areas, so as to be readily visible. Sign placement shall be such that any point in the exit access shall not be more than 100 ft from the nearest visible sign. Main exterior exit doors which are obviously and clearly identifiable as exits are not required to have "Exit" signs where approved.

**111. Emergency Lighting** (IFC15: 1008; IFC09/06/03: 1006; BOCA-F: 610.1)

All means of egress shall be equipped with emergency lighting.

**112. Maintenance of Fire-Rated Construction** (IFC: 703; IFC09: 1018.1; IFC06: 1027.17; IFC03: 1026.17.1; IPMC: 703; BOCA-F: 303; BOCA-PM: 704)

Required fire-rated construction shall be maintained. Doors are required to be self-closing and shall meet relevant codes for fire rating of the corridor. [See Appendix O, P, or Q for requirements]

**113. Capacity and Width of Corridors** (IFC15: 1020.2; IFC09: 1018.2; IFC06: 1017.2; IFC03: 1016.2; IFC06: 1028; IFC03: 1027; BOCA-F: 604.1; BOCA-F: 605.1; 175.410I; 185.380c7A)

The minimum clear width of each corridor shall be maintained and shall not be obstructed by chairs, tables, or other objects. **IFC/BOCA-F only:** Corridors in a school with more than 100 occupants shall have a clear width of 72 in. **185/175 only:** Corridors serving occupant loads greater than 200 shall have a clear width of 96 in. Corridors servicing occupant loads greater than 100 but not more than 200 shall have a clear width of 84 in. No obstructions into required width, except during evening, vacation and similar "other than normal" occupancy periods shall be permitted.

**114. Storage in Corridors and Lobbies** (IFC15: 807.5.2.1; IFC09/06: 807.4.3.1; IFC03: 1027; BOCA-F: 604.1; BOCA-F: 605.1; 175.410m; 185.380c11)

Storage in lobbies and corridors is not permitted except when the corridors and lobbies are protected with sprinklers or smoke detectors. Metal lockers may be used as long as the required width for means of egress is maintained. Coats or other clothing may be hung open in the corridor only under prescribed conditions. **175 only:** Permits coats or other clothing to be hung in an open corridor under certain prescribed conditions. Where this is done, the width of the corridor shall be increased 15 inches on each side where cloaks are hung. **185 only:** Permits students' cloaks to be hung in the open on the side walls of corridors as long as the following criteria are met:

- The resulting clear width of such corridors is not less than 85% of the minimum allowable clear width established by 185, and
- The uninterrupted length of cloaks hung along any corridor wall is not more than 25 ft. in an unsprinklered building or 40 ft. in a sprinklered building:

Such length shall be measured horizontally from one end of the cloak hanging hooks or bars to the other end. Continuity can be interrupted by a fire break consisting of a doorway or blank wall area not less than 36 in. in width or of a partition extending outward perpendicularly from the corridor wall not less than 12 inches and upwards from the floor to an elevation not less than 24 inches above the top of the cloaks. This fire break partition, if provided, shall be considered in determining compliance with the limitations of the preceding paragraph.

**115. Artwork** (IFC15: 807.5.2.2; IFC15: 807.5.2.3; IFC09/06: 807.4.3.2)

**For schools contracted for design on or after September 25, 2007 only:** Artwork and teaching materials shall be limited on the walls of corridors to not more than 20% of the wall area. **For schools contracted for design on or after July 1, 2016 only:** Artwork and teaching materials shall be limited on walls of classrooms to not more than 50% of the specific wall area to which they are attached.

## **ELEVATORS AND CONVEYING SYSTEMS**

**121. Does Not Obstruct Egress** (IFC15: 1031; IFC09: 1030; IFC06: 1028; IFC03: 1027; BOCA-F: 605.1)

No obstructions are allowed to reduce the clear width of required paths of exit travel.

**122. Certificate of Inspection** (41 II Admin Code 1000.60)

Elevators must have a current inspection certificate.

## **EXTERIOR ITEMS**

**123. Properly Installed and Maintained Exterior Stairs** (IFC15: 1031; IFC09: 1030; IPMC09: 304.10; IFC06: 1028; IFC03: 1027; BOCA-F: 605.1)

All exterior stairways shall properly installed and maintained in good working order and be kept free of snow and ice and any other obstructions.

**124. Fire Lanes** (IFC: Section 503; BOCA-F: Section F-311)

Fire lanes that have been required by the Regional Office of Education or ISBE shall be maintained, kept clear of obstructions and marked with appropriate signage.

**125. Fire Department Connection** (41 Ill. Adm. Code 109; NFPA 13)

Fire department connections shall be unobstructed and easily accessible.

**126. Fire Hydrants** (425 ILCS 20)

No object shall be constructed, maintained or installed within 48 inches of a fire hydrant. It shall be unlawful to install, maintain, construct or enlarge any barriers, trees, bushes, walls, or other obstacles which may hide or impede the use of a fire hydrant. Any fire hydrant installed or replaced after the effective date of this *Act* [1990] shall have a discharge that is maintained at least 14 inches, but not more than 26 inches, from the surface from which the hydrant protrudes.

## FIRE ESCAPE STAIRS

**128. Existing Fire Escapes** (IFC15: 1104.16; IBC09: 3406; IBC06/03: 3404.1.3; IFC06: 1027.16.1; IFC03: 1026.16.1; BOCA-B: 1025; 185.370k; 185 Appendix Table J)

Existing fire escape stairs shall be permitted in existing buildings but shall not constitute more than 50% of the required exit capacity. **185 only:** Fire escape stairs shall be permitted as an approved means of exit only for those students above second grade and only where specifically approved by the authority having jurisdiction.

**129. Access to Fire Escapes** (IFC15: 1104.16.4; IFC06: 1027.16.4; IFC03: 1026.16.4)

Where access to the fire escape is through a window, such window shall be located with the sill not more than 18 in above the level of the exterior balcony or landing nor more than 36 in above the interior floor level. Each such window shall be easily openable and accessible. **IFC only:** Access to fire escape stairs from a corridor shall not be through an intervening room.

**130. Protection of Openings** (IFC15: 1104.16.2; IFC09: 3406.5; IFC06: 1027.16.2; IFC03: 1026.16.2; 185.370k9)

Except in buildings protected throughout with a sprinkler system, openings within 10 feet of fire escape stairs shall be protected by fire assemblies having a minimum  $\frac{3}{4}$ -hour fire-resistance rating. **IFC09 only:** Door and windows along the fire escape shall be protected with  $\frac{3}{4}$ -hour opening protectives. **185 only:**  $\frac{1}{4}$ -inch wired glazing can be used or if the building is protected throughout with sprinklers,  $\frac{1}{4}$ -inch plate glass can be used.

**131. Testing** (IPMC15/09: 304.1.1(12); IPMC15/09: 304.10; IFC06: 1027.16.5; IFC03: 1026.16.5; 185.370k15)

The AHJ is authorized to require testing or other satisfactory evidence that an existing fire escape stair meets the requirements of the code under which they were installed.

## GREENHOUSES

*This does not apply to the “greenhouse windows” commonly found in science laboratories that are installed as a window system. This applies to separate greenhouse buildings or rooms that are glass- or Plexiglas-enclosed permanent spaces with a controlled environment for growing plants, vegetables, and fruits out of season.*

**132. Maintenance of Fire-Rated Construction** (IFC: 703; BOCA-F: 303)

Required fire-rated construction shall be maintained. [See Appendix O, P, or Q for requirements]

**133. Fire Alarm Systems**

Most greenhouses used at a school are considered a classroom setting and would therefore be required to have a fire alarm system with pull stations and occupant notification. The fire alarm system in the greenhouse is not required to be connected to the main school building's fire alarm system. If the greenhouse is not used at all as a classroom setting (students have no need to enter the greenhouse), then a fire alarm system is not required, as long as it is an independent building.

**134. Detectors** (185.395c2B; 175.460a1)

Fire detectors are required in greenhouses which have heaters and are not protected by an automatic sprinkler system. The code does not require the use of heaters to trigger the requirement for detectors, but there are no smoke detectors and heat detectors that are listed for use in freezing environments.

## **GYM AND MULTIPURPOSE ROOMS**

**138. Posted Occupant Loads** (IFC: 1004.3; BOCA-F: 601.7)

Any assembly occupancy (greater than 50 persons) must have an approved occupancy load sign posted in a visible location.

**139. Number of Exits** (IFC15: 1006; IFC09: 1021; IFC06: 1019; IFC03: 1018; BOCA 604.1; BOCA-F: 606.2; 175.410; 185.360c)

Exits shall not be obstructed and number of exits shall not be reduced.

**140. Means of Egress Arrangement** (IFC15: 1029; IFC09: 1028; IFC06: 1025; IFC03: 1024; BOCA-F: 607.3; 175.310; 185.810)

Means of egress from auditoriums, including aisle and aisle accessway width, and aisle and aisle accessway design shall be designed in accordance with applicable codes.

**141. Illuminated Exit Signs** (IFC15: 1013; IFC09/06/03: 1011; BOCA-F: 610.2)

In all buildings, rooms or spaces required to have more than one exit or exit access, all required means of egress shall be indicated with approved signs reading "Exit" visible from the exit access and, where necessary, supplemented by directional signs in the exit access corridors indicating the direction and way of egress. All "exit" signs shall be located at exit doors or exit access areas, so as to be readily visible. Sign placement shall be such that any point in the exit access shall not be more than 100 ft from the nearest visible sign. Main exterior exit doors which are obviously and clearly identifiable as exits are not required to have "Exit" signs where approved.

**142. Emergency Lighting** (IFC15: 1008; IFC09/06/03: 1006; BOCA-F: 610.1)

Emergency lighting is required for means of egress illumination including all assembly areas.

**143. Maintenance of Fire-Rated Construction** (IFC: 703; BOCA-F: 303)

Required fire-rated construction shall be maintained. [See Appendix O, P, or Q for requirements]

## **HOME ECONOMICS AND FAMILY SERVICES ROOMS**

**151. Maintenance of Fire-Rated Construction** (IFC: 703; BOCA-F: 303)

Required fire-rated construction shall be maintained. [See Appendix O, P, or Q for requirements]

**152. Fire Detectors** (175.460a1; 185.395c2B)

Fire detectors are required in home economics/family services rooms not protected by an automatic sprinkler system.

**153. Exhaust Fan** (175.550c)

An exhaust fan must be provided in any home economics/family services rooms where objectionable odors or fumes are produced.

## **INDUSTRIAL TECHNOLOGY LABS AND METAL WORKING SHOPS**

**161. Maintenance of Fire-Rated Construction** (IFC: 703; BOCA-F: 303)

Required fire-rated construction shall be maintained. [See Appendix O, P, or Q for requirements]

**162. Fire Detectors** (175.460a1; 185.395c2B)

Fire detectors are required in all industrial technology and metal working shops not protected by an automatic sprinkler system.

**163. Welding Booth Exhaust** (IPMC: 403.4; BOCA-PM: 404.4; 175.552; 185.460a3)

An exhaust fan must be provided in every welding booth. Such contaminated air must be exhausted to the outside and not re-circulated.

**164. Eye Glasses** (105 ILCS 115; 23 Il Admin Code 1.420s)

Protective eye devices shall be provided to and worn by all students, teachers, and visitors when participating in or observing dangerous vocational arts and chemical-physical courses of laboratories as specified in 105 ILCS 115/1. Eye protection shall comply with ANSI Z87.1.

## **KITCHENS**

*This does not apply to Home Economic Kitchens or non-commercial cooking operations.*

**176. Maintenance of Fire-Rated Construction and Door Closers** (IFC: 703; BOCA-F: 303)

Required fire-rated construction shall be maintained. [See Appendix O, P, or Q for requirements]

**177. Fire Detectors** (175.460a1; 185.395c2B)

Fire detectors are required in kitchens not protected by an automatic sprinkler system.

**178. Fire Extinguishers** (41 Il Admin Code 251.25; IFC09-904.11.5; NFPA 96-10.10; NFPA 10-6.6)

Portable fire extinguishers shall be provided within a 30-foot travel distance of commercial-type cooking equipment. Cooking equipment involving solid fuels (whether under a hood or not) or vegetable or animal oils and fats (including deep fat fryers) shall be protected by a Class K rated portable extinguisher.

**179. Cooking Hood Exhaust** (IFC15/09/06: 609; IFC03: 610; BOCA-F: 309.1; 175.550; 185.460a2)

Each existing commercial cooking appliance and domestic cooking appliance utilized for commercial purposes shall be protected with an approved commercial kitchen exhaust hood and duct system.

**180. Regular Inspection and Cleaning of Cooking Hood Exhaust System** (IFC15/09: 609.3.3; IFC06/03: 904.11.6.3; BOCA-F: 309.2)

Kitchen cooking hood exhaust and filters shall be cleaned on a frequency that will prevent the accumulation of grease. **IFC09 only:** Kitchen hoods, grease-removal devices, fans, ducts and other appurtenances shall be inspected at 6 month intervals by qualified individuals. If cooking operations involve solid-fuel burning cooking appliances inspections shall be at 1 month intervals. If cooking operations involve charbroiling or wok cooking inspections shall be at 3 month intervals. If during the inspection it is found that hoods, grease-removal devices, fans, ducts or other appurtenances have an accumulation of grease, such components shall be cleaned.

**181. Filter Installation and Maintenance** (IFC15/09/06: 609; IFC03: 610; BOCA-F: 309.1)

Filters shall be provided, cleaned and maintained and listed for use in commercial kitchen exhaust systems.

**182. Cooking Hood Extinguishing Systems** (41 Il. Admin. Code Part 251.120)

Fire extinguishing systems installed for the protection of commercial cooking operations that produce grease-laden vapors shall comply with the UL 300. Automatic fire-extinguishing systems shall be serviced at least every 6 months and after activation of the system. One current inspection tag shall be displayed on the remote manual pull or on the system cylinder. Inspections shall be performed by contractors or personnel licensed by the Illinois Office of the State Fire Marshal for these types of systems. After January 1, 2011 licensed contractor will not be able to perform inspection, testing or maintenance on non-UL 300 listed systems.

## **LIBRARY AND MEDIA CENTERS (If classified as an Assembly Occupancy)**

**189. Posted Occupant Loads** (IFC: 1004.3; BOCA-F: 601.7)

Any assembly occupancy (greater than 50 persons) must have an approved occupancy load sign posted in a visible location.

**190. Number of Exits** (IFC15: 1006; IFC09: 1021; IFC06: 1019; IFC03: 1018; BOCA 604.1; BOCA-F: 606.2; 175.410; 185.360c)

Exits shall not be obstructed and number of exits shall not be reduced.

**191. Means of Egress Arrangement** (IFC15: 1029; IFC09: 1028; IFC06: 1025; IFC03: 1024; BOCA-F: 607.3; 175.310; 185.810)

Means of egress from auditoriums, including aisle and aisle accessway width, and aisle and aisle accessway design shall be designed in accordance with applicable codes.



**192. Illuminated Exit Signs** (IFC15: 1013, IFC09/06/03: 1011; BOCA-F: 610.2)

In all buildings, rooms or spaces required to have more than one exit or exit access, all required means of egress shall be indicated with approved signs reading “Exit” visible from the exit access and, where necessary, supplemented by directional signs in the exit access corridors indicating the direction and way of egress. All “exit” signs shall be located at exit doors or exit access areas, so as to be readily visible. Sign placement shall be such that any point in the exit access shall not be more than 100 ft from the nearest visible sign. Main exterior exit doors which are obviously and clearly identifiable as exits are not required to have “Exit” signs where approved.

**193. Emergency Lighting** (IFC15: 1008; IFC09/06/03: 1006; BOCA-F: 610.1)

All means of egress shall be equipped with emergency lighting, including all assembly areas.

**194. Maintenance of Fire-Rated Construction and Door Closers** (IFC: 703; BOCA-F: 303)

Required fire-rated construction shall be maintained. [See Appendix O, P, or Q for requirements]

**195. Fire Detectors** (175.460a1; 185.395c2D)

**Parts 175 and 185 only:** Smoke or heat detectors are required in libraries and media centers if the room or area has interior finish with flame spread greater than 75 and is not protected with sprinklers.

## **MECHANICAL AND FURNACE ROOMS**

**198. Maintenance of Fire-Rated Construction and Door Closers** (IFC: 703; BOCA-F: 303)

Required fire-rated construction shall be maintained. [See Appendix O, P, or Q for requirements]

**199. Fire Detectors** (175.460a; 185.395c2A)

Fire detectors are required in mechanical rooms which are not protected by an automatic sprinkler system.

**200. Storage of Combustibles** (IFC15: 315.3.3; IFC09/06/03: 315.2.3; BOCA-F: 308.1; 175.532; 185.435; NFPA 54)

Clearances to combustible materials shall be maintained so the operation of furnaces and other gas appliances will not create a hazard to persons or property, but a minimum clearance is required to permit maintenance and inspection of equipment. **IFC only:** Combustible materials shall not be stored in mechanical rooms. A mechanical room is defined by the IMC as a room or space in which nonfuel-fired mechanical equipment and appliances are located.

## MUSIC PRACTICE ROOMS

**202. Sound Proofing Used As Wall Covering** (IFC15/09/06: Chapter 8; IFC03: 806; BOCA-F: 305)

Interior finish in music practice rooms shall comply with the applicable requirements for flame spread and smoke development.

## PHOTO DEVELOPING LABS

**208. Maintenance of Fire-Rated Construction and Door Closers** (IFC: 703; BOCA-F: 303)

Required fire-rated construction shall be maintained. [See Appendix O, P, or Q for requirements]

**209. Fire Detectors** (175.460a1; 185.395c2B)

Fire detectors are required in photo developing rooms not protected by an automatic sprinkler system.

**210. Exhaust Fan** (IPMC: 403.4; BOCA-PM: 404.4; 175.564; 185.460c)

An exhaust fan must be provided in any photo developing lab where objectionable odors or fumes are produced. Such contaminated air must be exhausted to the outside and not re-circulated.

**211. Proper Storage and Use of Flammable and Combustible Liquids and Other Chemicals/Portable Gasoline Containers** (IFC15: Part V; IFC: 2701.1; BOCA-F: 3203.2; BOCA-PM: 703.2)

Flammable and combustible liquids and other chemicals shall be stored in accordance with applicable codes. Only approved gasoline containers shall be used. Plastic containers meeting the requirements of and used for petroleum products within the scope of one or more of the specifications listed in Appendix B shall be acceptable. [See Appendix B for information]

## SCIENCE LABORATORIES

**225. Maintenance of Fire-Rated Construction and Door Closers** (IFC: 703; BOCA-F: 303)

Required fire-rated construction shall be maintained. [See Appendix O, P, or Q for requirements]

**226. Fire Detectors** (175.460a1; 185.395c2B)

Fire detectors are required in science laboratories not protected by an automatic sprinkler system.

**227. Exhaust Fan** (IPMC: 403.4; BOCA-PM: 404.4; 175.564; 185.460a6)

An exhaust fan must be provided in science laboratories where objectionable odors or fumes are produced.

**228. Fume Hood Exhaust** (IPMC: 403.4; BOCA-PM: 404.4; 175.564; 185.460a5)

A fume hood exhaust for mixing chemicals is to be provided with a separate system which is exhausted to the outside and not re-circulated. Fume exhaust hoods shall not be used for storage.

**229. Eye Glasses** (105 ILCS 115; 23 II Admin Code 1.420s)

Protective eye devices shall be provided to and worn by all students, teachers, and visitors when participating in or observing dangerous vocational arts and chemical-physical courses of laboratories as specified in 105 ILCS 115/1. Eye protection shall comply with ANSI Z87.1.

**230. Proper Storage and Use of Flammable and Combustible Liquids and Other Chemicals/Portable Gasoline Containers** (IFC15: Part V; IFC: 2701.1; BOCA-F: 3203.2; BOCA-PM: 703.2)

Flammable and combustible liquids and other chemicals shall be stored in accordance with applicable codes. Only approved gasoline containers shall be used. Plastic containers meeting the requirements of and used for petroleum products within the scope of one or more of the specifications listed in Appendix B shall be acceptable. [See Appendix B for information]

**231. Emergency Fuel Burner Switch** (IFGC15/09: 409.6)

**Applies only to schools approved for design on or after January 1, 2010:** Where provided with two or more gas outlets, including table-, bench-, and hood-mounted outlets, each laboratory space in educational, research, commercial, and industrial occupancies shall be provided with a single dedicated shutoff valve through which all such gas outlets shall be supplied. The dedicated shutoff valve shall be readily accessible, located within the laboratory space served, located adjacent to the egress door from the space, and shall be identified by approved signage stating "Gas Shutoff".

## **SHOWER AND LOCKER ROOMS**

**235. Number of Exits** (IFC15: 1006; IFC09: 1021; IFC06: 1019; IFC03: 1018; BOCA 604.1; BOCA-F: 606.2; 175.410; 185.360c)

Exits shall not be obstructed and number of exits shall not be reduced.

**236. Illuminated Exit Signs** (IFC15: 1013; IFC09/06/03: 1011; BOCA-F: 610.2)

In all buildings, rooms or spaces required to have more than one exit or exit access, all required means of egress shall be indicated with approved signs reading "Exit" visible from the exit access and, where necessary, supplemented by directional signs in the exit access corridors indicating the direction and way of egress. All "exit" signs shall be located at exit doors or exit access areas, so as to be readily visible. Sign placement shall be such that any point in the exit access shall not be more than 100 ft from the nearest visible sign. Main exterior exit doors which are obviously and clearly identifiable as exits are not required to have "Exit" signs where approved.

**237. Exhaust Fan/Ventilation** (IMC: 403.3; BOCA-MC: 175.558; 175.560; 185.457; 185.460a1)

**IMC only:** Mechanical ventilation/exhaust is required with a minimum exhaust airflow rate of 0.5 cfm/ft<sup>2</sup>. Recirculation is prohibited, except under certain circumstances. See code

requirements. **BOCA-MC:** Ventilation at 0.5 cfm/ft<sup>2</sup> either by natural or mechanical ventilation. **175/185 only:** An exhaust fan must be provided in every shower/locker room. **185 for locker rooms only:** Mechanical ventilation is not required if proper ventilation can be obtained using exterior windows and doors. See code requirements in 185.457.

**238. Vapor-Proof Lights** (175.660d; 185.510a)

Vapor-proof lighting fixtures, devices, controls, and raceway systems shall be used in or adjacent to shower rooms and similar areas characterized by high moisture conditions.

## **STAGES (Large), DRESSING ROOMS AND OTHER ACCESSORY AREAS**

*These requirements pertain to those stages with overhead hanging curtains, drops, scenery or stage effects other than lighting and sound; or a stage where the distance between the top of the proscenium opening and the ceiling above the stage is more than 5 ft or the overall stage height is more than 50 ft. These are usually only found in high schools.*

**243. Illuminated Exit Signs** (IFC15: 1013; IFC09/06/03: 1011; BOCA-F: 610.2)

In all buildings, rooms or spaces required to have more than one exit or exit access, all required means of egress shall be indicated with approved signs reading "Exit" visible from the exit access and, where necessary, supplemented by directional signs in the exit access corridors indicating the direction and way of egress. All "exit" signs shall be located at exit doors or exit access areas, so as to be readily visible. Sign placement shall be such that any point in the exit access shall not be more than 100 ft from the nearest visible sign. Main exterior exit doors which are obviously and clearly identifiable as exits are not required to have "Exit" signs where approved. Exit signs may not be covered during performances.

**244. Emergency Lighting** (IFC15: 1008; IFC09/06/03: 1006; BOCA-F: 610.1)

Emergency lighting shall be provided in stage and accessory areas.

**245. Maintenance of Fire-Rated Construction and Door Closers** (IFC: 703; BOCA-F: 303)

Required fire-rated construction shall be maintained. [See Appendix O, P, or Q for requirements]

**246. Proscenium Wall Opening Protection** (IBC: 410; BOCA-B: 412; 175.310e; 185.360e)

**IBC/BOCA-B only:** Legitimate (large) stages shall be completely separated from the seating area by a proscenium wall with not less than a 2-hour fire-resistance rating. The proscenium opening of every legitimate (large) stage shall be provided with a proscenium curtain of approved material and the closing of the curtain from the full open position shall be effected in less than 30 seconds, but the last 8 feet of travel shall require not less than 5 seconds. **175/185 only:** The proscenium opening shall be provided with a noncombustible or flame proofed proscenium curtain. Doors in the proscenium wall shall be of the self-closing type and of metal or solid core wood construction. Proscenium curtains shall be installed, maintained, and tested in accordance with NFPA 101. [See Appendix E for requirements]

**247. Curtains and Scenery** (IFC15/09/06: Chapter 8; IFC03: 805; IFC03: 806; BOCA-F: 306; 175.430c; 185.390k)

Stage curtains must be flameproof or fire retardant. All other decorative materials shall be of noncombustible material or flame retardant.

**248. Sprinkler Systems and Ventilators** (IBC: 410; BOCA-B: 412; 175.310e; 185.360e1)

Every stage located in a Class A or B Assembly Occupancy as defined by Part 175 or Part 185 or legitimate (large) stages approved for design under Part 180 rules, which are equipped with fly galleries, gridirons, and rigging for movable theater-type scenery shall be protected by sprinklers. Such protection shall also be provided in auxiliary spaces such as dressing rooms, storerooms, and workshops. Requirements of this rule shall not apply to stages not falling within the scope of language above, i.e. unenclosed platform-type stages or stages without proscenium walls. **Part 185 and 175 only:** If the stage falls under one of the exemptions for sprinklers, then fire detection is required.

**249. Standpipes for Stages** (IFC 905.3.4; BOCA-B: 412.7; 175.310b; NFPA 101-8-1516)

**IFC only:** Standpipes are required for stages greater than 1,000 ft<sup>2</sup>. **BOCA 1993/1996 only:** A wet standpipe system in accordance with Section 914 shall be provided and equipped with 1½-inch hose connections on each side of the stage. **175 only (from NFPA 101-1967):** Each stage shall be equipped with 2½-inch standpipe and hose on each side of the stage, installed in accordance with NFPA 14.

## **STAGES (Small)**

*These requirements apply to those smaller stages found in your typical grade school and middle school or an enclosed platform where the distance between the top of the proscenium opening and stage ceiling is not more than 5 ft. Scenery is still used, but normally not hung from professional riggings installed in the ceiling as with the Large Stages in the section above.*

**256. Illuminated Exit Signs** (IFC15: 1013; IFC09/06/03: 1011; BOCA-F: 610.2)

In all buildings, rooms or spaces required to have more than one exit or exit access, all required means of egress shall be indicated with approved signs reading “Exit” visible from the exit access and, where necessary, supplemented by directional signs in the exit access corridors indicating the direction and way of egress. All “exit” signs shall be located at exit doors or exit access areas, so as to be readily visible. Sign placement shall be such that any point in the exit access shall not be more than 100 ft from the nearest visible sign. Main exterior exit doors which are obviously and clearly identifiable as exits are not required to have “Exit” signs where approved. Exit signs shall not be covered during performances.

**257. Emergency Lighting** (IFC15:1008; IFC09/06/03: 1006; BOCA-F: 610.1)

Emergency lighting shall be provided in stage and accessory areas.

**258. Curtains and Scenery** (IFC15/09/06: Chapter 8; IFC03: 805; IFC03: 806; BOCA-F: 306; 175.430c; 185.390k)

Stage curtains must be flameproof or fire retardant. All other decorative materials shall be of noncombustible material or flame retardant.

**259. Fire Detectors** (175.460a3; 185.395c2E)

Fire detectors are required in all stages, dressing rooms, and storage rooms which are part of or accessory to an assembly occupancy room and not protected by an automatic sprinkler system.

## **STAGES WITH STORAGE UNDERNEATH**

**265. Maintenance of Fire-Rated Construction and Door Closers** (IFC15: 315.3.4; IFC09/06/03: 315.2.4; IFC: 703; BOCA-F: 303)

Required fire-rated construction shall be maintained. [See Appendix O, P, or Q for requirements]

**266. Noncombustible Storage Only** (IFC15: 315.3.4; IFC09/06/03: 315.2.4;)

**IFC15 only:** One-hour separation is not required if the area below the stage is protected with sprinklers. **IFC09/06/03 only:** One-hour separation is not required for storage spaces under stage are used for only noncombustible storage, or if area below stage is protected with sprinklers.

**267. Fire Detectors** (175.460a3; 185.395c2E)

Fire detectors are required in storage areas not protected by an automatic sprinkler system.

**268. Sprinklers** (IBC15: 410.7; IBC09/06/03: 410.6(1); BOCA-B96: 412.6; BOCA-B93: 412.6(4))

If the stage is required to be sprinklered, then the storage space under the stage also must be protected with sprinklers. **IBC/BOCA-B96 only:** Sprinklers are not required under stage areas less than 4 feet in clear height utilized exclusively for storage of tables and chairs, provided the conceals space is separated from the adjacent spaces by not less than 5/8-inch Type X gypsum board. **BOCA-B93 only:** Sprinklers are not required under stages less than 4 feet in clear height utilized for storage and the stage supporting structures are of 1-hour fire resistance rating.

## **STAIRWELLS**

**272. Properly Maintained Stairs** (IPMC: 305.4; BOCA-PM: 305.5; 185.370c10G)

Stairs, walking surfaces and rails shall be maintained in sound condition and good repair.

**185 only:** Non-slip treads are required on all stairs.

**273. Illuminated Exit Signs** (IFC15: 1013; IFC09/06/03: 1011; BOCA-F: 610.2)

In all buildings, rooms or spaces required to have more than one exit or exit access, all required means of egress shall be indicated with approved signs reading "Exit" visible from the exit access and, where necessary, supplemented by directional signs in the exit access corridors indicating the direction and way of egress. All "exit" signs shall be located at exit doors or exit access areas, so as to be readily visible. Sign placement shall be such that any point in the exit access shall not be more than 100 ft from the nearest visible sign. Main exterior exit doors which are obviously and clearly identifiable as exits are not required to have "Exit" signs where approved.

**274. Emergency Lighting** (IFC15: 1008; IFC09/06/03: 1006; BOCA-F: 610.1)

Emergency lighting is required for means of egress illumination in stairwells.

**275. Interior Exit Stair Enclosures** (IFC: 703; BOCA-F: 303; BOCA-F: 606.3; BOCA-PM: 704)

Required fire-rated construction shall be maintained. [See Appendix O, P, or Q for requirements]

**276. No Storage under or in Stairs/Stairways** (IFC15: 315.3.2; IFC: 315.2.2; BOCA-F: 606.1.1; BOCA-PM: 703.1)

The space located beneath a stair can only be used for storage if it is enclosed with one-hour fire rated construction. Access to the enclosed usable storage area shall not be directly from within the stair enclosure.

**277. Fire Detectors** (185.395c2F)

**185 only:** Fire detectors are required at the top of stairwells not protected by an automatic sprinkler system.

## **STORAGE, SUPPLY ROOMS AND CLOSETS**

**283. Maintenance of Fire-Rated Construction** (IFC: 703; BOCA-F: 303)

Required fire-rated construction shall be maintained. [See Appendix O, P, or Q for requirements]

**284. Fire Detectors** (175.460a4; 185.395c2A)

Fire detectors are required in storage areas not protected by an automatic sprinkler system. **175 only:** Detector is required if storage room is greater than 10 ft<sup>2</sup>.

**285. Classroom, Janitor's Closets and Cloakrooms** (175.290b; 185.310e5C; 185.310e5D)

**175 only:** To avoid the requirement for automatic closing devices, closet doors, which are open only when a responsible person is in attendance, must normally be kept locked. **185 only:** Teachers' closets not more than 12 ft<sup>2</sup> in areas with access doorway directly from a normal educational classroom shall be considered as part of the classroom and shall not be required to be separated. Rooms that lead directly into a normal educational classroom used only for the storage of coats and other apparel and not more than 100 ft<sup>2</sup> in area shall not be required to be separated. Cloakrooms not more than 100 sq. ft. in area with access doorway there into directly from a normal Educational Occupancy classroom shall be considered as part of such classroom and thereby, classified as an Educational Occupancy, provided-the use of such cloakrooms is restricted to that attendant with the normal storage of wraps, coats and other human apparel. Where cloakrooms are used for any purposes other than that of storage of cloaks, wraps, and other human apparel or are more than 100 sq. ft. in area, such rooms shall be classified as Storage Occupancies and shall comply with the requirements of Section 185.390(f)(1).

## **SWIMMING POOLS**

*(A) Applies only if the swimming pool area can be classified as an Assembly Occupancy.*

### **289. Posted Occupant Loads (A)** (IFC: 1004.3; BOCA-F: 601.7)

Any assembly occupancy (greater than 50 persons) must have an approved occupancy load sign posted in a visible location.

### **290. Number of Exits (A)** (IFC15: 1006; IFC09: 1021; IFC06: 1019; IFC03: 1018; BOCA 604.1; BOCA-F: 606.2; 175.410; 185.360c)

Exits shall not be obstructed and number of exits shall not be reduced.

### **291. Means of Egress Arrangement (A)** (IFC15:1029; IFC09: 1028; IFC06: 1025; IFC03: 1024; BOCA-F: 607.3; 175.310; 185.810)

Means of egress from auditoriums, including aisle and aisle accessway width, and aisle and aisle accessway design shall be designed in accordance with applicable codes.

### **292. Illuminated Exit Signs (A)** (IFC15: 1013; IFC09/06/03: 1011; BOCA-F: 610.2)

In all buildings, rooms or spaces required to have more than one exit or exit access, all required means of egress shall be indicated with approved signs reading "Exit" visible from the exit access and, where necessary, supplemented by directional signs in the exit access corridors indicating the direction and way of egress. All "exit" signs shall be located at exit doors or exit access areas, so as to be readily visible. Sign placement shall be such that any point in the exit access shall not be more than 100 ft from the nearest visible sign. Main exterior exit doors which are obviously and clearly identifiable as exits are not required to have "Exit" signs where approved.

### **293. Emergency Lighting (A)** (IFC15: 1008; IFC09/06/03: 1006; BOCA-F: 610.1)

All means of egress shall be equipped with emergency lighting, including all assembly areas.

### **294. Maintenance of Fire-Rated Construction and Door Closers (A)** (IFC: 703; BOCA-F: 303)

Required fire-rated construction shall be maintained. [See Appendix O, P, or Q for requirements]

### **295. Vapor-Proof Lights** (175.660d; 185.510a)

Vapor-proof lighting fixtures, devices, controls, and raceway systems shall be used in or adjacent to swimming pool rooms, and similar areas characterized by high moisture conditions.

### **296. Exhaust Fan** (175.554; 185.460a7)

Exhaust fans must be provided in every swimming pool room.

### **297. IDPH Safety Equipment** (77 Ill. Adm. Code 820.310)

Lifesaving equipment is to be mounted in readily accessible location in accordance with minimum sanitary requirements for the design and operation of swimming pools and bathing beaches as produced by the IDPH.



**298. Fire Extinguishers (NFPA 10-5.5.7)**

If a fire extinguisher is provided in the pool area, only water fire extinguishers shall be installed in areas containing oxidizers such as pool chemicals. Multipurpose dry chemical fire extinguishers shall not be installed in areas containing oxidizers.

**299. Fire Detectors (A) (185.395c2D)**

**Part 185 only:** Smoke or heat detectors are required in assembly areas if the room or area has interior finish with flame spread greater than 75 and is not protected with sprinklers.

## **TEACHERS' WORKROOMS AND LOUNGES**

**301. Maintenance of Fire-Rated Construction and Door Closers (IFC: 703; BOCA-F: 303)**

If the teachers' lounge has any cooking or heating appliances the required fire-rated construction shall be maintained. [See Appendix O, P, or Q for requirements]

**302. Fire Detectors (175.460a1; 185.395c2E)**

Fire detectors are required in teachers' workrooms and any lounges where there are cooking or heating appliances if these areas are not protected by an automatic sprinkler system.

**303. Exhaust Fan (175.550c)**

An exhaust fan must be provided in any teachers' workroom/lounge where there are any cooking or heating appliances where objectionable odors fumes may be produced.

## **TIME-OUT ROOMS**

**304. Ceiling Height (23 Ill. Admin. Code 1.285a1A)**

Any enclosure used for isolated time out shall have the same ceiling height as the surrounding room or rooms and be large enough to accommodate not only the student being isolated but also any other individual who is required to accompany that student.

**305. Safe Construction (23 Ill. Adm. Code 1.285a; IFC15/09/06: Chapter 8; IFC03: 806; BOCA-F: 305)**

Any enclosure used for isolated time out shall be constructed of materials that cannot be used by students to harm themselves or others, be free of electrical outlets, exposed wiring, and other objects that could be used by students to harm themselves or others, and be designed so that students cannot climb up the walls (including walls far enough apart so as not to offer the students being isolated sufficient leverage for climbing). If an enclosure is fitted with a door, either a steel door or a wooden door of solid-core construction shall be used. If the door includes a viewing panel, the panel shall be unbreakable. Any padding shall comply with applicable codes for flame spread, smoke development, and fire resistance.

**306. Locking** (23 Ill. Adm. Code 1.285a4)

If a locking mechanism is used on the enclosure, the mechanism shall be constructed so that it will engage only when a key, handle, knob, or other similar device is being held in position by a person, unless the mechanism is an electrically or electronically controlled one that is automatically released when the building's fire alarm system is triggered. Upon release of the locking mechanism by the supervising adult, the door must be able to be opened readily.

**307. Monitoring** (23 Ill. Admin. Code 1.285a1C)

Any enclosure for isolated time out shall be designed to permit continuous visual monitoring of and communication with the student.

## **TOILETS**

**309. Exhaust Fan** (IPMC: 403.2; BOCA-PM: 404.2; 175.556; 185.460a1)

Exhaust fans must be provided in every toilet room.

## **WOODWORKING SHOPS**

**315. Maintenance of Fire-Rated Construction and Door Closers** (IFC: 703; BOCA-F: 303)

Required fire-rated construction shall be maintained. [See Appendix O, P, or Q for requirements]

**316. Fire Detectors** (175.460a2; 185.395c2B)

Fire detectors are required in woodworking shops that are not protected by an automatic sprinkler system.

**317. Fire Extinguishers** (IFC15: 2804.3; IFC09/06/03: 1904.2; BOCA-F: 1603.3)

A fire extinguisher suitable for Class A fires is required to be installed within 50 ft of any machine producing shavings or sawdust. The fire extinguisher must be inspected annually by a contractor licensed by the Office of the State Fire Marshal and the fire extinguisher shall display a current inspection tag. **IFC only:** A standpipe system with hose connected to an approved water supply and located within 50 feet to any machine producing shavings or sawdust can be used in lieu of fire extinguishers.

**318. Sawdust Collector and Exhaust** (IFC15: 2803.3; IFC09/06/03: 1903.2; BOCA-F: 1603.2; 175.562; 185.460b)

A special exhaust system to collect sawdust is required in woodworking shops. Collection device must be emptied regularly.

**319. Eye Glasses** (105 ILCS 115; 23 II Admin Code 1.420s)

Protective eye devices shall be provided to and worn by all students, teachers, and visitors when participating in or observing dangerous vocational arts and chemical-physical courses of laboratories as specified in 105 ILCS 115/1. Eye protection shall comply with ANSI Z87.1.

**320. Housekeeping** IFC15: 2803.3.1; (IFC09/06/03: 1903.3.1; BOCA-F: 1603.2)

Provisions shall be made for systematic, thorough cleaning of the woodworking area at sufficient intervals to prevent the accumulation of combustible dust and spilled combustible or flammable liquids and to keep the premises clean. All horizontal flat areas, including shelves, sills, fixtures and similar geometries where dust can settle and collect shall be part of this systematic cleaning program.

# APPENDIX A

## Code References and Acronyms

23 Il. Adm. Code 1	Public Schools Evaluation, Recognition and Supervision
29 CFR 1910	Title 29 of the Code of Federal Regulations-1910 is Labor
29 Il. Adm. Code 1500	Joint Rules of the Office of the State Fire Marshal and the Illinois State Board of Education: School Emergency and Crisis Response Plans
41 Il. Adm. Code 109	Fire Sprinkler Contractor Rules
41 Il Adm. Code 111	School Inspections
41 Il. Adm. Code 251	Fire Equipment Distributor and Employee Standards
41 Il. Adm. Code 1000	Illinois Elevator Safety Rules
105 ILCS 5/	School Code
105 ILCS 115/	Eye Protection in School Act
105 ILCS 128/	School Safety Drill Act
105 ILCS 135/	Toxic Art Supplies in Schools Act
175	Health Life Safety Code 175, Built after July 1, 1965
175/101	NFPA 101-Life Safety Code, 1967 edition
180	Health Life Safety Code 180, Built after March 25, 1995
185	Health Life Safety Code 185, Built before July 1, 1965
225 ILCS 317	Fire Sprinkler Contractor Licensing Act
425 ILCS 20	Fire Hydrant Act
430 ILCS 75	Boiler and Pressure Vessel Safety Act
430 ILCS 60	Safety Glazing Materials Act
AHJ	Authority Having Jurisdiction
ANSI	American National Standards Institute
ANSI/UL 1313	Nonmetallic Safety Cans for Petroleum Products
ANSI Z87.1	Practice for Occupational and Educational Eye and Face Protection (2003)
ANSI Z97.1	Safety Glazing Materials Used in Buildings (1966 or later as adopted by the Illinois Department of Labor)
ANSI Z358.1	Emergency Eye Wash and Shower Equipment
ASME B&PV Code	American Society of Mechanical Engineers-Boiler and Pressure Vessel Safety Code (2007)
ASTM	American Society of Testing Materials
ASTM E-84	Standard Test Method for Surface Burning Characteristics of Building Materials
ASTM F852	Standard for Portable Gasoline Containers for Consumer Use
ASTM F976	Standard for Portable Kerosene containers for Consumer Use
BOCA	Building Officials and Code Administrators
BOCA-B	BOCA National Building Code (1993 and 1996)*
BOCA-F93	BOCA National Fire Prevention Code (1993)
BOCA-F96	BOCA National Fire Prevention Code (1996)
BOCA-F	BOCA National Fire Prevention Code (1993 and 1996)*
BOCA-MC	BOCA National Mechanical Code
BOCA-PM	BOCA Property Maintenance Code
CFR	Code of Federal Regulations
CPSC	Consumer Product Safety Commission
DOC FF-1 "pill test"	CPSC 16 CFR, Part 1630-Standard for the Surface Flammability of Carpets and Rugs
ESFR	Early Suppression Fast Response
FM	Factory Mutual

IAQ	Indoor Air Quality
IARSS	Illinois Association of Regional Superintendents of Schools <a href="http://www.iarss.org">www.iarss.org</a>
IBC	International Building Code (2003, 2006, 2009, and 2015)
ICC	International Code Council
ICC 300	Bleachers, Folding, Telescopic Seating, and Grandstands (2002, 2007, and 2012)
IDA	Illinois Department of Agriculture
IDPH	Illinois Department of Public Health
IFC	International Fire Prevention Code (2003, 2006, 2009, and 2015)*
IFC03	International Fire Code (2003)
IFC06	International Fire Code (2006)
IFC09	International Fire Code (2009)
IFC15	International Fire Code (2015)
IFGC09	International Fuel Gas Code (2009)
IFGC15	International Fuel Gas Code (2015)
Ill. Adm. Code	Illinois Administrative Code
ILCS	Illinois Compiled Statutes
IMC	International Mechanical Code (1996, 2003, 2006 and 2009)*
IPMC	International Property Maintenance Code (2003, 2006, 2009, and 2015)*
ISBE	Illinois State Board of Education <a href="http://www.isbe.net">www.isbe.net</a>
IWAS	ISBE Web Application Security
NFPA	National Fire Protection Association
NFPA 10	Standard for Portable Fire Extinguishers (2007)
NFPA 13	Standard for the Installation of Sprinkler Systems
NFPA 14	Standard for the Installation of Standpipe & Hose Systems
NFPA 17	Standard for Dry Chemical Extinguishing Systems
NFPA 33	Standard for Spray Application Using Flammable or Combustible Materials
NFPA 40	Standard for the Storage and Handling of Cellulose Nitrate Motion Picture Film
NFPA 54	National Fuel Gas Code
NFPA 70	National Electrical Code
NFPA 72	National Fire Alarm Code
NFPA 72A	Standard for Local Protective Signaling Systems
NFPA 80	Standard for Fire Doors and Fire Windows
NFPA 80	Standard for Fire Doors and Other Opening Protectives
NFPA 96	Standard for Ventilation Control and Fire Protection of Commercial Cooking Operations (2008)
NFPA 101	Life Safety Code (1967)
NFPA 102	Places of Outdoor Assembly, Grandstands and Tents
NFPA 110	Standard for Emergency and Standby Power Systems
NFPA 255	Standard Method of Test of Surface Burning Characteristics of Building Materials
NFPA 286	Standard Methods of Fire Tests for Evaluating Contribution of Wall and Ceiling interior Finish to Room Fire Growth
NFPA 701	Standard Methods of Fire Tests for Flame Propagation of Textiles and Films
OSFM	Office of the State Fire Marshal <a href="http://www.sfm.illinois.gov">www.sfm.illinois.gov</a>
OSHA	Occupational Safety and Health Administration
UL	Underwriter's Laboratories
UL 300	Standard for Fire Testing of Fire Extinguishing Systems for Protection of Commercial Cooking Equipment
UL 924	Standard for Safety Emergency Lighting and Power Equipment

(\* Section numbering did not change between edition years)

## APPENDIX B

### The Storage/Handling of Flammable/Combustibles Liquids and Other Chemicals

#### 1. Storage of Flammable and Combustible Liquids

- Flammable and combustible liquids stored in an approved cabinet
- Maximum of three cabinets in a single fire area
- Venting to outside not required to be hooked up, but the vent opening itself must be covered using manufacturer's (provided) cover
- Flammable and combustible liquids kept outside of the cabinet must be stored in an approved safety can (See below for more information on plastic gas cans).
- Control ignition sources
- Approved garbage receptacles for oily rags
- Housekeeping
- Plastic gasoline containers that comply with one or more of the following standards are acceptable to use: ASTM F852; ASTM F976; ANSI/UL 1313

#### 2. Storage of Gases

- Flammable gases should not be stored with nonflammable oxidizing gases. Keep a 20 ft separation or a ½-hr fire rated wall
- Cylinders shall always be secured upright whether full or empty. Propane/LPG tanks should be stored outside and in an approved cage, but the code permits indoor storage under certain circumstances
- Gas storage area should be clear of combustible storage
- Control ignition sources
- Housekeeping
- Protect from physical damage

#### 3. Spray Paint Areas

- Storage of flammable spray paints in an approved cabinet
- Exhaust has filters and filters are changed or cleaned regularly
- Approved garbage receptacles for used oily and paint rags
- Housekeeping

#### 4. The Storage of Corrosives with in Flammable Liquids Cabinets with Flammable and Combustible Liquids

Corrosives are not all combustible, but their chief hazard lies in the danger of leakage and possible mixture with other chemicals or combustible material stored in the vicinity, since fire or explosions could occur from mixing of the chemicals. Some corrosives are strong oxidizing agents and would provide oxygen to accelerate the burning of other combustible materials. For this reason oxidizing corrosives should never be stored in the same areas as flammable liquids. The first principle of good storage practice for chemicals is segregation, including separation from other materials in storage, from processing and handling operations and from other incompatible materials.

## APPENDIX C

### Fire Alarm Inspection, Testing, and Maintenance

Building Codes	Location of Fire Alarm ITM Requirements
<b>2015 IBC.</b> For new fire alarm systems contracted for design <b>on or after July 1, 2016</b> . For system contracted for design <b>before July 1, 2016</b> , allows compliance with IBC 2009, IBC 2006, IBC 2003, BOCA 96, BOCA 93, Part 175, or Part 185.	IFC (15): 907.9 and NFPA 72 (2013)
<b>2009 IBC.</b> For new fire alarm systems contracted for design <b>on or after January 1, 2010 but before July 1, 2016</b> . For systems contracted for designed <b>before January 1, 2010</b> , allows compliance with IBC 2006, IBC 2003, BOCA 96, BOCA 93, Part 175, or Part 185.	IFC (09): 907.9 and NFPA 72 (2007)
<b>2006 IBC.</b> For fire alarm systems contracted for design <b>on or after September 25, 2007 but before January 1, 2010</b> . For systems contracted for design before September 25, 2007, allows compliance with IBC 2003, BOCA 96, BOCA 93, Part 175 or Part 185.	IFC (06): 907.20 and NFPA 72 (2002)
<b>2003 IBC.</b> For fire alarm systems contracted for design <b>on or after October 3, 2005 but before September 25, 2007</b> . For systems contracted for design <b>before October 3, 2005</b> , allows compliance with BOCA 96, BOCA 93, Part 175 or Part 185.	IFC (03): 907.20 and NFPA 72 (1999)
<b>1996 BOCA.</b> For fire alarm systems contracted for design <b>on or after July 6, 1998 but before October 3, 2005</b> . For systems contracted for designed <b>before October 3, 2005</b> , allows compliance with BOCA 93, Part 175 or Part 185.	BOCA-F(96): 513.1 and NFPA 72 (1996)
<b>1993 BOCA.</b> For fire alarm systems contracted for design <b>on or after March 24, 1995 and before July 6, 1998</b> . For systems designed <b>before March 24, 1995</b> , allows compliance with Part 175 or Part 185.	BOCA-F(93): 512.1 and NFPA 72 (1990)

<p><b>Part 175.</b> For fire alarm systems contracted for design <b>on or after July 1, 1965 but before March 24, 1995.</b></p> <p>For systems contracted for design <b>before July 1, 1965</b>, allows compliance with Part 185.</p>	175.610(c) and NFPA 72 (1967)
<p><b>Part 185.</b> For fire alarm systems contracted for design <b>before July 1, 1965.</b></p>	185.510(b) and NFPA 72 (1961)



## APPENDIX D

### Fire Extinguisher Installation Matrix

NFPA 10 – <i>Standard for Portable Fire Extinguishers</i> (2007) as adopted by the Illinois Administrative Code, Title 41, Part 251				
Hazard Classification	Maximum travel distance to fire extinguisher (ft)	Other Requirements		
		Maximum area to be protected per unit of "A" for Class A fires	Class B fires	Class C fires
Light hazard 2A	75	3,000 ft <sup>2</sup>		Extinguisher requires a non-conducting extinguishing media
	30		5B	
	50		10B	
Ordinary hazard 2A	75	1,500 ft <sup>2</sup>		
	30		10B	
	50		20B	
Extra hazard 4A	75	1,000 ft <sup>2</sup>		
	30		40B	
	50		80B	
Class D fires <sup>(1)</sup>	75			
Class K fires	30 <sup>(2)</sup>			(3)
Areas containing oxidizers	Only water type extinguishers shall be installed in areas containing oxidizers such as pool chemicals. Multipurpose dry chemical fire extinguishers shall not be installed in areas containing oxidizers such as pool chemicals			

<sup>(1)</sup> Size determinations shall be on the basis of the specific combustible metal, its physical particle size, area to be covered, and recommendations by the fire extinguisher manufacturer on data from control tests conducted

<sup>(2)</sup> 30 ft travel distance from cooking appliance to fire extinguisher

<sup>(3)</sup> Class C not a consideration in cooking media fires

## APPENDIX E

### **Recommendations for Periodic Inspection and Testing of Proscenium Curtains from NFPA 80-(2007)**

**\*\*This list is mandatory for proscenium curtains installed on or  
after January 1, 2010\*\***

- The fire safety (proscenium) curtain assembly should be closed at all times except when there is an event, rehearsal, or similar activity.
- The fire safety (proscenium) curtain should be labeled for compliance with testing methods and this label should be within 5 ft of the bottom of the curtain and indicate the curtain fabric's fire resistance rating.
- The rigging system should be inspected annually by someone qualified to perform the work.
- Inspection should include all components of the fire safety (proscenium) curtain assembly and operation including testing of emergency operation activation and systems.
- Re-training of the owner and staff should be mandatory during each annual inspection.
- Signed and dated inspection reports including a list of who attended the training should be kept on file with the owner for review.
- Unless temporary measures have been approved by the authority having jurisdiction, repairs required for emergency operation of the fire safety (proscenium) curtain assembly should be completed before the facility can be occupied for an event with an audience.
- Repairs not affecting the emergency closing of the fire safety (proscenium) curtain should be completed within 30 days.
- Maintenance should be carried out in accordance with the manufacturer's recommendations and schedule.
- Repairs and maintenance should be recorded in a repair/maintenance log, which should include the date, name of the person repairing or maintaining, and a description detailing parts affected, maintained and adjusted, and/or replaced. This report should be kept on file with the owner for review.

## APPENDIX F

### Periodic Testing of Emergency Lighting Equipment

#### **For buildings approved for design before October 3, 2005 (BOCA-F96: 611.2; BOCA-F93: 610.1.1)**

- Functional testing should be conducted every month for not less than 30 seconds, and
- Functional testing should be conducted annually for not less than one hour if the emergency lighting system is battery powered, and
- The emergency lighting equipment should be fully operational for the duration of the tests required by (a) and (b), and
- Written records of visual inspections and tests should be kept by the owner.

#### **For buildings approved for design on or after October 3, 2005**

#### **(NFPA 70-*National Electrical Code* 2002/2005/2008: Article 700.4 and Article 700.3 (2014 edition) as referenced by the International Code Council Electrical Code 2003/2006 and Section 2701.1 of IBC09/15)**

- Systems shall be tested periodically on a schedule acceptable to the authority having jurisdiction to ensure the systems are maintained in proper operating condition. Where battery systems or unit equipment is involved, including batteries used for starting, control, or ignition in auxiliary engines, the authority having jurisdiction shall require periodic maintenance.
- A written record shall be kept of such tests and maintenance.
- Means for testing all emergency lighting and power systems during maximum anticipated load conditions shall be provided. [For testing and maintenance procedures of emergency power supply systems (EPSSs), see NFPA]

## APPENDIX G

### Dead-End Travel Matrix

<b>185.380I(9)(A)</b>	No dead-end shall exceed 20 ft in length, except as permitted below:
<b>(i)</b>	The dead-end travel may be increased to 40 ft if the building is protected throughout with sprinklers and the room or space is not used by more than 20 persons.
<b>(ii)</b>	The dead-end travel may be increased to 40 ft if the room or space has a capacity of not more than 100 persons and is provided with a secondary path of travel to an exit that is separated from the dead-end corridor.
<b>(iii)</b>	The dead-end travel may be increased to 60 ft if the room or space has a capacity of not more than 100 persons and is all persons have access to an exterior exit. In this case the dead-end travel may be increased to 75 ft in buildings protected throughout with sprinklers.
<b>(iv)</b>	The dead-end travel may be increased to 40 ft for those dead-end corridors serving street floor rooms or spaces with capacities of more than 10 persons and is provided with an exterior exit, or a separated secondary path of exit travel, or a secondary means of escape. In this case the dead-end travel may be increased to 60 ft in buildings protected throughout with sprinklers.
<b>175.410(g)</b>	Dead end corridors requiring travel of not more than 20 ft from the door of a room to an exit shall be permitted.
<b>BOCA-F: 607.2</b>	Dead end corridors shall not exceed 35 ft except for in a building protected throughout with sprinklers the dead-end travel may be increased to 70 ft.
<b>IFC03: 1026.17.2; IFC06: 1027.17.2</b>	For educational and assembly occupancies, dead-end corridors shall not exceed 20 ft in length in sprinklered and unsprinklered buildings, except that there shall be no limit where the dead-end passageway or corridor is less than 2½-times the least width of the dead-end passageway or corridor.
<b>IFC09: 1018.4</b>	For educational and assembly occupancies, dead-end corridors shall not exceed 50 ft in length in sprinklered and unsprinklered buildings, except that there shall be no limit where the dead-end passageway or corridor is less than 2½-times the least width of the dead-end passageway or corridor.
<b>IFC15: 1020.4</b>	For educational and assembly occupancies, dead-end corridors shall not exceed 50 ft in length in sprinklered and unsprinklered buildings, except that there shall be no limit where the dead-end passageway or corridor is less than 2½-times the least width of the dead-end passageway or corridor.

## APPENDIX H

### Wall-Mounted Alcohol-Based Hand-Rub Dispensers IFC09/06)-Section 3405.5 and IFC15-Section 5705.5

**Wall-mounted alcohol-based hand rubs classified as Class I or II liquids (Flash point <140°F):** The use of wall-mounted dispensers containing alcohol-based hand rubs classified as Class I or II liquids shall be in accordance with all of the following:

1. The maximum capacity of each dispenser shall be 68 oz.
2. The minimum separation between dispensers shall be 48 in.
3. The dispensers shall not be installed directly adjacent to, directly above or below an electrical receptacle, switch, appliance, device or other ignition source. The wall space between the dispenser and the floor shall remain clear and unobstructed. **IFC15 only:** Dispensers shall not be installed above, below, or closer than 1 inch to an electrical receptacle, switch, appliance, device, or other ignition source.
4. Dispensers shall be mounted so that the bottom of the dispenser is a minimum of 42 in and a maximum of 48 in above the finished floor.
5. Dispensers shall not release their contents except when the dispenser is manually activated.
6. Storage and use of alcohol-based hand rubs shall be in accordance with the applicable provisions of Sections 3404 and 3405.
7. Dispensers installed in occupancies with carpeted floors shall only be allowed in areas equipped throughout with an approved automatic sprinkler system in accordance with Section 903.3.1.1 or 903.3.1.2. The sprinklered area must be bounded by fire walls, fire barriers, exterior walls, or smoke barriers as well as ceiling/floor assemblies.

#### **Corridor Installations (IFC06):**

1. Aerosol containers shall not be allowed in corridors.
2. The maximum capacity of each dispenser shall be 41 oz.
3. The maximum quantity allowed in a corridor within a control area shall be 10 gallons.
4. The minimum corridor width shall be 72 in.
5. Projections into a corridor shall be in accordance with Section 1003.3.3.

#### **Corridor installations (IFC15/09):**

1. Level 2 and 3 aerosol containers shall not be allowed in corridors.
2. The maximum capacity of each dispenser shall be 41 oz.
3. The maximum capacity of each Level 1 aerosol dispenser shall be 18 oz.
4. The maximum quantity allowed in a corridor within a control area shall be 10 gal of Class I or II liquids or 1,135 oz of Level 1 aerosols, not to exceed in total the equivalent of 10 gal.
5. The minimum corridor width shall be 72 in.
6. Projections into a corridor shall be in accordance with Section 1003.3.3.

# APPENDIX I

## **Decorative Vegetation IFC15/09/06)-Section 806.1**

**806.1.1 Restricted occupancies.** Natural cut trees shall be prohibited in Group A, E, I-1, I-2, I-3, I-4, M, R-1, R-2 and R-4. [E is educational].

**Exceptions:** Trees located in areas protected by an approved automatic sprinkler system installed in accordance with Section 903.3.1.1 or 903.3.1.2 shall not be prohibited in Groups A, E, M, R-1 and R-2.

**806.1.2 Support devices.** The support device that holds the tree in an upright position shall be of a type that is stable and that meets all of the following criteria:

1. The device shall hold the tree securely and be of adequate size to avoid tipping over of the tree.
2. The device shall be capable of containing a minimum two-day supply of water.
3. The water level, when full shall cover the tree stem at least 2 in. The water level shall be maintained above the fresh cut and checked at least once daily.

**806.1.3 Dryness.** The tree shall be removed from the building whenever the needles or leaves fall off readily when a tree branch is shaken or if the needles are brittle and break when bend between the thumb and index finger. The tree shall be checked daily for dryness.

## APPENDIX J

### Manual Fire Alarm Pull Stations

#### Part 185.395d3

- A. Manual alarm sending stations shall be located so as to be readily visible and accessible and shall be of the same general type throughout the school.
- B. Stations shall be near each main exit and in the natural path of escape from fire. Not less than one station shall be provided on each floor in every fire area, except that 50 ft. and one flight of stairs may be traversed to reach a station on another story in the natural path of escape.
- C. Stations shall be so located that not more than 100 ft. of corridor or primary egress aisle have to be traversed to reach a station in an unsprinklered building and 150 ft. in a sprinklered building. In addition, a station shall be provided on the auditorium side of the proscenium wall in each Class A or B assembly room and in or adjacent to boiler rooms serving spaces with a capacity over 250 persons.

#### Part 175.470f

Manual stations shall be located so as to be readily visible and accessible and shall be of the same general type throughout the building. Stations shall be near each main exit and in the natural path of escape from fire and shall be so located that not more than 100 ft. of corridor (or main aisle in an open plan school) have to be traversed to reach a station on the same story or 50 ft. and one flight of stairs to reach a station on another story in the natural path of escape. In addition, a station shall be provided on the auditorium side of the proscenium wall in assembly rooms and in, or adjacent to, boiler rooms.

#### Part 180 or BOCA and ICC Chapter 9 requirements.

Manual pull stations shall be located within 5 ft to the entrance to every exit with additional pull stations located so there will not be more than 200 foot travel to a pull station.

For construction contracted for design on or after September 25, 2007 manual fire alarm boxes are not required in schools that are protected throughout with an approved automatic sprinkler system installed in accordance with the applicable section of the 2006 or 2009 ICC codes. Occupant notification shall activate upon sprinkler water flow.

# **APPENDIX K**

## **HEALTH/LIFE SAFETY ANNUAL INSPECTION CHECKLISTS**

**(See Next Page)**



# HEALTH/LIFE SAFETY ANNUAL INSPECTION CHECKLIST (ROE)

## Administrative and General Building Requirements

- |  |   |   |
|--|---|---|
| <input type="checkbox"/> Safety reference plans (1)          | <input type="checkbox"/> Fire alarm audibility (10)       | <input type="checkbox"/> Alcohol hand-rub-dispensers (19)               |
| <input type="checkbox"/> School safety drills (2)            | <input type="checkbox"/> Manual fire alarm station (11)   | <input type="checkbox"/> Decorative vegetation (20)                     |
| <input type="checkbox"/> Annual review of crisis plans (3)   | <input type="checkbox"/> ITM of fire alarm systems (12)   | <input type="checkbox"/> Space heaters (21)                             |
| <input type="checkbox"/> Hold-open devices (4)               | <input type="checkbox"/> Functional sprinkler system (13) | <input type="checkbox"/> Furnishings and decorations (22)               |
| <input type="checkbox"/> Unobstructed exits (5)              | <input type="checkbox"/> Clearance above storage (14)     | <input type="checkbox"/> Interior wall, ceiling and floor finishes (23) |
| <input type="checkbox"/> Emergency lighting + exit signs (6) | <input type="checkbox"/> Functional standpipe system (15) | <input type="checkbox"/> Extension cords/multiple plug adaptors (24)    |
| <input type="checkbox"/> Testing of emergency lighting (7)   | <input type="checkbox"/> Fire extinguishers (16)          | <input type="checkbox"/> Electrical systems (25)                        |
| <input type="checkbox"/> Flam/comb liquids + chemicals (8)   | <input type="checkbox"/> Safety glazing (17)*             | <input type="checkbox"/> Carbon Monoxide Detection (26)                 |
| <input type="checkbox"/> Fire alarm system (9)               | <input type="checkbox"/> Shower/eye wash stations (18)*   |   |

**(A)-applies only if classified as assembly**

### Arts and Crafts Rooms

- ☐ Fire-rated construction (28)
- ☐ Fire detectors (29)
- ☐ Spray finishing (30)
- ☐ Limited Spraying Spaces (31)
- ☐ Electrical Wiring & Equip (32)
- ☐ Kiln exhaust (33)
- ☐ Kiln fuel switch (34)
- ☐ Eye glasses (35)\*
- ☐ Toxic art supplies (36)\*

### Auditoriums

- ☐ Posted occupancy loads (37)
- ☐ Number of exits (38)
- ☐ Means of egress arrange (39)
- ☐ Illuminated exit signs (40)
- ☐ Emergency lighting (41)
- ☐ Fire-rated construction (42)
- ☐ Fire detectors (43)

### Automotive Shops

- ☐ Fire-rated construction (51)
- ☐ Fire detectors (52)
- ☐ Spray paint rooms (53)
- ☐ Limited Spraying Spaces (54)
- ☐ Electrical Wiring & Equip (55)
- ☐ Welding booth exhaust (56)
- ☐ Eye glasses (57)\*

### Bleachers and Grandstands

- ☐ Inspection/maintenance (63)\*
- ☐ Storage underneath (64)

### Boiler Room

- ☐ Door swing (69)
- ☐ Fire-rated construction (70)
- ☐ Housekeeping (71)
- ☐ Fire detectors (72)
- ☐ Emergency fuel switch (73)
- ☐ Inspection posted (74)

### Cafeteria (A)

- ☐ Posted occupant loads (80)
- ☐ Number of exits (81)
- ☐ Means of egress arrange (82)
- ☐ Illuminated exit signs (83)
- ☐ Emergency lighting (84)
- ☐ Fire-rated construction (85)
- ☐ Fire detectors (86)

### Classrooms

- ☐ Doors unlocked (93)
- ☐ Fire-rated construction (94)
- ☐ Door glass-vision panel (95)
- ☐ Classroom door swing (96)
- ☐ Artwork in classrooms (97)

### Corridors

- ☐ Number of exits (108)
- ☐ Dead-end travel (109)
- ☐ Illuminated exit signs (110)
- ☐ Emergency lighting (111)
- ☐ Fire-rated construction (112)
- ☐ Width of corridors (113)
- ☐ Storage in corridors (114)
- ☐ Artwork (115)

### Elevator and Conveying Systems

- ☐ Does not obstruct egress (121)
- ☐ Certificate of Inspection (122)

### Exterior Items

- ☐ Exterior stairs maintained (123)
- ☐ Fire lanes (124)
- ☐ Fire dept connection (125)
- ☐ Fire hydrants (126)

### Fire Escape Stairs

- ☐ Existing fire escapes (128)
- ☐ Access to fire escapes (129)
- ☐ Protection of openings (130)
- ☐ Testing (131)

### Greenhouses

- ☐ Fire-rated construction (132)
- ☐ Fire alarm systems (133)
- ☐ Fire detectors (134)

### Gym and Multipurpose Rooms

- ☐ Posted occupant loads (138)
- ☐ Number of exits (139)
- ☐ Means of egress arrange (140)
- ☐ Illuminated exit signs (141)
- ☐ Emergency lighting (142)
- ☐ Fire-rated construction (143)

### Home Economics and Family Services Rooms

- ☐ Fire-rated construction (151)
- ☐ Fire detector (152)
- ☐ Exhaust fan (153)

### Industrial Technology Labs

- ☐ Fire-rated construction (161)
- ☐ Fire detectors (162)
- ☐ Welding booth exhaust (163)
- ☐ Eye glasses (164)\*

### Kitchens

- ☐ Fire-rated construction (176)
- ☐ Fire detectors (177)
- ☐ Fire extinguishers (178)
- ☐ Cooking hood exhaust (179)

- ☐ Exhaust inspections (180)
- ☐ Filter maintenance (181)
- ☐ Fire extinguishing systems (182)

### Library/Media Center (A)

- ☐ Posted occupancy loads (189)
- ☐ Number of exits (190)
- ☐ Means of egress arrange (191)
- ☐ Illuminated exit signs (192)
- ☐ Emergency lighting (193)
- ☐ Fire-rated construction (194)
- ☐ Fire detectors (195)

### Mechanical & Furnace Rooms

- ☐ Fire-rated construction (198)
- ☐ Fire detectors (199)
- ☐ Storage of combustibles (200)

### Music Practice Rooms

- ☐ Sound proofing (202)

### Photo Developing Labs

- ☐ Fire-rated construction (208)
- ☐ Fire detector (209)
- ☐ Exhaust fan (210)
- ☐ Chemical storage (211)

### Science Laboratories

- ☐ Fire-rated construction (225)
- ☐ Fire detector (226)
- ☐ Exhaust fan (227)
- ☐ Fume hood exhaust (228)
- ☐ Eye glasses (229)\*
- ☐ Chemical storage (230)
- ☐ Emergency fuel switch (231)

### Shower and Locker Rooms

- ☐ Number of exits (235)
- ☐ Illuminated exit signs (236)
- ☐ Exhaust fan (237)\*
- ☐ Vapor-proof lights (238)\*

### Stages (Large)+Accessory Rooms

- ☐ Illuminated exit signs (243)
- ☐ Emergency lighting (244)
- ☐ Fire-rated construction (245)
- ☐ Proscenium wall protection (246)
- ☐ Curtains and scenery (247)
- ☐ Sprinklers and ventilators (248)
- ☐ Standpipes (249)

### Stages (Small)

- ☐ Illuminate exit signs (256)
- ☐ Emergency lighting (257)
- ☐ Curtains+scenery (258)
- ☐ Fire detectors (259)

### Stages with Storage Under

- ☐ Fire-rated constr (265)
- ☐ Storage only (266)
- ☐ Fire detectors (267)
- ☐ Sprinklers (268)

### Stairwells

- ☐ Properly maintained (272)
- ☐ Illuminated exit signs (273)
- ☐ Emergency lighting (274)
- ☐ Stair enclosure (275)
- ☐ No storage (276)
- ☐ Fire detector (277)

### Storage/Supply/Closets

- ☐ Fire-rated constr (283)
- ☐ Fire detector (284)
- ☐ Classroom/janitor's (285)

### Swimming Pools

- ☐ Occup loads (289) (A)
- ☐ Number of exits (290) (A)
- ☐ Egress arrange (291) (A)
- ☐ Exit signs (292) (A)
- ☐ Emerg lighting (293) (A)
- ☐ Fire-rated constr (294) (A)
- ☐ Vapor-proof lights (295)\*
- ☐ Exhaust fan (296)\*
- ☐ IDPH equipment (297)\*
- ☐ Fire extinguisher (298)
- ☐ Fire detectors (299)

### Teachers Workrooms and Lounges

- ☐ Fire-rated constr (301)
- ☐ Fire detector (302)
- ☐ Exhaust fan (303)

### Time-Out Rooms

- ☐ Ceiling height (304)
- ☐ Safe construction (305)
- ☐ Locking (306)
- ☐ Monitoring (307)

### Toilets

- ☐ Exhaust fan (309)\*

### Woodworking Shop

- ☐ Fire-rated constr (315)
- ☐ Fire detectors (316)
- ☐ Fire extinguishers (317)
- ☐ Sawdust collector (318)
- ☐ Eye glasses (319)\*
- ☐ Housekeeping (320)

<b>District</b>		<b>Date:</b>
<b>School</b>		
<b>School Address</b>		<b>Inspected by:</b>

**Administration and General Building Requirements**

Y	N	N/A		(Code references found in the Glossary)	Remarks
			1	Safety reference plans	
			2	School safety drills	
			3	Annual review of crisis plans	
			4	Hold-open devices	
			5	Unobstructed exits	
			6	Emergency lighting and illuminated exit signs	
			7	Testing of emergency lighting and exit signs	
			8	Flammable/combustible liquids + chemicals	
			9	Fire alarm system	
			10	Fire alarm audibility	
			11	Unobstructed manual fire alarm stations	
			12	Inspection, testing, maintenance fire alarm system	
			13	Functional sprinkler system	
			14	Clearance above storage and from sprinklers	
			15	Functional standpipe system	
			16	Fire extinguishers	
			17	Safety glazing*	
			18	Emergency shower and eye wash stations*	
			19	Wall-mounted alcohol hand-rub dispensers	
			20	Decorative vegetation	
			21	Space heaters	
			22	Furnishings and decorations	
			23	Interior Wall, ceiling, and floor finishes	
			24	Extension cords/multiple adaptors	
			25	Electrical systems	
			26	Carbon monoxide detection	

**Specific Requirements for Rooms and Spaces**

Y	N	N/A		Arts and Crafts Rooms	Remarks
			28	Fire-rated construction and door closers	
			29	Fire detectors	
			30	Spray finishing operations using flammable finishes	
			31	Limited spraying spaces	
			32	Electrical wiring and equipment	
			33	Kiln exhaust fan	
			34	Kiln fuel switch	
			35	Eye glasses*	
			36	Toxic art supplies*	

Y	N	N/A		Auditoriums	Remarks
			37	Posted occupancy load	
			38	Number of exits	
			39	Means of egress arrangement	
			40	Illuminated exit signs	
			41	Emergency lighting	
			42	Fire-rated construction and door closers	
			43	Fire detectors	

<b>Y</b>	<b>N</b>	<b>N/A</b>		<b>Automotive Shops</b>	<b>Remarks</b>
			51	Fire-rated construction and door closers	
			52	Fire detectors	
			53	Fire protection in spray paint rooms and booths	
			54	Limited Spraying Spaces	
			55	Electrical wiring and equipment	
			56	Welding booth exhaust	
			57	Eye glasses*	
<b>Y</b>	<b>N</b>	<b>N/A</b>		<b>Bleachers and Grandstands</b>	<b>Remarks</b>
			63	Installation, inspection and maintenance*	
			64	Combustible storage and waste accumulation	
<b>Y</b>	<b>N</b>	<b>N/A</b>		<b>Boiler Room</b>	<b>Remarks</b>
			69	Door swing	
			70	Fire-rated construction and door closers	
			71	Housekeeping	
			72	Fire detectors	
			73	Emergency fuel burner switch	
			74	Certificate of inspection posted	
<b>Y</b>	<b>N</b>	<b>N/A</b>		<b>Cafeteria (A)</b>	<b>Remarks</b>
			80	Posted occupant loads	
			81	Number of exits	
			82	Means of egress arrangement	
			83	Illuminated exit signs	
			84	Emergency lighting	
			85	Fire-rated construction and door closers	
			86	Fire detectors	
<b>Y</b>	<b>N</b>	<b>N/A</b>		<b>Classrooms</b>	<b>Remarks</b>
			93	Inside of exit doors unlocked	
			94	Fire-rated construction and door closers	
			95	Door glass-vision panel	
			96	Classroom door swing	
			97	Artwork in classrooms	
<b>Y</b>	<b>N</b>	<b>N/A</b>		<b>Corridors</b>	<b>Remarks</b>
			108	Number of exits	
			109	Dead-end travel	
			110	Illuminated exit signs	
			111	Emergency lighting	
			112	Fire-rated construction	
			113	Capacity and width of corridors	
			114	Storage in corridors and lobbies	
			115	Artwork	
<b>Y</b>	<b>N</b>	<b>N/A</b>		<b>Elevator and Conveying Systems</b>	<b>Remarks</b>
			121	Does not obstruct egress	
			122	Certificate of inspection	
<b>Y</b>	<b>N</b>	<b>N/A</b>		<b>Exterior Items</b>	<b>Remarks</b>

			123	Exterior stairways properly installed/maintained	
			124	Fire lanes	
			125	Fire department connection	
			126	Fire hydrants	
<b>Y</b>	<b>N</b>	<b>N/A</b>		<b>Fire Escape Stairs</b>	<b>Remarks</b>
			128	Existing fire escapes	
			129	Access to fire escapes	
			130	Protection of openings	
			131	Testing	
<b>Y</b>	<b>N</b>	<b>N/A</b>		<b>Greenhouses</b>	<b>Remarks</b>
			132	Fire-rated construction and door closers	
			133	Fire alarm systems	
			134	Fire detectors	
<b>Y</b>	<b>N</b>	<b>N/A</b>		<b>Gym and Multipurpose Rooms</b>	<b>Remarks</b>
			138	Posted occupant loads	
			139	Number of exits	
			140	Means of egress arrangement	
			141	Illuminated exit signs	
			142	Emergency lighting	
			143	Fire-rated construction and door closers	
<b>Y</b>	<b>N</b>	<b>N/A</b>		<b>Home Economics+Family Services Rooms</b>	<b>Remarks</b>
			151	Fire-rated construction and door closers	
			152	Fire detectors	
			153	Exhaust fan	
<b>Y</b>	<b>N</b>	<b>N/A</b>		<b>Industrial Technology Labs</b>	<b>Remarks</b>
			161	Fire-rated construction and door closers	
			162	Fire detectors	
			163	Welding booth exhaust	
			164	Eye glasses*	
<b>Y</b>	<b>N</b>	<b>N/A</b>		<b>Kitchens</b>	<b>Remarks</b>
			176	Fire-rated construction and door closers	
			177	Fire detectors	
			178	Fire extinguishers	
			179	Range canopy exhaust	
			180	Inspection and cleaning of cooking exhaust system	
			181	Filter installation and maintenance	
			182	Cooking hood extinguishing systems	
<b>Y</b>	<b>N</b>	<b>N/A</b>		<b>Library and Media Centers (A)</b>	<b>Remarks</b>
			189	Posted occupancy loads	
			190	Number of exits	
			191	Means of egress arrangement	
			192	Illuminated exit signs	
			193	Emergency lighting	
			194	Fire-rated construction and door closers	
			195	Fire detectors	

Y	N	N/A		<b>Mechanical &amp; Furnace Rooms</b>	<b>Remarks</b>
			198	Fire-rated construction and door closers	
			199	Fire detectors	
			200	Storage of combustibles	
Y	N	N/A		<b>Music Practice Rooms</b>	<b>Remarks</b>
			202	Sound proofing used as wall covering	
Y	N	N/A		<b>Photo Developing Rooms</b>	<b>Remarks</b>
			208	Fire-rated construction and door closers	
			209	Fire detectors	
			210	Exhaust fan	
			211	Proper storage of chemicals	
Y	N	N/A		<b>Science Laboratories</b>	<b>Remarks</b>
			225	Fire-rated construction and door closers	
			226	Fire detectors	
			227	Exhaust fan	
			228	Fume hood exhaust	
			229	Eye glasses*	
			230	Proper storage of chemicals	
			231	Emergency fuel burner switch	
Y	N	N/A		<b>Shower and Locker Rooms</b>	<b>Remarks</b>
			235	Number of exits	
			236	Illuminated exit signs	
			237	Exhaust fan*	
			238	Vapor-proof lights*	
Y	N	N/A		<b>Stage (Large), and Accessory Areas</b>	<b>Remarks</b>
			243	Illuminated exit signs	
			244	Emergency lighting	
			245	Fire-rated construction and door closers	
			246	Proscenium wall protection	
			247	Curtains and scenery	
			248	Sprinkler systems and ventilators	
			249	Standpipes for stages	
Y	N	N/A		<b>Stages (Small)</b>	<b>Remarks</b>
			256	Illuminated exit signs	
			257	Emergency lighting	
			258	Curtains and scenery	
			259	Fire detectors	
Y	N	N/A		<b>Stages with Storage Underneath</b>	<b>Remarks</b>
			265	Fire-rated construction and door closers	
			266	Noncombustible storage only	
			267	Fire detectors	
			268	Sprinklers	
Y	N	N/A		<b>Stairwells</b>	<b>Remarks</b>
			272	Properly maintained stairs	
			273	Illuminated exit signs	

			274	Emergency lighting	
			275	Interior exit stair enclosure	
			276	No storage under stairs	
			277	Fire detectors	
Y	N	N/A		<b>Storage/Supply/Closets</b>	
			283	Fire-rated construction and door closers	
			284	Fire detectors	
			285	Classroom/janitor's closets	
Y	N	N/A		<b>Swimming Pools</b>	<b>Remarks</b>
			289	Posted occupancy loads (A)	
			290	Number of exits (A)	
			291	Means of egress arrangement (A)	
			292	Illuminated exit signs (A)	
			293	Emergency lighting (A)	
			294	Fire-rated construction (A)	
			295	Vapor-proof lights*	
			296	Exhaust fan*	
			297	IDPH safety equipment*	
			298	Fire extinguishers	
			299	Fire detectors	
Y	N	N/A		<b>Teacher's Workroom/Lounge</b>	<b>Remarks</b>
			301	Fire-rated construction and door closers	
			302	Fire detectors	
			303	Exhaust fan	
Y	N	N/A		<b>Time-Out Rooms</b>	<b>Remarks</b>
			304	Ceiling height	
			305	Safe construction	
			306	Locking	
			307	Monitoring	
Y	N	N/A		<b>Toilets</b>	<b>Remarks</b>
			309	Exhaust fan*	
Y	N	N/A		<b>Woodworking Shops</b>	<b>Remarks</b>
			315	Fire-rated construction and door closers	
			316	Fire detectors	
			317	Fire extinguishers	
			318	Sawdust collector and exhaust	
			319	Eye glasses*	
			320	Housekeeping	

\*Will not be addressed by fire service personnel

**Comments:**

---

---

---

---

---

---

---

---



# HEALTH/LIFE SAFETY ANNUAL INSPECTION CHECKLIST (FIRE SERVICE)

School Name: \_\_\_\_\_ Address: \_\_\_\_\_ School Dist. # \_\_\_\_\_

City: \_\_\_\_\_ County: \_\_\_\_\_ Phone: \_\_\_\_\_

Inspector's Name: \_\_\_\_\_ Inspector's Department: \_\_\_\_\_

Inspector's Contact Information: Phone: \_\_\_\_\_ Email: \_\_\_\_\_

Date of Inspection: \_\_\_\_\_ Was ROE/ISC Representative Present at Inspection? Yes ☐ No ☐

#	SUBJECT	MET	NOT	N/A
<b>1</b>	<b>EMERGENCY LIGHTING</b>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
General (6) Auditoriums (41) Cafeterias (84) Corridors (111) Gym/Multipurpose (142) Library/Media Center (193) Large Stages (244) Small Stages (257) Stairwells (274) Swimming Pools (293)				
<b>2</b>	<b>EXIT SIGNS</b>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
General (7) Auditoriums (40) Cafeteria (83) Corridors (110) Gyms & Multipurpose Rooms (141) Library/Media Center (192) Showers & Locker Rooms (236) Stages (Large) (243) Stages (Small) (256) Stairwells (273) Swimming Pools (292)				
<b>3</b>	<b>FIRE ALARM and CO MONITORING</b>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
General (9+10) Carbon Monoxide Detection (26) Greenhouses (133)				
<b>4</b>	<b>FIRE ALARM INITIATING DEVICES</b>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
<u>Fire Detectors</u> Arts & Crafts Rooms (29) Auditoriums (43) Auto Shops (52) Boiler Rooms (72) Cafeterias (86) Greenhouses (134) Home Economics & Family Services Rooms (152) Industrial Tech Labs (162) Kitchens (177) Library/Media Center (195) Mechanical & Furnace Rooms (199) Photo Developing Lab (209) Science Labs (226) Stages (Small) (259) Stage with Storage Underneath (267) Stairwells (277) Storage/Supply Closets (284) Swimming Pools (299) Teacher's Workrooms & Lounges (302) Woodworking Shop (316) <u>Manual Fire Alarm Stations</u> General (11)				
<b>5</b>	<b>FIRE RATED CONSTRUCTION</b>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Arts & Crafts Rooms (28) Auditoriums (42) Auto Shops (51) Boiler Rooms (70) Cafeterias (85) Classrooms (94+95) Corridors (112) Protection of Openings near Fire Escapes (130) Greenhouses (132) Gyms & Multipurpose Rooms (143) Home Economics & Family Services Rooms (151) Industrial Tech Labs (161) Kitchens (176) Library/Media Centers (194) Mechanical & Furnace Rooms (198) Photo Developing Lab (208) Science Labs (225) Stages (Large) (245) Proscenium Wall (246) Stages with Storage Under (265) Stair Enclosure (275) Storage/Supply Closets (283) Classroom Storage/Janitor Rooms (285) Swimming Pools (294) Teacher's Workrooms & Lounges (301) Woodworking Shop (315)				
<b>6</b>	<b>ELECTRICAL WIRING and EQUIPMENT</b>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Arts & Crafts Rooms (32) Automotive Shops (55)				

<b>7</b>	<b>DOORS</b>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Hold Open Devices (4) Boiler Room Door Swing (69) Classroom Door Unlocked (93) Classroom Door Swing (96) Timeout Doors Unlocked (306)				
<b>8</b>	<b>POSTED OCCUPANT LOADS</b>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Auditoriums (37) Cafeterias (80) Gyms & Multipurpose Rooms (138) Library/Media Center (189) Swimming Pools (289)				
<b>9</b>	<b>EGRESS COMPONENTS</b>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Width of Corridors (113) Existing Fire Escapes (128) Access to Fire Escapes (129)				
<b>10</b>	<b>MEANS OF EGRESS ARRANGEMENT</b>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Auditoriums (39) Cafeteria (82) Corridor Dead Ends (109) Gyms & Multipurpose Rooms (140) Library/Media Centers (191) Swimming Pools (291)				
<b>11</b>	<b>FIRE EXTINGUISHERS</b>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
General (16) Kitchens (178) Woodworking Shop (318)				
<b>12</b>	<b>NUMBER OF EXITS</b>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Auditoriums (38) Cafeteria (81) Corridors (108) Gyms & Multipurpose Rooms (139) Library/Media Rooms (190) Shower and Locker Rooms (235) Swimming Pools (290)				
<b>13</b>	<b>INTERIOR FINISH/DECORATIONS</b>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Decorative Vegetation (20) Furnishing & Decorations (22) Interior Wall, Ceiling & Floor Finishes (23) Classroom Artwork (97) Corridor Artwork (115) Sound Proofing (202) Curtains & Scenery Large Stages (247) Curtains & Scenery Small Stages (258)				
<b>14</b>	<b>HOUSEKEEPING/MAINTENANCE</b>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Unobstructed Exits (5) Clearance above Storage (14) Extension Cords & Multi-Plugs (24) Storage Under Bleachers (64) Housekeeping in Boiler Rooms (71) Storage in Corridors (114) Conveyances do not Obstruct Egress (121) Exterior Stairways (123) Fire Lane Clearances/Marking/Signage (124) FD Connection Clear (125) Fire Hydrants Clear/Maintained (126) Mechanical & Furnace Rooms (200) Stairwells (272) No Storage in Stairwells (276) Woodworking Shop (320)				
<b>15</b>	<b>SYSTEM INSPECTION, TESTING, and MAINTENANCE.</b>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Testing Emergency Lighting (7) Fire Alarm (12) Sprinkler System (13) Standpipe System (15) Elevator Certificate (122) FD Connection (125) Testing of Fire Escapes (131) Kitchen Exhaust Inspection & Cleaning (180) Kitchen Filter Maintenance (181) Cooking Extinguishing Systems (182)				





# APPENDIX L-Interior Wall, Ceiling and Floor Finish

## **PART 185**

### **185.390(j) Interior Finish** *(Part 185 does not address floor finishes)*

The term "interior finish" is used in this Part solely to identify those exposed surfaces of a building which are subject to flame spread limitations. The interior finish of a building, or portion thereof, shall include all surfaces (exposed to view in occupied rooms or spaces) of walls and partitions including trim and doors located therein; of ceilings and the underside of floor and roof assemblies (when no ceilings are provided); of bulletin or display boards rigidly attached to a wall or partition; of those lockers and cabinets which are built-in, rigidly affixed to, or closely backed up to walls and partitions which thereby, hide or cover surfaces which otherwise would be considered as part of the interior finish.

### **185.390(j)(3) Basic Rules**

- The use or existence of interior finish materials with flame spread ratings in excess of 200, when tested in accordance with the applicable requirements of ASTM E-84, is prohibited in any occupied room or space.
- Notwithstanding the flame spread rating, interior finish trim materials and other surface treatments exposed to occupied areas which produce a quantity of smoke or toxic fumes sufficient to affect life safety, shall not be permitted in any occupied room or space.
- Plastics used as a construction material or as an interior finish material shall be subject to the same flame spread tests and ratings as other materials.
- In unsprinklered rooms or spaces, 10% of the total wall area (including doors, door and window casings, and other trim) and 5% of the total ceiling area of a room or space shall be permitted to have a flame spread rating of not more than 200 even though a lower flame spread rating is required for such room or space. In sprinklered rooms or spaces, the figures established in the preceding sentence may be increased to 20% and 10%, respectively.
- In general terms, interior finish materials in the form of acoustic tiles or wall or ceiling boards, as well as plaster, can be grouped into two categories, as follows:
  - i. Those having a surface flamespread rating of 25 or less, thereby qualifying them as NONCOMBUSTIBLE interior finish materials. Included in this category are plaster, acoustic plaster on noncombustible surfaces, gypsum and plaster boards, mineral boards, glass fiber tile, metal ceilings, etc. Some wood and cellulose fiber tiles also are included, but these tiles must be positively identified by the label of an approved testing laboratory as having a flamespread rating of 25 or less.
  - ii. Those having a surface flamespread rating of more than 25, classifying them as COMBUSTIBLE. Included in this category are most cellulose fiber boards, wood fiber boards, plywood, pressed fiberboards, wood particle boards, cloths, plastic panels, acoustic plaster on combustible surfaces, etc.

**185.390(j)(4)** The flamespread rating for the interior finish of other occupied rooms and spaces shall not exceed the limitations established in Appendix A, Table K. Area limiting figures shall apply to that area within rooms, in contrast to the area of spaces (see definitions therefore under Section 185.220 (c)).

*\*\* (Table is not producible by OSFM as it is not available on the Health/Life Safety webpage and OSFM does not own a copy of Table K) \*\**

**185.320(e) Plan A Buildings without Basements**

- An interior finish flame spread rating of not more than 200 shall be permitted for corridors and primary egress aisles located in Plan A buildings without basements, provided every room or space having a capacity of more than 10 persons, if unsprinklered, and 20 persons, if sprinklered, is provided with an exterior exit, a separated secondary path of exit travel or a secondary means of escape.
- Educational Occupancy rooms located on the street floor in those Plan A buildings having an enclosed interior arrangement shall be permitted to have an interior finish flame spread rating of not more than 200, provided every such room having a capacity of more than 50 persons is provided with an exterior exit or a secondary means of escape.

**185.360(f) Assembly Areas**

- The flame spread rating of the interior finish of Assembly Occupancy shall comply with the applicable provisions of Section 185.390(j) but in no case shall such rating exceed the following:
  - a. 75 for the ceilings and walls of all unsprinklered Assembly Occupancies.
  - b. 75 for the ceilings and 200 for the walls of all sprinklered Assembly Occupancies except that a ceiling flame spread rating of not more than 200 shall be permitted for sprinklered Class C Assembly Occupancies.

**185.380(c)(6) Corridor Plenum Chambers.**

- Where a corridor is used as a plenum chamber, the flame spread rating of the interior finish of a corridor shall not exceed 25 in an unsprinklered building or 75 in a sprinklered building.

**185.380(c)(9) Dead-End Corridors**

- No dead-end corridor more than 20 feet in length shall have an interior finish flame spread rating of more than 25 if unsprinklered or 75 if sprinklered.

**185.390(j)(3) Existing Buildings**

- Interior finish surfaces having a flame spread rating in excess of that permitted under this Part shall be replaced or shall be coated with an approved fire retardant paint or coating applied in such quantity as to reduce the flame spread rating of the existing surface to within the limits permitted under this Part. No fire retardant paint or coating shall be considered as approved unless such is listed or approved by any accepted testing laboratory. Such paint or coating shall be applied in strict conformance with the manufacturer's instructions.

- The applicator shall be required to submit to the School Board a signed certificate stating that the approved fire retardant paint or coating has been applied in accordance with the requirements of this Part and specifically identifying the surfaces to which such has been applied. Such certificate shall be maintained on file by the School Board.

## **Part 175**

### **Section 175.420 Interior Finish**

*Part 175 does not address floor finishes*

Interior finish materials for walls and ceilings, unless otherwise limited herein, shall have a flamespread rating no greater than that indicated as follows:

Exitways and stairs, corridors, lobbies, etc., open thereto	25
Corridors not part of exitways	75
Classrooms, laboratories, shops, etc., not over 1,000 ft <sup>2</sup>	200*
Heating, ventilating, boiler, furnace, incinerator, and trash rooms	25
Auditoriums, cafeterias, and other assembly spaces for over 200 persons	75*
All other	75*

All flamespread ratings shall be based on the standard tunnel test (NFPA 255, ASTM E-84). Materials that give off smoke or gases more dense or more toxic than that given off by untreated wood or untreated paper under comparable exposure to heat or flame shall not be permitted as interior finish.

Exceptions to the above requirements not to exceed 10% of the aggregate wall and ceiling areas of any room or space may have a flamespread rating not exceeding 200.

\*Exposed, heavy timber-roof construction permitted

## **BOCA-1996/1993**

**BOCA-F: 305.1:** The interior finish and trim of structures shall be maintained as approved.

**BOCA-F: 305.2:** A finished floor covering shall be exempt from the requirements of this section, provided that where the code official finds a floor surface to be of unusual hazard, the floor surface shall be considered part of the interior finish for the purposes of this code.

**BOCA-B: Table 803.4:** (where an automatic sprinkler system installed in accordance with Section 906.2.1 or 906.2.2 is installed throughout a building, Class II or III interior finish shall be permitted where Class I or II materials, respectively, are required.)

	<u>Class</u>
➤ Required vertical exits and passageways	I
➤ Exit access corridors	II
➤ Rooms or enclosed spaces	III

### **ICC 2015/2009/2006/2003**

**IBC 803.5:** Interior wall and ceiling finish shall have a flame spread index not greater than that specified in Table 803.5 for the group and location designated. Interior wall and ceiling finish materials, other than textiles, tested in accordance with NFPA 286 and meeting the acceptance criteria of Section 806.2.1.1, shall be permitted to be used where a Class A classification in accordance with ASTM E-84 is required.

#### **IBC: Table 803.5:**

	<u>Class</u>
Sprinklered vertical exits and exit passageways (< 3 stories in height = Class C in sprinklered buildings)	B
Sprinklered exit access corridors and other exitways	C
Sprinklered rooms and enclosed spaces	C
Unsprinklered vertical exits and exit passageways (< 3 stories in height = Class B in sprinklered buildings)	A
Unsprinklered exit access corridors and other exitways	B
Unsprinklered rooms and enclosed spaces	C
Floor finish in unsprinklered exit enclosures and corridors	II
Floor finish in sprinklered exit enclosures and corridors	DOC FF-1 "pill test"***
Sprinklered/Unsprinklered floor finish in all other areas	DOC FF-1 "pill test"***

\*Exposed, heavy timber-roof construction permitted


\*\* CPSC 16CFR, Part 1630 – *Standard for the Surface Flammability of Carpets and Rugs.*

## APPENDIX M-Clearance from Sprinkler Heads

Clearance from a sprinkler head is not always horizontal plane below sprinkler deflector. NFPA 13 provides diagrams that clarify this requirement.

### NFPA 13 (2010)

**8.5.5.1\* Performance Objective.** Sprinklers shall be located so as to minimize obstructions to discharge as defined in 8.5.5.2 and 8.5.5.3, or additional sprinklers shall be provided to ensure adequate coverage of the hazard.

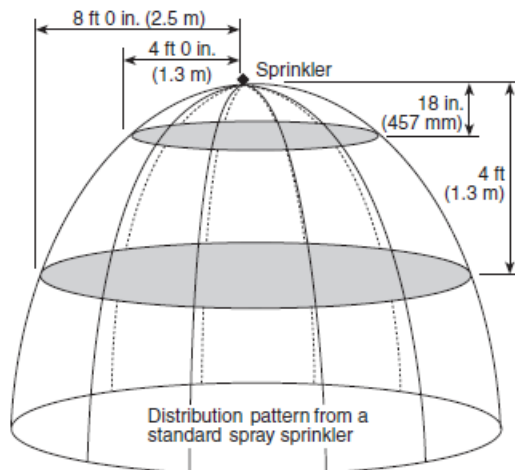

**FIGURE A.8.5.5.1** Obstructions to Sprinkler Discharge Pattern Development for Standard Upright or Pendent Spray Sprinklers.

## APPENDIX N-Door Locking Hardware

The issue of code-compliant locking of door within a school room (and this applies to all doors to rooms that are normally occupied, not just classrooms) is still an active conversation throughout public schools in Illinois. ISBE, Office of the State Fire Marshal (OSFM), and IARSS are diligently working together to keep the state's Regional Offices of Education up to date on this security locking issue. Acts of violence in schools have caused questions as to code-compliant locking systems in schools. Unfortunately there is still pressure from non-school, non-fire service vendors that these security locking systems should be used in public schools. The majority of the security locking systems seen by ISBE, OSFM, and IARSS do not comply with the School Code. To make matters worse, schools are purchasing these systems without confirming first that they are allowed to be used.

School Codes/Building Codes require that:


1. Locks requiring special knowledge or tools to unlock are not permitted. This includes the use of keys, combinations, or any special device that has to be removed or activated to allow the door to be open.
2. Bolt locks of any kind are not permitted.
3. Unlatching of doors shall not require more than one motion. Hardware exists that permits two locking features, but one motion to unlock and unlatch that hardware. Think of door hardware on a hotel room. When a person closes the door after entering their guestroom the door automatically locks from the corridor side of the door. There usually exists an option lock a "thumb-turn" dead bolt located just above the door handle. In the morning when that person leaves he/she grabs the door handle turns and in one motion the "thumb-turn" dead bolt is released and the door latch is also released and the door is pulled open. With most of the devices that ISBE, OSFM, and IARSS are seeing it takes two motions: First motion being the removal of the special security locking device and second motion being the turning of the door handle or knob to unlatch and open the door.

"While these devices are perceived to provide additional security, they have the significant potential to facilitate unintended consequences when incidents of bullying, harassment, or physical violence take place. These devices prevent access by school staff and first responders and they delay egress in the case of emergencies such as a fire, which is statistically much more likely to happen. There are existing solutions that are code compliant and therefore allow first responders access to a classroom in case of an emergency. Classroom doors must be able to be closed for safety and security, as well as opened when needed. Some of these devices will lock the intruder or more frequently a bully in the room with their victims."<sup>1</sup>

Below are examples of security locking devices that ISBE, OSFM, and ROEs/ISCs have seen and are not compliance with the School Codes/building codes.

---

<sup>1</sup> National Association of State Fire Marshals (NASFM) Supports New Video Stressing Importance of Securing Classrooms without Compromising Life Safety—*School safety concerns have led to the installation of non-code compliant and possibly dangerous classroom door barricade devices.*  
<http://www.firemarshals.org/>

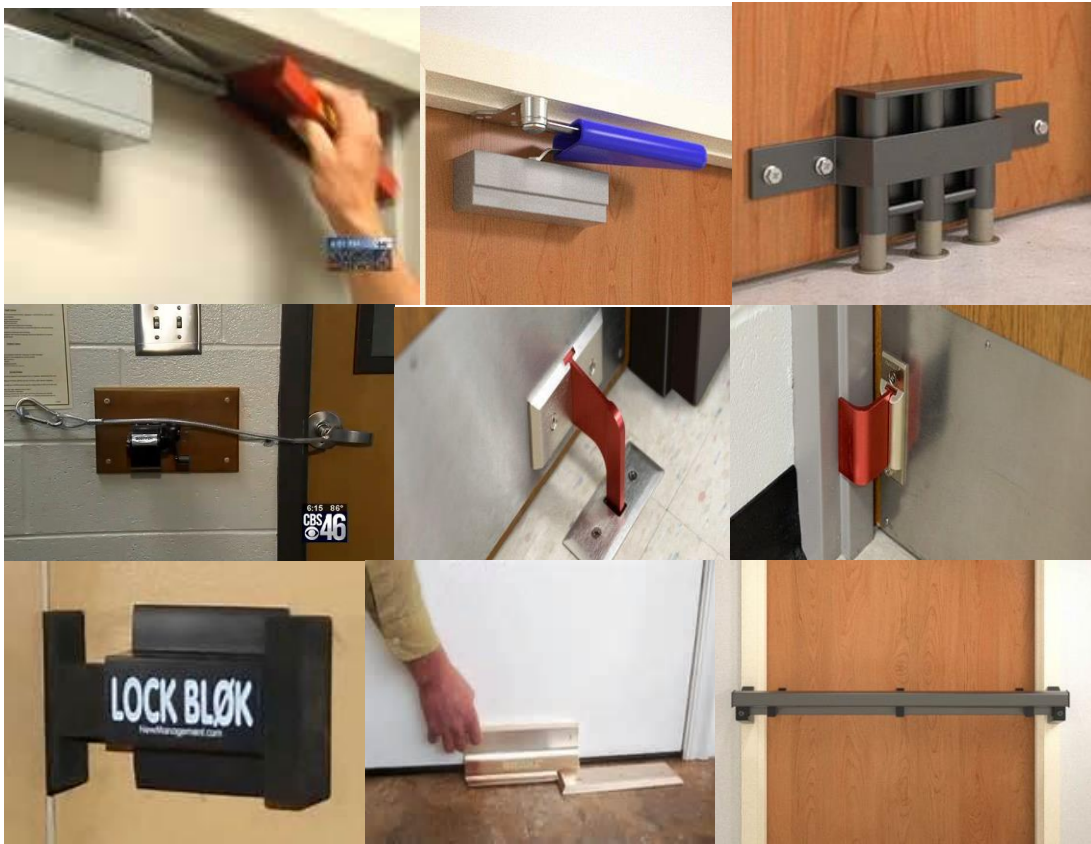

Prior to purchasing and installing security locking devices, **please** confirm with ROEs/ISCs or the OSFM (see contact information below) that the system complies with the School Code.

### Contact Information for Security Locking Systems

Local Regional Office of Education

[www.iarss.org/directory](http://www.iarss.org/directory)

#### **Cathy Stashak, Section Chief**

Office of the Illinois State Fire Marshal

Technical Services Division

[Catherine.Stashak@illinois.gov](mailto:Catherine.Stashak@illinois.gov) (emails are the best form of contact)

312-814-2425

#### **Dale Simpson, Regional Manager**

Office of the Illinois State Fire Marshal

Fire Prevention Division

[Dale.Simpson@illinois.gov](mailto:Dale.Simpson@illinois.gov) (emails are the best form of contact)

217-558-0639



## APPENDIX O-Part 175 Fire Rated Separations

### Efficient and Adequate Standards for Building Specifications for the Construction of Schools–Fire Separation Requirements (23 Ill. Adm. Code 175)

#### *Outline for use with Part 175-Fire Separation Requirements Public School Buildings designed on or after July 1, 1965 but before March 24, 1995*

Part 175: On or after July 1, 1965 but before March 24, 1995				
Room or Area	Section	Fire Rating	With Sprinklers	Comments
Agricultural Shops	175.260d	1-hour	$\frac{3}{4}$ -hour No detection [175.460a]	Detection required [175.460a]
Agricultural Shop Opening Protectives	175.285a2B	1-hour	$\frac{3}{4}$ -hour or $1\frac{3}{4}$ " SC wood doors with max 1,296 in <sup>2</sup> wired glass permitted [175.285a2C]	<b>(d)</b>
Art Rooms	175.260c	$\frac{3}{4}$ -hour	No detection [175.460a]	Detection required [175.460a]
Art Room Opening Protectives	175.285a2C	$\frac{3}{4}$ -hour		$1\frac{3}{4}$ " SC wood doors with max 1,296 in <sup>2</sup> wired glass permitted <b>(d)</b>
Assembly – Class A	(From Part 185. No definitions Part 175)	Definitions		> 1,000 persons
Assembly – Class B				> 600 but ≤ 1,000 persons
Assembly – Class C				> 200, but ≤ 600 persons
Assembly – BOCA-F	303.1	Definition		> 50 persons

<b>Part 175: On or after July 1, 1965 but before March 24, 1995</b>				
<b>Room or Area</b>	<b>Section</b>	<b>Fire Rating</b>	<b>With Sprinklers</b>	<b>Comments</b>
<b>Assembly &gt; 600</b>	<b>175.260a</b>	1-hour		
<b>Assembly &gt; 600 Opening Protectives</b>	<b>175.285a2B</b>	1-hour		<b>(d)</b>
<b>Attics used for combustible storage</b>	<b>175.330 175.260d</b>	1-hour	$\frac{3}{4}$ -hour No detection [175.460a]	Sprinklers or detection required [175.460a5]
<b>Attics used for combustible storage Opening Protectives</b>	<b>175.285a2B</b>	$\frac{3}{4}$ -hour	$\frac{3}{4}$ -hour or $1\frac{3}{4}$ " SC wood doors with max 1,296 in <sup>2</sup> wired glass permitted [175.285a2C]	<b>(d)</b>
<b>Auditoriums &gt; 600</b>	<b>175.260a</b>	1-hour		
<b>Auditoriums &gt; 600 Opening Protectives</b>	<b>175.285a2B</b>	1-hour		<b>(d)</b>
<b>Automotive Shops</b>	<b>175.260d</b>	1-hour	$\frac{3}{4}$ -hour No detection [175.460a]	Detection required [175.460a]
<b>Automotive Shop Opening Protectives</b>	<b>175.285a2B</b>	1-hour	$\frac{3}{4}$ -hour or $1\frac{3}{4}$ " SC wood doors with max 1,296 in <sup>2</sup> wired glass permitted [175.285a2C]	<b>(d)</b>
<b>Boiler Rooms (over 15 psi steam)</b>	<b>175.260e</b>	2-hours	No detection [175.460a]	Detection required [175.460a6]
<b>Boiler Room Opening Protectives (15 psi and basement)</b>	<b>175.285a2A</b>	3-hours		Door must swing into the room if an interior door [175.285b] <b>(d)</b>

<b>Part 175: On or after July 1, 1965 but before March 24, 1995</b>				
<b>Room or Area</b>	<b>Section</b>	<b>Fire Rating</b>	<b>With Sprinklers</b>	<b>Comments</b>
<b>Boiler Room (basement)</b>	<b>175.260e</b>	2-hours	No detection [175.460a]	Detection required [175.460a6]
<b>Boiler Room (basement) Opening Protectives</b>	<b>175.285a2A</b>	3-hours		Door must swing into the room if an interior door [175.285b] <b>(d)</b>
<b>Boiler Rooms (other)</b>	<b>175.260f</b>	1-hour	No detection [175.460a]	Detection required [175.460a6]
<b>Boiler Room (other) Opening Protectives</b>	<b>175.285a2B</b>	1-hour		Door must swing into the room if an interior door [175.285b] <b>(d)</b>
<b>Cafeteria &gt; 600</b>	<b>175.260a</b>	1-hour		
<b>Cafeteria &gt; 600 Opening Protectives</b>	<b>175.285a2B</b>	1-hour		<b>(d)</b>
<b>Closets</b>	<b>175.260d</b>	1-hour	<sup>3</sup> / <sub>4</sub> -hour No detection [175.460a]	Detection required if > 10 ft <sup>2</sup> [175.460a4]
<b>Closet Doors</b>	<b>175.285a2B</b>	1-hour	<sup>3</sup> / <sub>4</sub> -hour or 1 <sup>3</sup> / <sub>4</sub> " SC wood doors with max 1,296 in <sup>2</sup> wired glass permitted [175.285a2C]	If normally kept locked, no closer required [175.290b] <b>(d)</b>
<b>Corridors</b>	<b>175.275a</b>	½-hour		Transoms are not permitted ¼" wired glass with no size limitation [175.275c]

<b>Part 175: On or after July 1, 1965 but before March 24, 1995</b>				
<b>Room or Area</b>	<b>Section</b>	<b>Fire Rating</b>	<b>With Sprinklers</b>	<b>Comments</b>
<b>Corridors Opening Protectives</b>	<b>175.285a5</b>	See comments		No louvers or if present they must be kept closed. Hollow or filled metal doors and 1¾" SC doors are permitted. Door frames of metal or of minimum 2" nominal lumber are permitted. <b>(a)(d)</b>
<b>Corridors in buildings with direct exterior exiting</b>	<b>175.275a1</b>	NR		
<b>Corridor in a 1-story building</b>	<b>175.275a2</b>	NR		Flame spread on walls and ceiling ≤ 75 and each classroom has a window readily available for exiting to the outside
<b>Corridor Clear Width</b>	<b>175.410l</b>	See comments		[175.410m] deals with hanging of clothing in corridor
<b>Crawl Spaces used for combustible storage</b>	<b>175.330</b> <b>175.260d</b>	1-hour	¾-hour No detection	Sprinklers or detection required
<b>Crawl Spaces used for combustible storage Opening Protectives</b>	<b>175.285a2B</b>	1-hour	¾-hour or 1¾" SC wood doors with max 1,296 in² wired glass permitted [175.285a2C]	<b>(d)</b>
<b>Electrical Equipment Rooms</b>	<b>175.260d</b>	1-hour	¾-hour	Detection required if room is > 10 ft² [175.460a4]
<b>Electrical Equipment Opening Protectives</b>	<b>175.285a2B</b>	1-hour	¾-hour or 1¾" SC wood doors with max 1,296 in² wired glass permitted [175.285a2C]	<b>(d)</b>
<b>Exitways (2-hours) Opening</b>	<b>175.285a3A</b>	1½-hour		<b>(b)(d)</b>

<b>Part 175: On or after July 1, 1965 but before March 24, 1995</b>				
<b>Room or Area</b>	<b>Section</b>	<b>Fire Rating</b>	<b>With Sprinklers</b>	<b>Comments</b>
<b>Protectives</b>				
<b>Exitways (1-hour) Opening Protectives</b>	<b>175.285a3B</b>	1-hour		<b>(b)(d)</b>
<b>Exitways (3/4-hours) Opening Protectives</b>	<b>175.285a3C</b>	¾-hour		¾-hour or 1¾" SC wood doors with max 1,296 in² wired glass permitted [175.285a2C] <b>(b)(d)</b>
<b>Fire Walls</b>	<b>175.255</b>	2-hours		2 ft parapets required
<b>Fire Wall Opening Protectives</b>	<b>175.285a1</b>	3-hours		<b>(d)</b>
<b>Flammable Paint and Flammable Liquid Storage Rooms</b>	<b>175.440b</b>	1-hour [175.260f]	¾-hour or 1¾" SC wood doors with max 1,296 in² wired glass permitted [175.285a2C]	Sprinkler protection required unless storage is in UL listed or FM approved flammable liquid storage cabinets
<b>Flammable Paint and Flammable Liquid Storage Rooms Opening Protectives</b>	<b>175.285a2B</b>	1-hour	¾-hour or 1¾" SC wood doors with max 1,296 in² wired glass permitted [175.285a2C]	<b>(d)</b>
<b>Fuel Storage</b>	<b>175.260f</b>	1-hour	¾-hour No detection [175.460a]	Detection required [175.460a6]
<b>Fuel Storage Opening Protectives</b>	<b>175.285a2B</b>	1-hour	¾-hour or 1¾" SC wood doors with max 1,296 in² wired glass permitted [175.285a2C]	<b>(d)</b>
<b>Furnace Room</b> [See 175.260f1 and 175.260f2 for	<b>175.260f</b>	1-hour	¾-hour No detection	Detection required [175.460a6]

Part 175: On or after July 1, 1965 but before March 24, 1995				
Room or Area	Section	Fire Rating	With Sprinklers	Comments
exceptions]			[175.460a]	
<b>Furnace Room Opening Protective</b>	<b>175.285a2B</b>	1-hour	¾-hour or 1¾" SC wood doors with max 1,296 in² wired glass permitted [175.285a2C]	<b>(d)</b>
<b>Greenhouses</b>	<b>175.260c</b>	¾-hour	No detection [175.460a]	Detection required [175.460a1]
<b>Greenhouse Opening Protectives</b>	<b>175.285a2C</b>	¾-hour		1¾" SC wood doors with max 1,296 in² wired glass permitted [175.285a2C] <b>(d)</b>
<b>Gym/Multipurpose Room &gt; 600</b>	<b>175.260a</b>	1-hour		
<b>Gym/Multipurpose Room &gt; 600 Opening Protectives</b>	<b>175.285a2B</b>	1-hour		<b>(d)</b>
<b>Home Economics</b>	<b>175.260c</b>	¾-hour	No detection [175.460a]	Detection required [175.460a]
<b>Home Economics Room Opening Protectives</b>	<b>175.285a2C</b>	¾-hour		1¾" SC wood doors with max 1,296 in² wired glass permitted [175.285a2C] <b>(d)</b>
<b>Horizontal Exits</b>	<b>175.410h 101-5-5</b>	2-hours		<b>(c)</b>
<b>Horizontal Exit Doors</b>	<b>101-5-5</b>	1½-hours		<b>(c)(d)</b>
<b>Incinerator Rooms</b>	<b>175.260f</b>	1-hour	¾-hour No detection [175.460a]	Sprinklers required [175.440a]

<b>Part 175: On or after July 1, 1965 but before March 24, 1995</b>				
<b>Room or Area</b>	<b>Section</b>	<b>Fire Rating</b>	<b>With Sprinklers</b>	<b>Comments</b>
<b>Incinerator Room Opening Protectives</b>	<b>175.285a2B</b>	1-hour	$\frac{3}{4}$ -hour or $1\frac{3}{4}$ " SC wood doors with max 1,296 in <sup>2</sup> wired glass permitted [175.285a2C]	<b>(d)</b>
<b>Industrial Technology and Metal Working Shops</b>	<b>175.260d</b>	1-hour	$\frac{3}{4}$ -hour No detection [175.460a]	Detection required [175.460a1]
<b>Industrial Technology and Metal Working Shops Opening Protectives</b>	<b>175.285a2B</b>	1-hour	$\frac{3}{4}$ -hour or $1\frac{3}{4}$ " SC wood doors with max 1,296 in <sup>2</sup> wired glass permitted [175.285a2C]	<b>(d)</b>
<b>Janitor's Closets</b>	<b>175.260d</b>	1-hour	$\frac{3}{4}$ -hour No detection [175.460a]	Detection required if > 10 ft <sup>2</sup> [175.460a4]
<b>Janitor's Closet Doors</b>	<b>175.285.a2B</b>	1-hour	$\frac{3}{4}$ -hour or $1\frac{3}{4}$ " SC wood doors with max 1,296 in <sup>2</sup> wired glass permitted [175.285a2C]	If normally kept locked, no closer required [175.290b] <b>(d)</b>
<b>Kitchens (not home economics kitchens)</b>	<b>175.260c</b>	$\frac{3}{4}$ -hour	No detection [175.460(a)]	Detection required [175.460a1]
<b>Kitchen Opening Protectives</b>	<b>175.285a2C</b>	$\frac{3}{4}$ -hour		$\frac{3}{4}$ -hour or $1\frac{3}{4}$ " SC wood doors with max 1,296 in <sup>2</sup> wired glass permitted [175.285a2C] <b>(d)</b>
<b>Libraries/Learning Resource Centers &gt; 600</b>	<b>175.260a</b>	1-hour		

Part 175: On or after July 1, 1965 but before March 24, 1995				
Room or Area	Section	Fire Rating	With Sprinklers	Comments
Libraries/Learning and Resource Centers > 600 Opening Protectives	175.285a2B	1-hour		<b>(d)</b>
Open Plan Areas (Limiting Walls)	175.250a	1-hour	No detection [175.460a]	Detection required in any enclosed room > 10 ft <sup>2</sup> [175.460a7]. All ceilings shall be N/C and have a flame spread ≤ 25 or be of construction using exposed heavy timber with limits established elsewhere
Open Plan Area Opening Protectives	175.285a4	¾-hour		¾-hour or 1¾" SC wood doors with max 1,296 in <sup>2</sup> wired glass permitted [175.285a2C] <b>(d)</b>
Painting and Finishing	175.260d	1-hour	No detection [175.460a]	Detection required [175.460a2]
Painting and Finishing Opening Protectives	175.285a2B	1-hour	¾-hour or 1¾" SC wood doors with max 1,296 in <sup>2</sup> wired glass permitted [175.285a2C]	<b>(d)</b>
Photo Developing Rooms	175.260c	¾-hour	No detection [175.460a]	Detection required [175.460a1]
Photo Developing Room Opening Protectives	175.285a2C	¾-hour		¾" SC wood doors with max 1,296 in <sup>2</sup> wired glass permitted <b>(d)</b>
Printing Rooms	175.260d	1-hour	No detection [175.460a]	Detection required [175.460a2]



<b>Part 175: On or after July 1, 1965 but before March 24, 1995</b>				
<b>Room or Area</b>	<b>Section</b>	<b>Fire Rating</b>	<b>With Sprinklers</b>	<b>Comments</b>
<b>Printing Rooms Opening Protectives</b>	<b>175.285a2B</b>	1-hour	$\frac{3}{4}$ -hour or $1\frac{3}{4}$ " SC wood doors with max 1,296 in <sup>2</sup> wired glass permitted [175.285a2C]	<b>(d)</b>
<b>Projection Rooms used in Assembly Rooms &gt; 600</b>	<b>175.320</b>	N/C constr Interior finish flame spread $\leq 25$		Does not apply to lighting and sound booths <b>(e)</b>
<b>Projection Rooms &gt; 600 Opening Protectives</b>	<b>175.320</b>	Metal doors or shutters		Other openings shall have fusible link released shutters <b>(d)(e)</b>
<b>Science Labs</b>	<b>175.260c</b>	$\frac{3}{4}$ -hour	No detection 175.460a	Detection required [175.460a1]
<b>Science Lab Opening Protectives</b>	<b>175.285a2C</b>	$\frac{3}{4}$ -hour		$1\frac{3}{4}$ " SC wood doors with max 1,296 in <sup>2</sup> wired glass permitted <b>(d)</b>
<b>Smoke Stop Partitions</b> (Cross-Corridor)	<b>175.280</b>	$\frac{1}{2}$ -hour		
<b>Smoke Stop Partition Opening Protectives</b> (Cross-Corridor Doors)	<b>175.280</b>	See comments		Hollow or filled metal doors and $1\frac{3}{4}$ " SC doors are permitted. Door frames of metal or of minimum 2" nominal lumber are permitted.
<b>Stages (Large) and Accessory Areas</b> -Includes storage and below stage	<b>175.260b</b>	1-hour	1 hour separation below stage not required	Sprinklers required
<b>Stages (Large) and Accessory Areas Opening Protectives</b>	<b>175.285a2B</b>	1-hour		<b>(d)(f)</b>

<b>Part 175: On or after July 1, 1965 but before March 24, 1995</b>				
<b>Room or Area</b>	<b>Section</b>	<b>Fire Rating</b>	<b>With Sprinklers</b>	<b>Comments</b>
<b>Stages (Small) and Accessory Areas</b>	<b>175.260b</b>	NR	No detection	Detection required if room falls under another classification within this Appendix, see those requirements [175.460a3]
<b>Stages (Small) and Accessory Areas Opening Protectives</b>	<b>175.260b</b>	NR		If room falls under another classification within this Appendix, see those requirements
<b>Stages (Large and Small) with Storage Underneath</b>	<b>185.360d1C as referenced by 175.310f3</b>	½-hour	N/C construction	If stage is required to be protected with sprinklers, then the areas underneath the stage are required to be protected. If no sprinklers then detection is required. For spaces beneath a stage that is used for both storage and as a plenum chamber with grilled openings into the general assembly area see [185.360d2]
<b>Stages (Large and Small) with Storage Underneath Opening Protectives</b>	<b>185.360d1B as referenced by 175.310f3</b>	½-hour		Metal or SC wood doors <b>(d)</b>
<b>Stairs ≤ 2 stories</b>	<b>175.265</b>	¾-hour wall permitted between stairs and corridors		All other partitions in the stair enclosure must be 1-hour
<b>Stairs ≤ 2 stories Opening Protectives</b>	<b>175.285a3C</b>	¾-hour wall permitted between stairs and corridors		All other openings must be 1-hour ¾-hour wall can have ¾-hour door or 1¾" SC wood door <b>(d)</b>

<b>Part 175: On or after July 1, 1965 but before March 24, 1995</b>				
<b>Room or Area</b>	<b>Section</b>	<b>Fire Rating</b>	<b>With Sprinklers</b>	<b>Comments</b>
<b>Stairs ≤ 2 stories in buildings with direct exterior exiting</b>	<b>175.270(a)</b>	NR		
<b>Stairs ≤ 4 stories</b>	<b>175.265</b>	1-hour		
<b>Stairs ≤ 4 stories Opening Protectives</b>	<b>175.285a3B</b>	1-hour		<b>(d)</b>
<b>Stairs &gt; 4 stories</b>	<b>175.265</b>	2-hours		
<b>Stairs &gt; 4 stories Opening Protectives</b>	<b>175.285a3A</b>	1½-hours		<b>(d)</b>
<b>Stairs (Basement)</b>	<b>175.270b</b>	NR		In the basement of a 1-story building, provided required exits from the first floor do not pass through these basement stairs.
<b>Storage Rooms</b>	<b>175.260d</b>	1-hour	¾-hour No detection [175.460a]	Detection required if > 10 ft² [175.460a4]
<b>Storage Room Opening Protectives</b>	<b>175.285a2B</b>	1-hour	¾-hour or 1¾" SC wood doors with max 1,296 in² wired glass permitted [175.285a2C]	<b>(d)</b>
<b>Swimming Pools &gt; 600</b>	<b>175.260a</b>	1-hour		
<b>Swimming Pool Opening Protectives</b>	<b>175.285a2B</b>	1-hour		<b>(d)</b>
<b>Teacher's Workrooms and Lounges (with cooking/heating appliances)</b>	<b>175.260c 175.260h</b>	¾-hour		
<b>Teachers' Workrooms and Lounge (with cooking/heating appliances) Opening Protective</b>	<b>175.285a2C</b>	¾-hour		¾-hour or 1¾" SC wood doors with max 1,296 in² wired glass permitted [175.285a2C]

<b>Part 175: On or after July 1, 1965 but before March 24, 1995</b>				
<b>Room or Area</b>	<b>Section</b>	<b>Fire Rating</b>	<b>With Sprinklers</b>	<b>Comments</b>
				<b>(d)</b>
<b>Trash Chute ≤ 4 stories</b>	<b>175.265</b>	1-hour		Sprinklers required at top of trash chute [175.440a]
<b>Trash Chute ≤ 4 stories Opening Protectives</b>	<b>175.285a3B</b>	1-hour		<b>(d)</b>
<b>Trash Chute &gt; 4 stories</b>	<b>175.265</b>	2-hours		Sprinklers required at top of trash chute [175.440a]
<b>Trash Chute &gt; 4 stories Opening Protectives</b>	<b>175.285a3A</b>	1½-hours		<b>(d)</b>
<b>Trash Collection Room</b>	<b>175.260f</b>	1-hour	¾-hour	Sprinkler protection required [175.440a]
<b>Trash Collection Room Opening Protectives</b>	<b>175.285a2B</b>	1-hour	¾-hour or 1¾" SC wood doors with max 1,296 in² wired glass permitted [175.285a2C]	<b>(d)</b>
<b>Utility Tunnels used for combustible storage</b>	<b>175.330 175.260d</b>	1-hour	No detection ¾-hour	Sprinklers or detection required
<b>Utility Tunnels used for combustible storage Opening Protectives</b>	<b>175.285a2B</b>	1-hour	¾-hour or 1¾" SC wood doors with max 1,296 in² wired glass permitted [175.285a2C]	<b>(d)</b>
<b>*Ventilation Equipment Rooms</b>	<b>175.260d</b>	1-hour	¾-hour No detection [175.460a]	Detection required [175.460a]

Part 175: On or after July 1, 1965 but before March 24, 1995				
Room or Area	Section	Fire Rating	With Sprinklers	Comments
Ventilation Equipment Room Opening Protectives	175.285a2B	1-hour	$\frac{3}{4}$ -hour or $1\frac{3}{4}$ " SC wood doors with max 1,296 in <sup>2</sup> wired glass permitted [175.285a2C]	(d)
Woodworking Shops	175.260d	1-hour	$\frac{3}{4}$ -hour No detection [175.460a]	Detection required [175.460a]
Woodworking Shop Opening Protectives	175.285a2B	1-hour	$\frac{3}{4}$ -hour or $1\frac{3}{4}$ " SC wood doors with max 1,296 in <sup>2</sup> wired glass permitted [175.285a2C]	(d)

N/C = Noncombustible Construction

SC = Solid Core

(a) = Hollow or filled metal doors and  $1\frac{3}{4}$ " SC wood doors are permitted. Door frames of metal or of minimum 2" nominal lumber.

(b) = Exitway can be thought of as a horizontal extension of a stairway. Therefore in accordance with 175.265 like fire resistance is required for enclosures around exitways. Like with the stairway for which it is attached. An exitway can also be an "exit" located within a building that i.e. used when travel distances are to long.

(c) = See NFPA 101 for more requirements

(d) = Unless otherwise noted, opening protectives are to have automatic closing devices and positive latching. Additionally opening protectives must comply with NFPA 80 (1967). Where applicable, 175.290a permits closing upon activation of the building's fire alarm system. Fusible links or rate-of-rise release may be used in addition to but not in lieu of, automatic operation. Refer to that section for details.

(e) = Does not apply if the entire projection booth complies with NFPA 40 (1967)

(f) = For proscenium curtain requirements see NFPA 101.

## APPENDIX P-Part 185 Fire Separation Requirements

### *Outline for use with Part 185-Fire Separation Requirements Public School Buildings designed before July 1, 1965*

Part 185: Before July 1, 1965				
Room or Area	Section	Fire Rating	With Sprinklers	Comments
<b>Agricultural Shops</b>	<b>185.390g4</b>	½-hour	Detection not required [185.395c2]	1-hour if in unsprinklered basement and lead directly into interior stair or ramp enclosure. ¾-hour if located in an unsprinklered basement or otherwise in any unsprinklered building > 2 stories. See also [185.390g5C] for borrowed lights in walls See also [185.390g5C] for borrowed lights in walls Detection is required [185.395c2B]
<b>Agricultural Shop Opening Protectives</b>	<b>185.380c10F</b>	See comments		Metal, SC wood or structurally stable wood panel construction. Borrowed light or vision panels in doors shall be fixed sash type glazed with wired glass or plate glass ≥ ¼" thick except that DS plain glass or 40 oz glass may be used where the area of a panel is ≤ 200 in <sup>2</sup> and 600 in <sup>2</sup> , respectively. <b>(n)</b>

Part 185: Before July 1, 1965				
Room or Area	Section	Fire Rating	With Sprinklers	Comments
Art Rooms	185.390g4	½-hour	Detection not required [185.395c2]	1-hour if in unsprinklered basement and lead directly into interior stair or ramp enclosure. ¾-hour if located in an unsprinklered basement or otherwise in any unsprinklered building > 2 stories. See also [185.390g5C] for borrowed lights in walls. Detection required [185.395c2B]
Art Room Opening Protectives	185.380c10F	See comments		Metal, SC wood or structurally stable wood panel construction. Borrowed light or vision panels in doors shall be fixed sash type glazed with wired glass or plate glass ≥ ¼" thick except that DS plain glass or 40 oz glass may be used where the area of a panel is ≤ 200 in <sup>2</sup> and 600 in <sup>2</sup> , respectively <b>(n)</b>
Assembly, Class A	185.310e4Ci	Definitions		> 1,000 persons
Assembly, Class B	185.310e4Cii			> 600, but ≤ 1,000 persons
Assembly, Class C	185.310e4Ciii			> 200, but ≤ 600 persons
Assembly BOCA-F	303.1			> 50 persons
Assembly > 200	185.390g4	½-hour	No detection required [185.395c2]	1-hour if in unsprinklered basement and lead directly into interior stair or ramp enclosure. ¾-hour if located in an unsprinklered basement or otherwise in any unsprinklered building > 2 stories. See also [185.390g5C] for borrowed lights in walls. Detection required if flame spread > 75 [185.395c2D]

Part 185: Before July 1, 1965				
Room or Area	Section	Fire Rating	With Sprinklers	Comments
Assembly > 200 Opening Protectives	185.380c10F	See comments		Metal, SC wood or structurally stable wood panel construction. Borrowed light or vision panels in doors shall be fixed sash type glazed with wired glass or plate glass $\geq \frac{1}{4}$ " thick except that DS plain glass or 40 oz glass may be used where the area of a panel is $\leq 200 \text{ in}^2$ and $600 \text{ in}^2$ , respectively. <b>(h)(n)</b>
Attics or Concealed Spaces above the Ceiling	185.390i2	N/C or $\frac{1}{2}$ -hour with flame spread $\leq 25$	Subdivision into compartments not required [185.390i2E] Detection not required [185.395c2]	Detection required in attics located in multistory buildings or spaces > 2,000 ft <sup>2</sup> or attic located in a single story building > 5,000 ft <sup>2</sup> [185.395c2C]
Auditoriums > 200	185.390g4	$\frac{1}{2}$ -hour	Detection not required [185.395c2]	1-hour if in unsprinklered basement and lead directly into interior stair or ramp enclosure. $\frac{3}{4}$ -hour if located in an unsprinklered basement or otherwise in any unsprinklered building > 2 stories. See also [185.390g5C] for borrowed lights in walls. Detection required if flame spread > 75 [185.395c2D]



<b>Part 185: Before July 1, 1965</b>				
<b>Room or Area</b>	<b>Section</b>	<b>Fire Rating</b>	<b>With Sprinklers</b>	<b>Comments</b>
<b>Auditoriums &gt; 200 Opening Protectives</b>	<b>185.380c10F</b>	See comments		Metal, SC wood or structurally stable wood panel construction. Borrowed light or vision panels in doors shall be fixed sash type glazed with wired glass or plate glass $\geq \frac{1}{4}$ " thick except that DS plain glass or 40 oz glass may be used where the area of a panel is $\leq 200 \text{ in}^2$ and $600 \text{ in}^2$ , respectively. <b>(h)(n)</b>
<b>Automotive Shops</b>	<b>185.390g4</b>	$\frac{1}{2}$ -hour	Detection not required [185.395c2]	1-hour if in unsprinklered basement and lead directly into interior stair or ramp enclosure. $\frac{3}{4}$ -hour if located in an unsprinklered basement or otherwise in any unsprinklered building > 2 stories. See also [185.390g5C] for borrowed lights in walls. Detection required [185.395c2B] <b>(k)</b>
<b>Automotive Shop Opening Protectives</b>	<b>185.380c10F</b>	See comments		Metal, SC wood or structurally stable wood panel construction. Borrowed light or vision panels in doors shall be fixed sash type glazed with wired glass or plate glass $\geq \frac{1}{4}$ " thick except that DS plain glass or 40 oz glass may be used where the area of a panel is $\leq 200 \text{ in}^2$ and $600 \text{ in}^2$ , respectively <b>(n)</b>
<b>Basements with Student Occupancy</b>	<b>185.390c1</b>	1-hour	Prevent passage of heat, smoke and gases [185.390c2]	Separation to floor above <b>(j)</b>

<b>Part 185: Before July 1, 1965</b>				
<b>Room or Area</b>	<b>Section</b>	<b>Fire Rating</b>	<b>With Sprinklers</b>	<b>Comments</b>
<b>Boiler Room</b>	<b>185.310e8Bi</b>	Definition		Houses fuel-burning equipment whose purpose is to provide heat or domestic hot water.
<b>Boiler Rooms (&gt; 200,000 BTU and &gt; 1.5 gph for oil)</b>	<b>185.390e2C</b>	1-hour	Detection not required [185.395c2]	Detection required [185.395c2A]
<b>Boiler Room Opening Protectives (&gt; 200,000 BTU and &gt; 1.5 gph for oil)</b>	<b>185.390e2E</b>	1½-hours, or 1-hour		Door must swing into the room if an interior door. Vision panel in door only as permitted in a B-labeled door <b>(i)(n)</b>
<b>Boiler Room (basement) of a ≥ 2 story building or beneath a Class A or B Assembly Occupancy</b>	<b>185.390e2C</b>	2-hours	Detection not required [185.395c2]	Detection required [185.395c2A]
<b>Boiler Room (basement) of a ≥ 2 story building or beneath a Class A or B Assembly Opening Protectives</b>	<b>185.390e2E</b>	1½-hours, or 1-hour		Door must swing into the room if an interior door. Vision panel in door only as permitted in a B-labeled door <b>(i)(n)</b>
<b>Boiler Rooms (other)</b>	<b>185.390e2C</b>	½-hour	Detection not required [185.395c2]	No borrowed lights or vision panels permitted in wall. Detection required [185.395c2A]
<b>Boiler Room (other) Opening Protectives</b>	<b>185.390e2F</b>	¾-hour, SC wood, or metal		Vision panels glazed with ¼" wired glass. No other borrowed lights or vision panels permitted. <b>(n)</b>

Part 185: Before July 1, 1965				
Room or Area	Section	Fire Rating	With Sprinklers	Comments
Cafeteria > 200	185.390(g)(4)	½-hour	Detection not required [185.395c2]	1-hour if in unsprinklered basement and lead directly into interior stair or ramp enclosure. ¾-hour if located in an unsprinklered basement or otherwise in any unsprinklered building > 2 stories. See also [185.390g5C] for borrowed lights in walls Detection required if flame spread is > 75 [185.395c2D]
Cafeteria > 200 Opening Protectives	185.380c10F	See comments		Metal, SC wood or structurally stable wood panel construction. Borrowed light or vision panels in doors shall be fixed sash type glazed with wired glass or plate glass ≥ ¼" thick except that DS plain glass or 40 oz glass may be used where the area of a panel is ≤ 200 in <sup>2</sup> and 600 in <sup>2</sup> , respectively. <b>(h)(n)</b>
Cloakrooms	185.310e5D	See comments		≤ 100 ft <sup>2</sup> with access from a classroom or a special education room is considered part of the classroom as long as only used for wraps, coats and other human apparel. Others are classified as a storage occupancy
Cloakroom Opening Protectives	185.390f1C	See comments	No door required between classroom and cloakroom if cloakroom ≤ 200 ft <sup>2</sup>	No door required between classroom and cloakroom if cloakroom is ≤ 100ft <sup>2</sup>

Part 185: Before July 1, 1965				
Room or Area	Section	Fire Rating	With Sprinklers	Comments
Closets	185.310e5C	See comments	Detection not required [185.395c2]	Teacher's closets $\leq 12 \text{ ft}^2$ with access from a classroom or special education room is considered part of the classroom. Other closets not under this scope are considered as storage occupancies Detection required [185.395c2A]
Closet Doors	185.310e5C	See comments	Panel areas in adjacent column may be doubled	In unsprinklered buildings, DS, 40 oz or plate glass (1/4" minimum) maybe be used in borrowed light openings provided the area of panels is $\leq 600, 800$ and $1000 \text{ in}^2$ , respectively, provided the flame spread rating is $< 75$ on both sides.
Corridors	185.390g5	1/2-hour		
Corridor Opening Protectives	185.380c10F	See comments		Metal, SC wood or structurally stable wood panel construction. Borrowed light or vision panels in doors shall be fixed sash type glazed with wired glass or plate glass $\geq 1/4$ " thick except that DS plain glass or 40 oz glass may be used where the area of a panel is $\leq 200 \text{ in}^2$ and $600 \text{ in}^2$ , respectively. <b>(a)(n)</b>
Crawl Spaces	185.390d1	Smoke tight		No storage permitted
Crawl Space Opening Protectives	185.390d1	Smoke tight		Access doors must remain closed and locked
Educational Occupancy	185.310e5	Definition		Spaces used for normal educational purposes $\leq 200$ including classrooms, locker rooms, toilets, offices, corridors, stairs

Part 185: Before July 1, 1965				
Room or Area	Section	Fire Rating	With Sprinklers	Comments
Electrical Equipment Rooms	185.390g4	½-hour	Detection not required [185.395(c)(2)]	1-hour if in unsprinklered basement and lead directly into interior stair or ramp enclosure. ¾-hour if located in an unsprinklered basement or otherwise in any unsprinklered building > 2 stories. See also [185.390g5C] for borrowed lights in walls. Detection required [185.395c2A]
Electrical Equipment Opening Protectives	185.380c10F	See comments		Metal, SC wood or structurally stable wood panel construction. Door closer required or door must be kept locked. Borrowed light or vision panels in doors shall be fixed sash type glazed with wired glass or plate glass $\geq \frac{1}{4}$ " thick except that DS plain glass or 40 oz glass may be used where the area of a panel is $\leq 200 \text{ in}^2$ and $600 \text{ in}^2$ , respectively <b>(n)</b>
Fire Escapes	185.370k9	See comments	$\geq \frac{1}{4}$ " plate glass shall be permitted in lieu of wired glass in exterior window and door openings located in sprinklered Educational Occupancy rooms or spaces.  "Small court" rule does not apply	Openings within 10 ft. of a fire escape stairs, walkways, or landings shall be protected using glass panels shall be glazed with wired glass. Such wired glass panels, where located in doors, shall be $\leq 720 \text{ in}^2$ or have any dimension > 54". Where located in windows, such panels shall be $\leq 1,296 \text{ in}^2$ , or have any dimension more > 54".  Where fire escape stairs are located in "small courts" the least dimension < $\frac{1}{3}$ their height, all openings below shall be protected.

<b>Part 185: Before July 1, 1965</b>				
<b>Room or Area</b>	<b>Section</b>	<b>Fire Rating</b>	<b>With Sprinklers</b>	<b>Comments</b>
<b>Fire Resistive Passageway – Unsprinklered Basements</b>	<b>185.370e4A</b>	1-hour		<b>(b)(j)</b>
<b>Fire Resistive Passageway- Unsprinklered Basement Opening Protectives</b>	<b>185.370m6ii (exception)</b>	1-hour		See exception language <b>(n)</b>
<b>Fire Resistive Passageway – Unsprinklered Building &gt; 2 stories</b>	<b>185.370e4</b>	1-hour		<b>(b)(j)(m)</b>
<b>Fire Resistive Passageway – Unsprinklered Building &gt; 2 stories Opening Protectives</b>	<b>185.370m6ii (exception)</b>	3 hours, 1½-hours, or 1-hour		<b>(m)(n)</b>
<b>Fire Resistive Passageway – Other</b>	<b>185.370e4</b>	¾-hour		<b>(b)(m)</b>
<b>Fire Resistive Passageway – Other Opening Protectives</b>	<b>185.370m6</b>	See comments		SC wood, metal construction mounted in rigid N/C frames except that combustible frames with minimum 2” nominal members may be used. Borrowed light or vision panels shall be approved wired glass. <b>(m)(n)</b>
<b>Fire Wall</b>	<b>185.220b</b>	2-hours		<b>(m)</b>
<b>Fire Wall Doors</b>	<b>185.390g2A</b>	3-hours, 1½-hours, or 1-hour		<b>(m)(n)</b>
<b>Fuel Storage</b>	<b>185.310e8C</b>	(See Boiler Rooms)		
<b>Fuel Storage Opening Protectives</b>	<b>185.310e8C</b>	(See Boiler Rooms)		
<b>Furnace Room</b>	<b>185.310e8C</b>	(See Boiler Rooms)		
<b>Furnace Room Opening Protective</b>	<b>185.310e8C</b>	(See Boiler Rooms)		

Part 185: Before July 1, 1965				
Room or Area	Section	Fire Rating	With Sprinklers	Comments
Greenhouses	185.390g4	½-hour	Detection not required [185.395c2]	1-hour if in unsprinklered basement and lead directly into interior stair or ramp enclosure. ¾-hour if located in an unsprinklered basement or otherwise in any unsprinklered building > 2 stories. See also [185.390g5C] for borrowed lights in walls. Detection required [185.395c2B]
Greenhouse Opening Protectives	185.380c10F	See comments		Metal, SC wood or structurally stable wood panel construction. Borrowed light or vision panels in doors shall be fixed sash type glazed with wired glass or plate glass ≥ ¼" thick except that DS plain glass or 40 oz glass may be used where the area of a panel is ≤ 200 in <sup>2</sup> and 600 in <sup>2</sup> , respectively. (n)
Gym/Multipurpose Room > 200	185.390g4	½-hour		1-hour if in unsprinklered basement and lead directly into interior stair or ramp enclosure. ¾-hour if located in an unsprinklered basement or otherwise in any unsprinklered building > 2 stories. See also [185.390g5C] for borrowed lights in walls.
Gym/Multipurpose Room > 200 Opening Protectives	185.380c10F	See comments		Metal, SC wood or structurally stable wood panel construction. Borrowed light or vision panels in doors shall be fixed sash type glazed with wired glass or plate glass ≥ ¼" thick except that DS plain glass or 40 oz glass may be used where the area of a panel is ≤ 200 in <sup>2</sup> and 600 in <sup>2</sup> , respectively. (n)

<b>Part 185: Before July 1, 1965</b>				
<b>Room or Area</b>	<b>Section</b>	<b>Fire Rating</b>	<b>With Sprinklers</b>	<b>Comments</b>
<b>Home Economics</b>	<b>185.390g4</b>	½-hour	Detection not required [185.395c2]	1-hour if in unsprinklered basement and lead directly into interior stair or ramp enclosure. ¾-hour if located in an unsprinklered basement or otherwise in any unsprinklered building > 2 stories. See also [185.390g5C] for borrowed lights in walls. Detection required [185.395c2B]
<b>Home Economics Room Opening Protectives</b>	<b>185.380c10F</b>	See comments		Metal, SC wood or structurally stable wood panel construction. Borrowed light or vision panels in doors shall be fixed sash type glazed with wired glass or plate glass ≥ ¼" thick except that DS plain glass or 40 oz glass may be used where the area of a panel is ≤ 200 in <sup>2</sup> and 600 in <sup>2</sup> , respectively. <b>(n)</b>
<b>Horizontal Exits</b>	<b>185.370g4B</b>	2-hours		No openings permitted except for exit doors.
<b>Horizontal Exit Doors</b>	<b>185.370g4B</b>	1½-hours or 1-hour		100 in <sup>2</sup> vision panel required as well as 2 opposite swinging doors with exit signs and panic hardware <b>(a)(n)</b>
<b>Incinerator Rooms</b>	<b>185.310e8C</b>	(See Boiler Rooms)		
<b>Incinerator Room Opening Protectives</b>	<b>185.310e8C</b>	(See Boiler Rooms)		



Part 185: Before July 1, 1965				
Room or Area	Section	Fire Rating	With Sprinklers	Comments
Industrial Technology and Metal Working Shops	185.390g4	½-hour	Detection not required [185.395c2]	1-hour if in unsprinklered basement and lead directly into interior stair or ramp enclosure. ¾-hour if located in an unsprinklered basement or otherwise in any unsprinklered building > 2 stories. See also [185.390g5C] for borrowed lights in walls. Detection required [185.395c2B]
Industrial Technology and Metal Working Shops Opening Protectives	185.380c10F	See comments		Metal, SC wood or structurally stable wood panel construction. Borrowed light or vision panels in doors shall be fixed sash type glazed with wired glass or plate glass ≥ ¼" thick except that DS plain glass or 40 oz glass may be used where the area of a panel is ≤ 200 in <sup>2</sup> and 600 in <sup>2</sup> , respectively (n)
Janitor's Closets	185.390g4	½-hour	Detection not required [185.395c2]	1-hour if in unsprinklered basement and lead directly into interior stair or ramp enclosure. ¾-hour if located in an unsprinklered basement or otherwise in any unsprinklered building > 2 stories. See also [185.390g5C] for borrowed lights in walls. Detection required [185.395c2A]

Part 185: Before July 1, 1965				
Room or Area	Section	Fire Rating	With Sprinklers	Comments
Janitor's Closets Opening Protectives	185.380c10F	See comments		Metal, SC wood or structurally stable wood panel construction. Borrowed light or vision panels in doors shall be fixed sash type glazed with wired glass or plate glass $\geq \frac{1}{4}$ " thick except that DS plain glass or 40 oz glass may be used where the area of a panel is $\leq 200 \text{ in}^2$ and $600 \text{ in}^2$ , respectively. (n)
Kitchens (not home economics kitchens)	185.390g4	$\frac{1}{2}$ -hour	Detection not required [185.395c2]	1-hour if in unsprinklered basement and lead directly into interior stair or ramp enclosure. $\frac{3}{4}$ -hour if located in an unsprinklered basement or otherwise in any unsprinklered building > 2 stories. See also [185.390g5C] for borrowed lights in walls. Detection required [185.395c2B]
Kitchen Opening Protectives	185.380c10F	See comments		Metal, SC wood or structurally stable wood panel construction. Borrowed light or vision panels in doors shall be fixed sash type glazed with wired glass or plate glass $\geq \frac{1}{4}$ " thick except that DS plain glass or 40 oz glass may be used where the area of a panel is $\leq 200 \text{ in}^2$ and $600 \text{ in}^2$ , respectively. (n)

<b>Part 185: Before July 1, 1965</b>				
<b>Room or Area</b>	<b>Section</b>	<b>Fire Rating</b>	<b>With Sprinklers</b>	<b>Comments</b>
<b>Libraries/Learning Resource Centers &gt; 200</b>	<b>185.390g4</b>	½-hour	Detection not required [185.395c2]	1-hour if in unsprinklered basement and lead directly into interior stair or ramp enclosure. ¾-hour if located in an unsprinklered basement or otherwise in any unsprinklered building > 2 stories. See also [185.390g5C] for borrowed lights in walls. Detection required [185.395c2D]
<b>Libraries/Learning and Resource Centers &gt; 200 Opening Protectives</b>	<b>185.380c10F</b>	See comments		Metal, SC wood or structurally stable wood panel construction. Borrowed light or vision panels in doors shall be fixed sash type glazed with wired glass or plate glass ≥ ¼" thick except that DS plain glass or 40 oz glass may be used where the area of a panel is ≤ 200 in <sup>2</sup> and 600 in <sup>2</sup> , respectively. <b>(n)</b>
<b>Mechanical Occupancy</b>	185.310e8	Definition		Includes all rooms and spaces in a school which are used primarily to house mechanical equipment of a permanent nature. Mechanical equipment shall be construed to also include transformers, electrical switchgear motors, and other equipment and devices of a similar nature powered by electricity. Subdivided into: ➤ Boiler Rooms ➤ Mechanical Equipment Rooms

Part 185: Before July 1, 1965				
Room or Area	Section	Fire Rating	With Sprinklers	Comments
<b>Mechanical Equipment Room</b>	185.310e8Bii	Definition		Houses non-fuel burning mechanical equipment: transformers, electrical switchgear, air compressors, pump motors, steam turbine-driven fans, air conditioning other than gas fired.
<b>Mechanical Equipment Room</b>	<b>185.390g4</b> <b>185.390e3D</b>	½-hour	[185.395c2]	1-hour if in unsprinklered basement and lead directly into interior stair or ramp enclosure. Sprinklered or 1-hour if located below an assembly occupancy. ¾-hour if located in an unsprinklered basement or otherwise in any unsprinklered building > 2 stories. Detection Required [185.395c2A] <b>(j)</b>
<b>Mechanical Equipment Room Opening Protectives</b>	<b>185.380c10F</b>	See comments		Metal, SC wood or structurally stable wood panel construction. Borrowed light or vision panels in doors shall be fixed sash type glazed with wired glass or plate glass ≥ ¼" thick except that DS plain glass or 40 oz glass may be used where the area of a panel is ≤ 200 in <sup>2</sup> and 600 in <sup>2</sup> , respectively. <b>(n)</b>
<b>Painting and Finishing Areas</b>	<b>185.390f2B</b>	½-hour	No detection required 185.395c2	Sprinklered or 1-hour if located below an assembly occupancy. ¾-hour if in any unsprinklered building > 2 stories. See also 185.390g5C for borrowed lights in walls. <b>(j)(k)</b>

<b>Part 185: Before July 1, 1965</b>				
<b>Room or Area</b>	<b>Section</b>	<b>Fire Rating</b>	<b>With Sprinklers</b>	<b>Comments</b>
<b>Painting and Finishing Opening Protectives</b>	<b>185.380c10F</b>	See comments		Metal, SC wood or structurally stable wood panel construction. Borrowed light or vision panels in doors shall be fixed sash type glazed with wired glass or plate glass $\geq \frac{1}{4}$ " thick except that DS plain glass or 40 oz glass may be used where the area of a panel is $\leq 200 \text{ in}^2$ and $600 \text{ in}^2$ , respectively. <b>(k)(n)</b>
<b>Paths of Travel, Primary</b>	<b>185.380b3 185.220b</b>	Utilize corridors and/or primary egress aisles as the paths of travel to approved exits from the doorways of the rooms and/or spaces involved with minimum amount of travel (if any) through adjacent occupied rooms or spaces		
<b>Paths of Travel, Secondary</b>	<b>185.380b4 185.220b</b>	Do not qualify as a primary path of travel and are supplemental to a primary path of travel used as travel to an exit and normally passes through adjacent rooms or spaces		
<b>Paths of Travel, Separated</b>	<b>185.220b</b>	Exits or paths of travel to exits which are so separated by smoke screens, fire partitions, corridor enclosure walls and other partitions and walls of equivalent construction as to prevent both exits and/or both paths of travel from becoming simultaneously unusable as a result of heat, smoke or gas accumulation developing from a single fire		
<b>Plan A Building</b>	<b>185.320</b>	Single story building with or without a basement		
<b>Plan A Fire Areas</b>	<b>185.320c</b>	See definitions and specific requirements identified in Part 185		
<b>Plan A Interior Finish</b>	<b>185.320e</b>			
<b>Plan A Smoke Areas</b>	<b>185.320c</b>			
<b>Plan A Sprinklered – also see 185.320b3</b>	<b>185.320b2A</b>	Sprinklers required in all areas except for educational occupancy rooms and spaces, including corridors with interior finish $\leq 75$ and attic and other concealed spaces above ceilings.		
<b>Plan A Stairways</b>	<b>185.320d</b>	See specific requirements identified in Part 185		

<b>Part 185: Before July 1, 1965</b>				
<b>Room or Area</b>	<b>Section</b>	<b>Fire Rating</b>	<b>With Sprinklers</b>	<b>Comments</b>
<b>Plan A Unsprinklered – see also 185.320b3</b>	<b>185.320b2B</b>	Fire detection required throughout except for any building having a total capacity of < 100 or, Street floor and attics of buildings and fire areas of Type I, II, III and IV construction with interior finish ≤ 75. This does not apply to stages, storage rooms, dressing rooms and under stage areas located in Class A and Class B Assembly Occupancies.		
<b>Plan B Building</b>	<b>185.330</b>	> 1 story in height have direct exterior exiting as defined under [185.310c3]. <b>(g)</b>		
<b>Plan B Fire Areas</b>	<b>185.330b2</b>	See definitions and specific requirements identified in Part 185		
<b>Plan B Height &amp; Area Limits</b>	<b>185.330b</b>			
<b>Plan B Smoke Areas</b>	<b>185.330b3</b>			
<b>Plan B Vertical Openings</b>	<b>185.330c</b>			
<b>Plan C Building</b>	<b>185.340</b>	Buildings > 1 story in height with an enclosed interior arrangement consisting of rooms instead of spaces, and corridors instead of egress aisles. [185.310c2A]		
<b>Plan C Height &amp; Area Limits</b>	<b>185.340b</b>	See definitions and specific requirements identified in Part 185		
<b>Plan C Vertical Openings</b>	<b>185.340c</b>			
<b>Plan D Building</b>	<b>185.350</b>	Buildings > 1 story in height with an open interior not qualifying as a Plan B Building		
<b>Plan D Height &amp; Area Limits</b>	<b>185.350b</b>	See definitions and specific requirements identified in Part 185		
<b>Plan D Vertical Openings</b>	<b>185.350c</b>			
<b>Photo Developing Room</b>	<b>185.390g4</b>	½-hour	Detection not required [185.395c2]	1-hour if in unsprinklered basement and lead directly into interior stair or ramp enclosure. ¾-hour if located in an unsprinklered basement or otherwise in any unsprinklered building > 2 stories. See also [185.390g5C] for borrowed lights in walls. Detection required [185.395c2B]

Part 185: Before July 1, 1965				
Room or Area	Section	Fire Rating	With Sprinklers	Comments
Photo Developing Room Opening Protectives	185.380c10F	See comments		Metal, SC wood or structurally stable wood panel construction. Borrowed light or vision panels in doors shall be fixed sash type glazed with wired glass or plate glass $\geq \frac{1}{4}$ " thick except that DS plain glass or 40 oz glass may be used where the area of a panel is $\leq 200$ in <sup>2</sup> and 600 in <sup>2</sup> respectively. <b>(n)</b>
Printing Rooms	185.390f2B	$\frac{1}{2}$ -hour	No detection [185.395c2]	Sprinklered or 1-hour if located below an assembly occupancy. $\frac{3}{4}$ -hour if in any unsprinklered building > 2 stories. See also [185.390g5C] for borrowed lights in walls. <b>(k)</b>
Printing Room Opening Protectives	185.380c10F	See comments		Metal, SC wood or structurally stable wood panel construction. Borrowed light or vision panels in doors shall be fixed sash type glazed with wired glass or plate glass $\geq \frac{1}{4}$ " thick except that DS plain glass or 40 oz glass may be used where the area of a panel is $\leq 200$ in <sup>2</sup> and 600 in <sup>2</sup> , respectively. <b>(k)(n)</b>
Projection Rooms used in Assembly Rooms	185.360d1B	$\frac{1}{2}$ -hour	$\frac{1}{2}$ -hour or N/C construction Detection not required [185.395c2]	Does not apply to lighting and sound booths Detection required if flame spread > 75 [185.395c2D]

<b>Part 185: Before July 1, 1965</b>				
<b>Room or Area</b>	<b>Section</b>	<b>Fire Rating</b>	<b>With Sprinklers</b>	<b>Comments</b>
<b>Projection Rooms Opening Protectives</b>	<b>185.360d1B</b>	See comments		Hollow metal or SC wood doors with automatic closer or kept locked when not occupied <b>(n)</b>
<b>Science Laboratories</b>	<b>185.390g4</b>	½-hour	Detection not required [185.395c2]	1-hour if in unsprinklered basement and lead directly into interior stair or ramp enclosure. ¾-hour if located in an unsprinklered basement or otherwise in any unsprinklered building > 2 stories. See also [185.390g5C] for borrowed lights in walls. Detection required [185.395c2B]
<b>Science Laboratories Opening Protectives</b>	<b>185.380c10F</b>	See comments		Metal, SC wood or structurally stable wood panel construction. Borrowed light or vision panels in doors shall be fixed sash type glazed with wired glass or plate glass ≥ ¼" thick except that DS plain glass or 40 oz glass may be used where the area of a panel is ≤ 200 in <sup>2</sup> and 600 in <sup>2</sup> , respectively. <b>(n)</b>
<b>Smoke Screen Partitions</b>	<b>185.390g3B</b>	½-hour		A structurally stable partition constructed primarily of wired glass panels mounted in wood framing (2"nominal) provided the exposed combustible surface area of the wood framing does not exceed 10% of the total area of the smoke screen
<b>Smoke Screen Partitions Opening Protectives</b>	<b>185.390g3B</b>	See comments		¼" clear wired glass in borrowed lights and vision panels. Metal or SC wood doors. <b>(n)</b>



Part 185: Before July 1, 1965				
Room or Area	Section	Fire Rating	With Sprinklers	Comments
Special Education Occupancy	185.310e6	Definition		≤ 200 used for industrial arts rooms, shops, home economics rooms, laboratories, art rooms, cafeterias, kitchens, libraries, dormitories, drama workshop rooms, garages with student occupancy
Stages (Large)			Sprinklers required [185.360e]	
Stages (Large) Opening Protectives	185.360e1	See comments		Metal or SC wood doors. <b>(f)(n)</b>
Stages (Large) and Accessory Areas	185.d1B	½-hour	Sprinklers required [185.360e1]	
Stages (Large) Accessory Area Opening Protectives	185.360d1B	See comments		Hollow metal or SC wood construction.
Stages (Small)	185.360e3	½-hour	N/C construction	Fire detection can be installed in lieu of sprinklers if the stage is located in an unsprinklered building
Stages (Small) Opening Protectives	185.360e3	See comments		Metal or SC wood doors. <b>(n)</b>
Stages with Storage Underneath	185.360d1C	½-hour	N/C construction	If stage is required to be protected with sprinklers, then the areas underneath the stage are required to be protected. If no sprinklers then detection is required. For spaces beneath a stage that is used for both storage and as a plenum chamber with grilled openings into the general assembly area see [185.360d2] <b>(e)</b>
Stages with Storage Underneath Opening Protectives	185.360d1B	½-hour		Metal or SC wood doors. <b>(n)</b>

Part 185: Before July 1, 1965				
Room or Area	Section	Fire Rating	With Sprinklers	Comments
Stairs ≤ 4 stories	185.390h2Ci	¾-hour	≤ 6 stories Detection not required [185.395c2]	Detection required at top of stairway and beneath the ceiling of each story at the point of entrance into the stairs [185.395c2F]
Stairs ≤ 4 stories Opening Protectives	185.390h2D 185.390h2E 185.370m6	SC wood or metal in N/C frames (c)		¼" wired glass in N/C frames ≤ 1200 in <sup>2</sup> except that glass panels may be of unlimited size in walls between corridors and stairway. (n)
Stairs > 4 stories	185.390h2Cii	1-hour	Detection not required [185.395c2]	Detection required at top of stairs and beneath the ceiling of each story at the point of entrance into the stairs [185.395c2F]
Stairs > 4 stories Opening Protectives	185.390h2D 185.390h2E 185.370m6	3-hour, 1½-hour or 1-hour		¼" wired glass vision panel required except in 3-hour doors. (n)
Storage Occupancy	185.310e7	Definition		Used for storage or for building maintenance and repair purposes
Storage Occupancy	185.390g4	½-hour	Detection not required [185.395c2]	1-hour if in unsprinklered basement and lead directly into interior stair or ramp enclosure. ¾-hour if located in an unsprinklered basement or otherwise in any unsprinklered building > 2 stories. See also 185.390g5C for borrowed lights in walls. Detection required [185.395c2A]

Part 185: Before July 1, 1965				
Room or Area	Section	Fire Rating	With Sprinklers	Comments
Storage Room Opening Protectives	185.380c10F	See comments		Metal, SC wood or structurally stable wood panel construction. Borrowed light or vision panels in doors shall be fixed sash type glazed with wired glass or plate glass $\geq \frac{1}{4}$ " thick except that DS plain glass or 40 oz glass may be used where the area of a panel is $\leq 200 \text{ in}^2$ and $600 \text{ in}^2$ , respectively (n)
Swimming Pools > 200	185.390g4	$\frac{1}{2}$ -hour	No detection required	1-hour if in unsprinklered basement and lead directly into interior stair or ramp enclosure. $\frac{3}{4}$ -hour if located in an unsprinklered basement or otherwise in any unsprinklered building > 2 stories. See also [185.390g5C] for borrowed lights in walls. Detection required if flame spread is > 75 [185.395c2D]
Swimming Pool > 200 Opening Protectives	185.380c10F	See comments		Metal, SC wood or structurally stable wood panel construction. Borrowed light or vision panels in doors shall be fixed sash type glazed with wired glass or plate glass $\geq \frac{1}{4}$ " thick except that DS plain glass or 40 oz glass may be used where the area of a panel is $\leq 200 \text{ in}^2$ and $600 \text{ in}^2$ , respectively (n)

Part 185: Before July 1, 1965				
Room or Area	Section	Fire Rating	With Sprinklers	Comments
Teacher's Workrooms and Lounges (with cooking/heating appliances)	185.390g4	½-hour	Detection not required [185.395c2]	1-hour if in unsprinklered basement and lead directly into interior stair or ramp enclosure. ¾-hour if located in an unsprinklered basement or otherwise in any unsprinklered building > 2 stories. Detection required [185.395c2B]
Teacher's Workrooms and Lounges (with cooking/heating appliances) Opening Protectives	185.380c10F	See comments		Metal, SC wood or structurally stable wood panel construction. Borrowed light or vision panels in doors shall be fixed sash type glazed with wired glass or plate glass ≥ ¼" thick except that DS plain glass or 40 oz glass may be used where the area of a panel is ≤ 200 in² and 600 in², respectively <b>(n)</b>
Transformer Rooms that use Flammable Coolant	185.390e3B	See comments		Follow requirements for a "vault" per NFPA 70- <i>National Electrical Code</i> (1962)
Trash Chute ≤ 5 stories	185.390h5 185.390h4	¾-hour		Sprinkler protection required at the top of the chute
Trash Chute ≤ 5 stories Opening Protectives	185.390h5	¾-hour		<b>(n)</b>
Trash Chute > 5 stories	185.390h5 185.390h4	1-hour		Sprinkler protection required at the top of the chute
Trash Chute > 5 stories Opening Protectives	185.390h5	1-hour		<b>(n)</b>
Trash Collection Room	185.390h5B	See comments		Sprinkler protection required rooms > 20 ft²
Utility Tunnels	185.390d1	Smoke tight		Sprinklers required if used for any type of storage

Part 185: Before July 1, 1965				
Room or Area	Section	Fire Rating	With Sprinklers	Comments
Utility Tunnel Opening Protectives	185.390d1	Smoke tight		Access doors must remain closed and locked
Ventilation Equipment Rooms	185.390g4 185.390e3D	½-hour	Detection not required [185.395c2]	1-hour if in unsprinklered basement and lead directly into interior stair or ramp enclosure. Sprinklered or 1-hour if located below an assembly occupancy. ¾-hour if located in an unsprinklered basement or otherwise in any unsprinklered building > 2 stories. See also [185.390g5C] for borrowed lights in walls.  Detection required [185.395c2A] <b>(j)</b>
Ventilation Equipment Room Opening Protective	185.380c10F	See comments		Metal, SC wood or structurally stable wood panel construction. Borrowed light or vision panels in doors shall be fixed sash type glazed with wired glass or plate glass ≥ ¼" thick except that DS plain glass or 40 oz glass may be used where the area of a panel is ≤ 200 in <sup>2</sup> and 600 in <sup>2</sup> , respectively. <b>(n)</b>
Ventilation Shafts ≤ 5 stories	185.390h4	¾-hour		Except when protected with a UL listed fire damper
Ventilation Shafts > 5 stories	185.390h4	1-hour		Except when protected with a UL listed fire damper
Woodworking Shops	185.390f2B	½-hour	Detection not required [185.395c2]	Sprinklered or 1-hour if located below an assembly occupancy. ¾-hour if in any unsprinklered building > 2 stories. See also [185.390g5C] for borrowed lights in walls. <b>(j)(k)</b>

Part 185: Before July 1, 1965				
Room or Area	Section	Fire Rating	With Sprinklers	Comments
Woodworking Shops Opening Protectives		See comments		Metal, SC wood or structurally stable wood panel construction. Borrowed light or vision panels in doors shall be fixed sash type glazed with wired glass or plate glass $\geq \frac{1}{4}$ " thick except that DS plain glass or 40 oz glass may be used where the area of a panel is $\leq 200 \text{ in}^2$ and $600 \text{ in}^2$ , respectively. <b>(k)(n)</b>

N/C = Noncombustible Construction

SC = Solid Core

(a) = Automatic hold open device in accordance with 185.370m6Bii are permitted

(b) = Fire resistive passageway can be thought of as a horizontal extension of a stairway. A fire resistive passageway can also be an "exit" located within a building that i.e. used when travel distances are too long.

(c) = Combustible frames are permitted but must be  $\leq 2$ " nominal lumber.

(d) = (Reserved)

(e) = For spaces beneath a stage that is used both for storage and as a plenum chamber with grilled openings into the general assembly area, see 185.360(d)(2)

(f) = Proscenium curtain must be N/C or "flame-proof" curtain.

(g) = (Reserved)

(h) = See also 185.310(e)(4)(B)

(i) = See NFPA 80 (1962)

(j) = Or be of concrete pan construction with a  $2\frac{1}{2}$ " minimum floor thickness or wood joists with metal lath and plaster

(k) = [185.390f2B] Shall be protected with sprinklers when such room or area is located in a basement or beneath any portion of a Type IV or Type V building subject to occupancy by students; or are open to a primary egress aisle as defined in 185.380(d). See 185.390(f)(2)(B) for exception that permits installation of fire detection.

(l) = (Reserved)

(m) = That portion of a fire wall located within and extending laterally across a corridor or a fire resistive passageway may be of  $\frac{1}{2}$ -hour N/C construction with  $\frac{1}{4}$ " wired glass provided panels are mounted in N/C frames and are  $\leq 1296 \text{ in}^2$ . [185.390g2A]

(n) = No louvers permitted, doors must have closers and latches.

## APPENDIX Q-Part 180 Fire Rated Separations

### Health/Life Safety Code for Public Schools (23 Ill. Adm. Code 180)

*Outline for use with Part 180  
Public School Buildings designed after March 24, 1995<sup>(a)</sup>*

Room or Area	BOCA 1993 (a)(e)	BOCA 1996 (a)(f)	ICC 2003 (a)(g)	ICC 2006 (a)(h)	ICC 2009 (a)(p)	ICC 2015 (a)(r)	Comments
<b>Part 180</b>	On or after 3/24/95 but before 7/6/98	On or after 7/6/98 but before 10/3/05	On or after 10/3/05 but before 9/25/07	On or after 9/25/07 but before 1/1/10	On or after 1/1/10 but before 7/1/16	On or after 7/1/16	
<b>Agricultural Shops</b>	NR	NR	1-hour or sprinklers [Table 302.1.1]	1-hour or sprinklers [Table 508.2]	1-hour or sprinklers [Table 508.2.5]	1-hour or sprinklers [Table 509]	<b>(b)(j)</b>
<b>Agricultural Shop Opening Protectives</b>	NR	NR	¾-hour or sprinklers [Table 715.3]	¾-hour or sprinklers [Table 715.4]	¾-hour or sprinklers [Table 715.4]	¾-hour or sprinklers [Table 716.5]	<b>(b)(d)(j)(t)</b>
<b>Art Rooms</b>	NR	NR	NR	NR	NR	NR	
<b>Art Room Opening Protectives</b>	NR	NR	NR	NR	NR	NR	
<b>Assembly</b>	2-hours or 1-hour with sprinklers [Table 313.1.2]	2-hours or 1-hour with sprinklers [Table 313.1.2]	2-hours or 1-hour with sprinklers [Table 302.3.2]	NR	NR	NR	<b>(j)</b>

Room or Area	BOCA 1993 (a)(e)	BOCA 1996 (a)(f)	ICC 2003 (a)(g)	ICC 2006 (a)(h)	ICC 2009 (a)(p)	ICC 2015 (a)(r)	Comments
<b>Part 180</b>	On or after 3/24/95 but before 7/6/98	On or after 7/6/98 but before 10/3/05	On or after 10/3/05 but before 9/25/07	On or after 9/25/07 but before 1/1/10	On or after 1/1/10 but before 7/1/16	On or after 7/1/16	
<b>Assembly Opening Protectives</b>	1½-hours or ¾-hour with sprinklers [Table 716.1]	1½-hours or ¾-hour with sprinklers [Table 717.1]	1½-hours or ¾-hour with sprinklers [Table 715.3]	NR	NR	NR	<b>(d)(j)(t)</b>
<b>Attics used for combustible storage</b>	Sprinklers and smoke partitions [Table 302.1.1]	Sprinklers and smoke partitions [Table 302.1.1]	1-hour or sprinklers [413.2] [717.4]	1-hour or sprinklers [413.2] [717.4]	1-hour or sprinklers [413.2] [717.4]	1-hour or sprinklers [413.2] [718.4]	In combustible construction any attic (no matter if used for storage or not) must be draftstopped in accordance with applicable code unless building is protected with sprinklers <b>(j)</b>
<b>Attics used for combustible storage Opening Protectives</b>	Self-closing and prevent spread of smoke [1211.2] [Table 302.1.1]	Self-closing and prevent spread of smoke [1211.2] [Table 302.1.1]	Self-closing 1¾" SC wood doors or N/C construction [413.2]	Self-closing 1¾" SC wood doors or N/C construction [413.2]	Self-closing 1¾" SC wood doors or N/C construction [413.2]	Self-closing 1¾" SC wood doors or N/C construction [413.2]	



<b>Room or Area</b>	<b>BOCA 1993 (a)(e)</b>	<b>BOCA 1996 (a)(f)</b>	<b>ICC 2003 (a)(g)</b>	<b>ICC 2006 (a)(h)</b>	<b>ICC 2009 (a)(p)</b>	<b>ICC 2015 (a)(r)</b>	<b>Comments</b>
<b>Part 180</b>	<b>On or after 3/24/95 but before 7/6/98</b>	<b>On or after 7/6/98 but before 10/3/05</b>	<b>On or after 10/3/05 but before 9/25/07</b>	<b>On or after 9/25/07 but before 1/1/10</b>	<b>On or after 1/1/10 but before 7/1/16</b>	<b>On or after 7/1/16</b>	
<b>Auditoriums</b>	2-hours, 1-hour and sprinklers [Table 313.1.2]	2-hours, 1-hour and sprinklers [Table 313.1.2]	2-hours or 1-hour with sprinklers <sup>l</sup> [Table 302.3.2]	NR	NR	NR	<b>(j)</b>
<b>Auditoriums Opening Protectives</b>	1½-hours or ¾-hour and sprinklers [Table 716.1]	1½-hours or ¾-hour and sprinklers [Table 717.1]	1 ½-hours or ¾-hour with sprinklers [Table 715.3]	NR	NR	NR	<b>(d)(j)(t)</b>
<b>Automotive Shops</b>	2-hours or 1-hour and sprinklers [Table 302.1.1]	2-hours or 1-hour and sprinklers [Table 302.1.1]	1-hour or sprinklers [Table 302.1.1]	1-hour or sprinklers [Table 508.2]	1-hour or sprinklers [Table 508.2.5]	1-hour or sprinklers [Table 509]	<b>(b)(j)</b>
<b>Automotive Shop Opening Protectives</b>	1½-hours or ¾-hour with sprinklers [Table 716.1]	1½-hours or ¾-hour with sprinklers [Table 717.1]	¾-hour or sprinklers <sup>l</sup> [Table 715.3]	¾-hour or sprinklers [Table 715.4]	¾-hour or sprinklers [Table 715.4]	¾-hour or sprinklers [Table 716.5]	<b>(b)(d)(j)(t)</b>
<b>Boiler Rooms (&gt; 15 psi and 10 HP)</b>	1-hour or sprinklers [Table 302.1.1]	1-hour or sprinklers with smoke partitions [Table 302.1.1]	1-hour or sprinklers [Table 302.1.1]	1-hour or sprinklers [Table 508.2]	1-hour or sprinklers [Table 508.2.5]	1-hour or sprinklers [Table 509]	<b>(d)(j)</b>
<b>Boiler Room Opening Protectives<sup>(d)</sup> (&gt; 15 psi and 10 HP)</b>	¾-hour [Table 716.1]	¾-hour [Table 717.1]	¾-hour or sprinklers [Table 715.3]	¾-hour or sprinklers [Table 715.4]	¾-hour or sprinklers [Table 715.4]	¾-hour or sprinklers [Table 716.5]	<b>(d)(t)</b>

Room or Area	BOCA 1993 (a)(e)	BOCA 1996 (a)(f)	ICC 2003 (a)(g)	ICC 2006 (a)(h)	ICC 2009 (a)(p)	ICC 2015 (a)(r)	Comments
<b>Part 180</b>	On or after 3/24/95 but before 7/6/98	On or after 7/6/98 but before 10/3/05	On or after 10/3/05 but before 9/25/07	On or after 9/25/07 but before 1/1/10	On or after 1/1/10 but before 7/1/16	On or after 7/1/16	
<b>Boiler Room (other)</b>	1-hour or sprinklers [Table 302.1.1]	1-hour or sprinklers with smoke partitions [Table 302.1.1]	NR	NR	NR	NR	<b>(d)(j)</b>
<b>Boiler Room (other) Opening Protectives</b>	¾-hour [Table 716.1]	¾-hour [Table 717.1]	NR	NR	NR	NR	<b>(d)(t)</b>
<b>Cafeteria (as assembly)</b>	2-hours or 1-hour with sprinklers [Table 313.1.2]	2-hours or 1-hour with sprinklers [Table 313.1.2]	2-hours or 1-hour with sprinklers [Table 302.3.2]	NR	NR	NR	<b>(j)</b>
<b>Cafeteria Opening Protectives (as assembly)</b>	1½-hours or ¾-hour with sprinklers [Table 716.1]	1½-hours or ¾-hour with sprinklers [Table 717.1]	1 ½-hours or ¾-hour with sprinklers [Table 715.3]	NR	NR	NR	<b>(d)(j)(t)</b>
<b>Closets</b>	Sprinklers and smoke partitions [Table 302.1.1]	Sprinklers and smoke partitions [Table 302.1.1]	1-hour or sprinklers [Table 302.1.1]	1-hour or sprinklers [Table 508.2]	NR if does not occupy > 10% of the building area of the story in which they are located or is not > tabular value in Table 503 [508.2.1] [508.2.4]	NR if does not occupy > 10% of the building area of the story in which they are located or is not > tabular value in Table 504 [509]	If > 10% or 503 then 1 hour or sprinklers <b>(j)</b>

Room or Area	BOCA 1993 (a)(e)	BOCA 1996 (a)(f)	ICC 2003 (a)(g)	ICC 2006 (a)(h)	ICC 2009 (a)(p)	ICC 2015 (a)(r)	Comments
<b>Part 180</b>	On or after 3/24/95 but before 7/6/98	On or after 7/6/98 but before 10/3/05	On or after 10/3/05 but before 9/25/07	On or after 9/25/07 but before 1/1/10	On or after 1/1/10 but before 7/1/16	On or after 7/1/16	
<b>Closets Opening Protectives</b>	Prevent the spread of smoke [Table 302.1.1]	Prevent the spread of smoke [Table 302.1.1]	$\frac{3}{4}$ -hour [Table 715.3]	$\frac{3}{4}$ -hour [Table 715.3]	NR (see above)	NR (see above)	If > 10% or 503 then $\frac{3}{4}$ -hour or sprinklers [Table 715.4] <b>(d)(j)(t)</b>
<b>Corridors</b>	1-hour or sprinklers [Table 1011.4]	1-hour or sprinklers [Table 1011.4]	1-hour or sprinklers [Table 1016.1]	1-hour or sprinklers [Table 1017.1]	1-hour or sprinklers [Table 1018.1]	1-hour or sprinklers [Table 1020.1]	Except for room requiring a higher fire-rated enclosure <b>(j)</b>
<b>Corridor Opening Protectives</b>	$\frac{1}{3}$ -hour [Table 716.1]	$\frac{1}{3}$ -hour or sprinklers [Table 717.1]	$\frac{1}{3}$ -hour or sprinklers [Table 715.3]	$\frac{1}{3}$ -hour or sprinklers [Table 715.4]	$\frac{1}{3}$ -hour or sprinklers [Table 715.4]	$\frac{1}{3}$ -hour or sprinklers [Table 716.5]	Except for opening protective in a room adjacent to corridor requiring a higher fire-rated opening protective <b>(d)(j)(t)</b>

Room or Area	BOCA 1993 (a)(e)	BOCA 1996 (a)(f)	ICC 2003 (a)(g)	ICC 2006 (a)(h)	ICC 2009 (a)(p)	ICC 2015 (a)(r)	Comments
<b>Part 180</b>	On or after 3/24/95 but before 7/6/98	On or after 7/6/98 but before 10/3/05	On or after 10/3/05 but before 9/25/07	On or after 9/25/07 but before 1/1/10	On or after 1/1/10 but before 7/1/16	On or after 7/1/16	
<b>Corridors in buildings with direct exterior exiting</b>	NR [1011.4(1)]	NR [1011.4(1)]	NR [1016.1(1)]	NR [1017.1(1)]	NR [1018.1]	NR [1020.1]	Every room that is used for instruction has at least one door directly to the exterior and assembly areas have $\geq \frac{1}{2}$ egress doors opening directly to outside
<b>Crawl Spaces used for combustible storage</b>	Sprinklers and smoke partitions [Table 302.1.1]	Sprinklers and smoke partitions [Table 302.1.1]	1-hour or sprinklers [413.2]	1-hour or sprinklers [413.2]	1-hour or sprinklers [413.2]	1-hour or sprinklers [413.2]	<b>(j)</b>
<b>Crawl Spaces used for combustible storage Opening Protectives</b>	Prevent the spread of smoke [Table 302.1.1]	Prevent the spread of smoke [Table 302.1.1]	1 $\frac{3}{4}$ " SC wood doors or N/C construction [413.2]	1 $\frac{3}{4}$ " SC wood doors or N/C construction [413.2]	1 $\frac{3}{4}$ " SC wood doors or N/C construction [413.2]	Self-closing 1 $\frac{3}{4}$ " SC wood doors or N/C construction [413.2]	<b>(d)(t)</b>

<b>Room or Area</b>	<b>BOCA 1993 (a)(e)</b>	<b>BOCA 1996 (a)(f)</b>	<b>ICC 2003 (a)(g)</b>	<b>ICC 2006 (a)(h)</b>	<b>ICC 2009 (a)(p)</b>	<b>ICC 2015 (a)(r)</b>	<b>Comments</b>
<b>Part 180</b>	<b>On or after 3/24/95 but before 7/6/98</b>	<b>On or after 7/6/98 but before 10/3/05</b>	<b>On or after 10/3/05 but before 9/25/07</b>	<b>On or after 9/25/07 but before 1/1/10</b>	<b>On or after 1/1/10 but before 7/1/16</b>	<b>On or after 7/1/16</b>	
<b>Electrical Equipment Rooms ≤ 600 volts</b>	NR	NR	NR	NR	NR	NR	Cannot be used for combustible storage and required clearances from electrical equipment must be maintained <b>(k)(l)(m)(n) (o)(s)</b>
<b>Electrical Equipment ≤ 600 volts Opening Protectives</b>	NR	NR	NR	NR	NR	NR	Doors must be kept locked <b>(d)(k)(l)(m)(n) (o)(s)(t)</b>
<b>Electrical Rooms &gt; 600 volts</b>	3-hours	3-hours	3-hours	3-hours	3-hours [NFPA 70 - Article 110.31(A)]	3-hours [NFPA 70 - Article 110.31(A)]	Cannot be used for combustible storage and required clearances from electrical equipment must be maintained <b>(k)(l)(m)(n) (o)(s)</b>

Room or Area	BOCA 1993 (a)(e)	BOCA 1996 (a)(f)	ICC 2003 (a)(g)	ICC 2006 (a)(h)	ICC 2009 (a)(p)	ICC 2015 (a)(r)	Comments
<b>Part 180</b>	On or after 3/24/95 but before 7/6/98	On or after 7/6/98 but before 10/3/05	On or after 10/3/05 but before 9/25/07	On or after 9/25/07 but before 1/1/10	On or after 1/1/10 but before 7/1/16	On or after 7/1/16	
<b>Electrical Rooms &gt; 600 volts Opening Protectives</b>	3-hours [Table 716.1]	3-hours [Table 717.1]	3-hours [Table 715.3]	3-hours [Table 715.4]	3-hours [Table 715.4]	3-hours [NFPA 70 - Article 110.31(A)]	Doors must be kept locked No glazing permitted <b>(d)(k)(l)(m)(n)(o)(s)(t)</b>
<b>Exit Passageways</b>	Equivalent to that of any connecting exit enclosure [1020.1]	Equivalent to that of any connecting exit enclosure [1020.1]	1-hour or equivalent to that of any connecting exit enclosure [1021.3]	1-hour or equivalent to that of any connecting exit enclosure [1021.3]	1-hour or equivalent to that of any connecting exit enclosure [1023.3]	1-hour or equivalent to that of any connecting exit enclosure [1024.3]	
<b>Exit Passageways Opening Protectives</b>	Equivalent to that of any connecting exit enclosure [1020.1]	Equivalent to that of any connecting exit enclosure [1020.1]	1-hour or equivalent to that of any connecting exit enclosure [Table 715.3]	1-hour or what is required for connecting exit enclosure [Table 715.4]	1-hour or what is required for connecting exit enclosure [Table 715.4]	1-hour or what is required for connecting exit enclosure [Table 716.5]	<b>(d)</b>
<b>Fire Escapes Opening Protectives</b>	Doors and windows along the fire escape $\frac{3}{4}$ -hour [1025.3.2]	Doors and windows along the fire escape $\frac{3}{4}$ -hour [1025.3.2]	Doors and windows along the fire escape $\frac{3}{4}$ -hour [3404.5]	Doors and windows along the fire escape $\frac{3}{4}$ -hour [3404.5]	Doors and windows along the fire escape $\frac{3}{4}$ -hour [3406.5]	Doors and windows along the fire escape $\frac{3}{4}$ -hour [1104.16.2]	
<b>Fire Walls</b>	2-hours [Table 707.1]	2-hours [707.1]	3-hours [Table 705.4]	3-hours [Table 705.4]	3-hours [Table 706.4]	3-hours [Table 706.4]	

Room or Area	BOCA 1993 (a)(e)	BOCA 1996 (a)(f)	ICC 2003 (a)(g)	ICC 2006 (a)(h)	ICC 2009 (a)(p)	ICC 2015 (a)(r)	Comments
<b>Part 180</b>	<b>On or after 3/24/95 but before 7/6/98</b>	<b>On or after 7/6/98 but before 10/3/05</b>	<b>On or after 10/3/05 but before 9/25/07</b>	<b>On or after 9/25/07 but before 1/1/10</b>	<b>On or after 1/1/10 but before 7/1/16</b>	<b>On or after 7/1/16</b>	
<b>Fire Wall Doors</b>	1½-hours [Table 716.1]	1½-hours [717.1]	3-hours [Table 715.3]	3-hours [Table 715.4]	3-hours [Table 715.4]	3-hours [Table 716.5]	<b>(d)(t)</b>
<b>Flammable Paint and Flammable Liquid Storage Rooms</b>	4-hours [Table 313.1.2]	4-hours [Table 313.1.2]	4-hours [Table 302.3.2]	4-hours or 3-hours with sprinklers [Table 508.3.3]	4-hours or 3-hours with sprinklers [Table 508.3.3]	4-hours or 3-hours with sprinklers [Table 508.3.3]	See International Fire Code or BOCA Fire Prevention Code for other protection requirements <b>(b)(j)</b>
<b>Flammable Paint and Flammable Liquid Storage Rooms Opening Protectives</b>	3-hours [Table 716.1]	3-hours [Table 717.1]	3-hours [Table 715.3]	3-hours [Table 715.4]	3-hours [Table 715.4]	3-hours [Table 715.4]	No glazing permitted in 3 hour doors <b>(j)(t)</b>
<b>Furnace Room</b>	1-hour or sprinklers [Table 302.1.1]	1-hour or sprinklers with smoke partition [Table 302.1.1]	NR	NR	NR	NR	<b>(j)</b>
<b>Furnace Room Opening Protectives</b>	¾-hour or sprinklers [Table 716.1]	¾-hour or sprinklers with smoke partition [Table 717.1]	NR	NR	NR	NR	<b>(d)(j)(t)</b>

<b>Room or Area</b>	<b>BOCA 1993 (a)(e)</b>	<b>BOCA 1996 (a)(f)</b>	<b>ICC 2003 (a)(g)</b>	<b>ICC 2006 (a)(h)</b>	<b>ICC 2009 (a)(p)</b>	<b>ICC 2015 (a)(r)</b>	<b>Comments</b>
<b>Part 180</b>	<b>On or after 3/24/95 but before 7/6/98</b>	<b>On or after 7/6/98 but before 10/3/05</b>	<b>On or after 10/3/05 but before 9/25/07</b>	<b>On or after 9/25/07 but before 1/1/10</b>	<b>On or after 1/1/10 but before 7/1/16</b>	<b>On or after 7/1/16</b>	
<b>Furnace Room – (&gt; 400,000 Btu per hour input)</b>	1-hour or sprinklers [Table 302.1.1]	1-hour or sprinklers with smoke partitions [Table 302.1.1]	1-hour or sprinklers [Table 302.1.1]	1-hour or sprinklers [Table 508.2]	1-hour or sprinklers [Table 508.2.5]	1-hour or sprinklers [Table 509]	<b>(j)</b>
<b>Furnace Room (&gt; 400,000 Btu per hour input) Opening Protectives</b>	¾-hour or sprinklers [Table 716.1]	¾-hour or sprinklers with smoke partitions [Table 716.1]	¾-hour or sprinklers [Table 715.3]	¾-hour or sprinklers [Table 715.4]	¾-hour or sprinklers [Table 715.4]	¾-hour or sprinklers [Table 716.5]	<b>(d)(j)(t)</b>
<b>Greenhouses</b>	NR	NR	1-hour [Table 302.3.2]	1-hour or sprinklers [Table 508.3.3]	1-hour or sprinklers [Table 508.4]	1-hour or sprinklers [Table 509]	
<b>Greenhouse Opening Protectives</b>	NR	NR	¾-hour [Table 715.3]	½-hour or sprinklers [Table 715.4]	½-hour or sprinklers [Table 715.4]	½-hour or sprinklers [Table 716.5]	<b>(d)(t)</b>
<b>Gym/Multipurpose Room</b>	2-hours, 1-hour and sprinklers [Table 313.1.2]	2-hours, 1-hour and sprinklers [Table 313.1.2]	2-hours or 1-hour with sprinklers [Table 302.3.2]	NR	NR	NR	<b>(j)</b>
<b>Gym/Multipurpose Room Opening Protectives</b>	1½-hours or ¾-hour and sprinklers [Table 716.1]	1½-hours or ¾-hour and sprinklers [Table 717.1]	1 ½-hours or ¾-hour with sprinklers [Table 715.3]	NR	NR	NR	<b>(d)(j)(t)</b>



Room or Area	BOCA 1993 (a)(e)	BOCA 1996 (a)(f)	ICC 2003 (a)(g)	ICC 2006 (a)(h)	ICC 2009 (a)(p)	ICC 2015 (a)(r)	Comments
<b>Part 180</b>	On or after 3/24/95 but before 7/6/98	On or after 7/6/98 but before 10/3/05	On or after 10/3/05 but before 9/25/07	On or after 9/25/07 but before 1/1/10	On or after 1/1/10 but before 7/1/16	On or after 7/1/16	
<b>Home Economics</b>	NR	NR	1-hour or sprinklers [Table 302.1.1]	1-hour or sprinklers [Table 508.2]	1-hour or sprinklers [Table 508.2.5]	1-hour or sprinklers [Table 509]	<b>(j)</b>
<b>Home Economics Room Opening Protectives</b>	NR	NR	¾-hour or sprinklers [Table 715.3]	¾-hour or sprinklers [Table 715.4]	¾-hour or sprinklers [Table 715.4]	¾-hour or sprinklers [Table 716.5]	<b>(d)(j)(t)</b>
<b>Horizontal Exits</b>	2-hours [1019.2]	2-hours [1019.2]	2-hours [1021.2]	2-hours [1022.2]	2-hours [1025]	2-hours [1026]	
<b>Horizontal Exit Doors</b>	1½-hours [Table 716.1]	1½-hours [717.1]	1½-hours [Table 715.3]	1½-hours [Table 715.4]	1½-hours [Table 715.4]	1½-hours [Table 716.5]	<b>ICC only:</b> When used as cross-corridor doors, doors shall be automatic closing by activation of a smoke detector installed in accordance with appropriate section of applicable code
<b>Incinerator Rooms</b>	2-hours and sprinklers [Table 302.1.1]	2-hours and sprinklers [Table 302.1.1]	2-hours and sprinklers [Table 302.1.1]	2-hours and sprinklers [Table 508.2]	2-hours and sprinklers [Table 508.2.5]	2-hours and sprinklers [Table 509]	<b>(j)</b>

Room or Area	BOCA 1993 (a)(e)	BOCA 1996 (a)(f)	ICC 2003 (a)(g)	ICC 2006 (a)(h)	ICC 2009 (a)(p)	ICC 2015 (a)(r)	Comments
<b>Part 180</b>	On or after 3/24/95 but before 7/6/98	On or after 7/6/98 but before 10/3/05	On or after 10/3/05 but before 9/25/07	On or after 9/25/07 but before 1/1/10	On or after 1/1/10 but before 7/1/16	On or after 7/1/16	
<b>Incinerator Room Opening Protectives</b>	1 ½-hours [Table 716.1]	1 ½-hours [Table 716.1]	1½-hour [Table 715.3]	1½-hours [Table 715.4]	1½-hours [Table 715.4]	1½-hours [Table 716.5]	<b>(d)(t)</b>
<b>Industrial Technology and Metal Working Shops</b>	2-hours or 1-hour and sprinklers [Table 313.1.2]	2-hours or 1-hour and sprinklers [Table 302.1.1]	1-hour or sprinklers [Table 302.1.1]	1-hour or sprinklers [Table 508.2]	1-hour or sprinklers [Table 508.2.5]	1-hour or sprinklers [Table 509]	<b>(b)(j)</b>
<b>Industrial Technology and Metal Working Shops Opening Protectives</b>	1½-hours or ¾-hour with sprinklers [Table 717.1]	1½-hours or ¾-hour with sprinklers [Table 717.1]	¾-hour or sprinklers [Table 715.3]	¾-hour or sprinklers [Table 715.4]	¾-hour or sprinklers [Table 715.4]	¾-hour or sprinklers [Table 716.5]	<b>(b)(d)(j)(t)</b>
<b>Janitor's Closets &gt; 100ft²</b>	Sprinklers and smoke partitions [Table 302.1.1]	Sprinklers and smoke partitions [Table 302.1.1]	1-hour or sprinklers [Table 302.1.1]	1-hour or sprinklers [Table 508.2]	NR if does not occupy > 10% of the building area of the story in which they are located or is not > tabular value in Table 503	NR if does not occupy > 10% of the building area of the story in which they are located or is not > tabular value in Table 504 [509]	If > 10% or 503 then 1 hour or sprinklers <b>(j)</b>

<b>Room or Area</b>	<b>BOCA 1993 (a)(e)</b>	<b>BOCA 1996 (a)(f)</b>	<b>ICC 2003 (a)(g)</b>	<b>ICC 2006 (a)(h)</b>	<b>ICC 2009 (a)(p)</b>	<b>ICC 2015 (a)(r)</b>	<b>Comments</b>
<b>Part 180</b>	<b>On or after 3/24/95 but before 7/6/98</b>	<b>On or after 7/6/98 but before 10/3/05</b>	<b>On or after 10/3/05 but before 9/25/07</b>	<b>On or after 9/25/07 but before 1/1/10</b>	<b>On or after 1/1/10 but before 7/1/16</b>	<b>On or after 7/1/16</b>	
<b>Janitor's Closet &gt; 100 ft<sup>2</sup> Opening Protectives</b>	Prevent the spread of smoke [Table 302.1.1]	Prevent the spread of smoke [Table 302.1.1]	$\frac{3}{4}$ -hour or sprinklers [Table 715.3]	$\frac{3}{4}$ -hour or sprinklers	(see above)	(see above)	If > 10% $\frac{3}{4}$ -hour or sprinklers [Table 715.4] <b>(d)(j)(t)</b>
<b>Janitor's Closets &gt; 50 ft<sup>2</sup> but <math>\leq</math> 100 ft<sup>2</sup></b>	1-hour or sprinklers and smoke partitions [Table 302.1.1]	1-hour or sprinklers and smoke partitions [Table 302.1.1]	NR	NR	NR if does not occupy > 10% of the building area of the story in which they are located or is not > tabular value in Table 503	NR if does not occupy > 10% of the building area of the story in which they are located or is not > tabular value in Table 504. [509]	If > 10% or 503 then 1 hour or sprinklers <b>(j)</b>
<b>Janitor's Closets &gt; 50 ft<sup>2</sup> but <math>\leq</math> 100 ft<sup>2</sup> Opening Protectives</b>	$\frac{3}{4}$ -hour or with sprinklers prevent the spread of smoke [Table 302.1.1] [Table 716.1]	$\frac{3}{4}$ -hour or with sprinklers prevent the spread of smoke [Table 302.1.1] [Table 717.1]	NR	NR	(see above)	(see above)	If > 10% $\frac{3}{4}$ -hour or sprinklers [Table 715.4] <b>(d)(j)(t)</b>
<b>Kitchens (not home economics kitchens)</b>	NR	NR	NR [Table 302.3.2]	NR [Table 508.3.3]	NR [Table 508.4]	NR [Table 508.4] [303.3]	

Room or Area	BOCA 1993 (a)(e)	BOCA 1996 (a)(f)	ICC 2003 (a)(g)	ICC 2006 (a)(h)	ICC 2009 (a)(p)	ICC 2015 (a)(r)	Comments
<b>Part 180</b>	On or after 3/24/95 but before 7/6/98	On or after 7/6/98 but before 10/3/05	On or after 10/3/05 but before 9/25/07	On or after 9/25/07 but before 1/1/10	On or after 1/1/10 but before 7/1/16	On or after 7/1/16	
<b>Kitchen Opening Protectives</b>	NR	NR	NR [Table 302.3.2]	NR [Table 508.3.3]	NR [Table 508.4]	NR [Table 508.4] [303.3]	
<b>Laundry Room &gt; 100 ft<sup>2</sup></b>	1-hour and sprinklers [Table 302.1.1]	1-hour and sprinklers [Table 302.1.1]	1-hour or sprinklers [Table 302.1.1]	1-hour or sprinklers [Table 508.2]	1-hour or sprinklers [Table 508.2.5]	1-hour or sprinklers [Table 509]	Does not apply to a domestic washer and dryer in a home economics room <b>(j)</b>
<b>Laundry Room &gt; 100 ft<sup>2</sup> Opening Protectives</b>	$\frac{3}{4}$ -hour [Table 716.1]	$\frac{3}{4}$ -hour [Table 717.1]	$\frac{3}{4}$ -hour or sprinklers [Table 715.3]	$\frac{3}{4}$ -hour or sprinklers [Table 715.4]	$\frac{3}{4}$ -hour or sprinklers [Table 715.4]	$\frac{3}{4}$ -hour or sprinklers [Table 716.5]	<b>(d)(j)(t)</b>
<b>Libraries/Learning Resource Centers (if assembly)</b>	2-hours, 1-hour and sprinklers [Table 313.1.2]	2-hours, 1-hour and sprinklers [Table 313.1.2]	2-hours or 1-hour with sprinklers [Table 302.3.2]	NR	NR	NR	<b>(j)</b>
<b>Libraries/Learning and Resource Centers Opening Protectives (if assembly)</b>	1½-hours or $\frac{3}{4}$ -hour and sprinklers [Table 716.1]	1½-hours or $\frac{3}{4}$ -hour and sprinklers [Table 717.1]	1½-hours or $\frac{3}{4}$ -hour with sprinklers [Table 715.3]	NR	NR	NR	<b>(d)(j)(t)</b>

<b>Room or Area</b>	<b>BOCA 1993 (a)(e)</b>	<b>BOCA 1996 (a)(f)</b>	<b>ICC 2003 (a)(g)</b>	<b>ICC 2006 (a)(h)</b>	<b>ICC 2009 (a)(p)</b>	<b>ICC 2015 (a)(r)</b>	<b>Comments</b>
<b>Part 180</b>	<b>On or after 3/24/95 but before 7/6/98</b>	<b>On or after 7/6/98 but before 10/3/05</b>	<b>On or after 10/3/05 but before 9/25/07</b>	<b>On or after 9/25/07 but before 1/1/10</b>	<b>On or after 1/1/10 but before 7/1/16</b>	<b>On or after 7/1/16</b>	
<b>Maintenance Shop</b>	2-hours or 1-hour with sprinklers [Table 302.1.1]	2-hours or 1-hour with sprinklers [Table 302.1.1]	1-hour or sprinklers [Table 302.1.1]	1-hour or sprinklers [Table 508.2]	1-hour or sprinklers [Table 508.2.5]	1-hour or sprinklers [Table 509]	<b>(j)</b>
<b>Maintenance Shop Opening Protectives</b>	1 ½-hours or ¾-hour with sprinklers [Table 716.1]	1 ½-hours or ¾-hour with sprinklers [Table 717.1]	¾-hour or sprinklers [Table 715.3]	¾-hour or sprinklers [Table 715.4]	¾-hour or sprinklers [Table 715.4]	¾-hour or sprinklers [Table 716.5]	<b>(d)(j)(t)</b>
<b>Open Plan Areas (Limiting Walls)</b>	NR	NR	NR	NR	NR	NR	
<b>Open Plan Area Opening Protectives</b>	NR	NR	NR	NR	NR	NR	
<b>Painting and Finishing</b>	2-hours, or 1-hour and sprinklers [Table 302.1.1]	2-hours, or 1-hour and sprinklers [Table 302.1.1]	2-hours, or 1-hour and sprinklers [Table 302.1.1]	2-hours; or 1-hour and sprinklers [Table 508.2]	2-hours; or 1-hour and sprinklers [Table 508.2.5]	2-hours; or 1-hour and sprinklers [Table 509]	<b>(b)(j)</b>
<b>Painting and Finishing Opening Protectives</b>	1½-hours, or ¾-hour with sprinklers [Table 716.1]	1½-hours, or ¾-hour with sprinklers [Table 716.1]	1½-hours, or ¾-hour with sprinklers [Table 715.3]	1½-hours, or ¾-hour with sprinklers [Table 715.4]	1½-hours, or ¾-hour with sprinklers [Table 715.4]	1½-hours, or ¾-hour with sprinklers [Table 716.5]	<b>(b)(d)(j)(t)</b>

Room or Area	BOCA 1993 (a)(e)	BOCA 1996 (a)(f)	ICC 2003 (a)(g)	ICC 2006 (a)(h)	ICC 2009 (a)(p)	ICC 2015 (a)(r)	Comments
<b>Part 180</b>	On or after 3/24/95 but before 7/6/98	On or after 7/6/98 but before 10/3/05	On or after 10/3/05 but before 9/25/07	On or after 9/25/07 but before 1/1/10	On or after 1/1/10 but before 7/1/16	On or after 7/1/16	
<b>Photo Developing Rooms</b>	NR	NR	NR	NR	NR	NR	
<b>Photo Developing Room Opening Protectives</b>	NR	NR	NR	NR	NR	NR	
<b>Projection Rooms</b>	Permanent construction consistent with the construction requirements for the building in which the room is located [411.2]	Permanent construction consistent with the construction requirements for the building in which the room is located [411.2]	Permanent construction consistent with the construction requirements for the building in which the room is located [409.2]	Permanent construction consistent with the construction requirements for the building in which the room is located [409.2]	Permanent construction consistent with the construction requirements for the building in which the room is located [409.2]	Permanent construction consistent with the construction requirements for the building in which the room is located [409.2]	Does not apply to lighting and sound booths. Applies to rooms in which safety film is utilized in conjunction with electric arc, xenon or other light-source projection equipment that develops hazardous gasses, dust or radiation. <b>(c)</b>

Room or Area	BOCA 1993 (a)(e)	BOCA 1996 (a)(f)	ICC 2003 (a)(g)	ICC 2006 (a)(h)	ICC 2009 (a)(p)	ICC 2015 (a)(r)	Comments
<b>Part 180</b>	On or after 3/24/95 but before 7/6/98	On or after 7/6/98 but before 10/3/05	On or after 10/3/05 but before 9/25/07	On or after 9/25/07 but before 1/1/10	On or after 1/1/10 but before 7/1/16	On or after 7/1/16	
<b>Projection Rooms Opening Protectives</b>	NR	NR	NR	NR	NR	NR	<b>(c)(t)</b>
<b>Science Labs</b>	NR	NR	1-hour or sprinklers [Table 302.1.1]	1-hour or sprinklers [Table 508.2]	1-hour or sprinklers [Table 508.2.5]	1-hour or sprinklers [Table 509]	<b>(b)(j)</b>
<b>Science Lab Opening Protectives</b>	NR	NR	¾-hour or sprinklers [Table 715.3]	¾-hour or sprinklers [Table 715.4]	¾-hour or sprinklers [Table 715.4]	¾-hour or sprinklers [Table 716.5]	<b>(b)(d)(j)</b>
<b>Stage, Legitimate<sup>q</sup> Proscenium Wall</b>	2-hours and sprinklers [412.3.5] [412.6]	N/A	N/A	N/A	N/A	N/A	
<b>Stage Legitimate<sup>q</sup> Proscenium Wall Opening Protectives</b>	1½-hours [Table 716.1]	N/A	N/A	N/A	N/A	N/A	Only openings permitted in proscenium are the stage opening and 1 door on each side of the stage at stage level and one opening into musician's pit. Proscenium curtain required at the stage proscenium opening. <b>(d)(t)</b>

Room or Area	BOCA 1993 (a)(e)	BOCA 1996 (a)(f)	ICC 2003 (a)(g)	ICC 2006 (a)(h)	ICC 2009 (a)(p)	ICC 2015 (a)(r)	Comments
<b>Part 180</b>	<b>On or after 3/24/95 but before 7/6/98</b>	<b>On or after 7/6/98 but before 10/3/05</b>	<b>On or after 10/3/05 but before 9/25/07</b>	<b>On or after 9/25/07 but before 1/1/10</b>	<b>On or after 1/1/10 but before 7/1/16</b>	<b>On or after 7/1/16</b>	
<b>Stage, Legitimate<sup>q</sup> Accessory Areas</b>	Sprinklers and separated from stage by 1-hour fire-rated constr. Accessory areas must be separated by 1-hour from each other [412.5.1] [412.6]	N/A	N/A	N/A	N/A	N/A	Stage separation from accessory areas is not required when stage is ≤ 500 ft <sup>2</sup>
<b>Stage, Legitimate<sup>q</sup> Accessory Areas Opening Protectives</b>	$\frac{3}{4}$ -hour [Table 716.1]	N/A	N/A	N/A	N/A	N/A	Cannot connect with the stage <b>(d)(t)</b>
<b>Stage, Height is &gt; 50 ft. Proscenium Wall</b>	N/A	2-hours and sprinklers [412.3.5] [412.6]	2-hours and sprinklers [410.3.4] [410.6]	2-hours and sprinklers [410.3.4] [410.6]	2-hours and sprinklers [410.3.4] [410.6]	2-hours and sprinklers [410.3.4] [410.7]	For exceptions to sprinkler requirements see: <b>(i)</b>



Room or Area	BOCA 1993 (a)(e)	BOCA 1996 (a)(f)	ICC 2003 (a)(g)	ICC 2006 (a)(h)	ICC 2009 (a)(p)	ICC 2015 (a)(r)	Comments
<b>Part 180</b>	On or after 3/24/95 but before 7/6/98	On or after 7/6/98 but before 10/3/05	On or after 10/3/05 but before 9/25/07	On or after 9/25/07 but before 1/1/10	On or after 1/1/10 but before 7/1/16	On or after 7/1/16	
<b>Stage Height is &gt; 50 ft. Proscenium Wall Opening Protectives</b>	N/A	1½-hours [Table 717.1]	1½-hours [Table 715.3]	1½-hours [Table 715.4]	1½-hours [Table 715.4]	1½-hours [Table 716.5]	<b>1996 stages only:</b> Only openings permitted in proscenium are the stage opening and 1 door on each side of the stage at stage level and one opening into musician's pit. <b>All stages:</b> Proscenium curtain required at the stage proscenium opening. <b>(d)(t)</b>
<b>Stage Height is &gt; 50 ft. Accessory Areas</b>	N/A	Stage must be separated from accessory areas by 2-hours and sprinklers [412.5.1] [412.6]	Stage must be separated from accessory areas by 2-hours and sprinklers [410.5.1] [410.6]	Stage must be separated from accessory areas by 2-hours and sprinklers [410.5.1] [410.6]	Stages must be separated from accessory areas by 2-hours and sprinklers [410.5.1] [410.6]	Stages must be separated from accessory areas by 2-hours and sprinklers [410.5.1] [410.6]	Accessory rooms must be separated from each other by 1-hour [410.5.2] <b>1996</b> [412.5.2]

Room or Area	BOCA 1993 (a)(e)	BOCA 1996 (a)(f)	ICC 2003 (a)(g)	ICC 2006 (a)(h)	ICC 2009 (a)(p)	ICC 2015 (a)(r)	Comments
<b>Part 180</b>	On or after 3/24/95 but before 7/6/98	On or after 7/6/98 but before 10/3/05	On or after 10/3/05 but before 9/25/07	On or after 9/25/07 but before 1/1/10	On or after 1/1/10 but before 7/1/16	On or after 7/1/16	
<b>Stage Height is &gt; 50 ft. Accessory Areas Opening Protectives</b>	N/A	1½-hours [715.3]	1½-hours [Table 715.3]	1½-hours [Table 715.4]	1½-hours [Table 715.4]	1½-hours [Table 715.4]	¾-hour for opening protectives between accessory areas <b>(d)(t)</b>
<b>Stage Height is ≤ 50 ft. Proscenium Wall</b>	NR for proscenium wall separation. Sprinklers required [412.6]	NR for proscenium wall separation. Sprinklers required [412.6]	NR for proscenium wall separation. Sprinklers required [410.6]	NR for proscenium wall separation. Sprinklers required [410.6]	NR for proscenium wall separation. Sprinklers required [410.6]	NR for proscenium wall separation. Sprinklers required [410.7]	For exceptions to sprinkler requirements see: <b>(i)</b>
<b>Stage Height is ≤ 50 ft. (Accessory Areas)</b>	Stage must be separated from accessory areas by 1-hour except NR when stage floor area is < 500 ft² [412.5.1][412.6]	Stage must be separated from accessory areas by 1-hour and sprinklers [412.5.1] [412.6]	Stage must be separated from accessory areas by 1-hour and sprinklers [410.5.1] [410.6]	Stages must be separated from accessory areas by 1-hour and sprinklers [410.5.1] [410.6]	Stages must be separated from accessory areas by 1-hour and sprinklers [410.5.1] [410.6]	Stages must be separated from accessory areas by 1-hour and sprinklers [410.5.1] [410.7]	Accessory areas must be separated from each other by 1-hour [410.5.2] <b>93/96</b> [412.5.2] For exceptions to sprinkler requirements see: <b>(i)</b>

Room or Area	BOCA 1993 (a)(e)	BOCA 1996 (a)(f)	ICC 2003 (a)(g)	ICC 2006 (a)(h)	ICC 2009 (a)(p)	ICC 2015 (a)(r)	Comments
<b>Part 180</b>	On or after 3/24/95 but before 7/6/98	On or after 7/6/98 but before 10/3/05	On or after 10/3/05 but before 9/25/07	On or after 9/25/07 but before 1/1/10	On or after 1/1/10 but before 7/1/16	On or after 7/1/16	
<b>Stage Height ≤ 50 ft. Accessory Areas Opening Protectives</b>	¾-hour except NR when stage floor area is < 500 ft² [Table 716.1]	¾-hour [Table 717.1]	¾-hour [Table 715.3]	¾-hour [Table 715.4]	¾-hour [Table 715.4]	¾-hour [Table 716.5]	¾-hour for opening protectives between accessory areas <b>(d)(t)</b>
<b>Stages w/Storage Underneath ≥ 4 ft. in height</b>	Sprinklers required if stage is required to be sprinklered [412.6]	Sprinklers required if stage is required to be sprinklered [412.6] <b>(i)</b>	When used for combustible storage must be separated from adjacent areas by 1-hour [IFC 315.2.4] Sprinklers required if stage is required to be sprinklered [410.6] <b>(i)</b>	When used for combustible storage must be separated from adjacent areas by 1-hour [IFC 315.2.4] Sprinklers required if stage is required to be sprinklered [410.6] <b>(i)</b>	When used for combustible storage must be separated from adjacent areas by 1-hour [IFC 315.2.4] Sprinklers required if stage is required to be sprinklered [410.6] <b>(i)</b>	When used for combustible storage must be separated from adjacent areas by 1-hour [IFC 315.3.4] Sprinklers required if stage is required to be sprinklered [410.7] <b>(i)</b>	
<b>Stages w/Storage Underneath ≥ 4 ft. Opening Protectives</b>	NR	NR	Self-closing 1¾" SC wood doors or N/C construction [IFC 315.2.4]	Self-closing 1¾" SC wood doors or N/C construction [IFC 315.2.4]	Self-closing 1¾" SC wood doors or N/C construction [IFC 315.2.4]	Self-closing 1¾" SC wood doors or N/C construction [IFC 315.3.4]	

Room or Area	BOCA 1993 (a)(e)	BOCA 1996 (a)(f)	ICC 2003 (a)(g)	ICC 2006 (a)(h)	ICC 2009 (a)(p)	ICC 2015 (a)(r)	Comments
<b>Part 180</b>	<b>On or after 3/24/95 but before 7/6/98</b>	<b>On or after 7/6/98 but before 10/3/05</b>	<b>On or after 10/3/05 but before 9/25/07</b>	<b>On or after 9/25/07 but before 1/1/10</b>	<b>On or after 1/1/10 but before 7/1/16</b>	<b>On or after 7/1/16</b>	
<b>Stages w/Storage Underneath &lt; 4 ft.</b>	Sprinklers required except when the stage and supporting construction is 1-hour fire-rated construction [412.6(4)]	Sprinklers required unless area is utilized exclusively for storage of tables and chairs and the concealed space is separated from the adjacent spaces by not less than 5/8-inch Type X gypsum board [412.6(1)]	When used for combustible storage must be separated from adjacent areas by 1-hour [IFC 315.2.4] Sprinklers are required unless area is utilized exclusively for storage of tables and chairs and the concealed space is separated from the adjacent spaces by not less than 5/8-inch Type X gypsum board [410.6(1)]	When used for combustible storage must be separated from adjacent areas by 1-hour [IFC 315.2.4] Sprinklers are required unless area is utilized exclusively for storage of tables and chairs and the concealed space is separated from the adjacent spaces by not less than 5/8-inch Type X gypsum board [410.6(1)]	When used for combustible storage must be separated from adjacent areas by 1-hour [IFC 315.2.4] Sprinklers are required unless area is utilized exclusively for storage of tables and chairs and the concealed space is separated from the adjacent spaces by not less than 5/8-inch Type X gypsum board [410.6(1)]	When used for combustible storage must be separated from adjacent areas by 1-hour [IFC 315.3.4] Sprinklers are required unless area is utilized exclusively for storage of tables and chairs and the concealed space is separated from the adjacent spaces by not less than 5/8-inch Type X gypsum board [410.7(1)]	
<b>Stages w/Storage Underneath &lt; 4 ft. Opening Protectives</b>	NR	NR	Self-closing 1 3/4" SC wood doors or N/C construction [IFC 315.2.4]	Self-closing 1 3/4" SC wood doors or N/C construction [IFC 315.2.4]	Self-closing 1 3/4" SC wood doors or N/C construction [IFC 315.2.4]	Self-closing 1 3/4" SC wood doors or N/C construction [IFC 315.3.4]	
<b>Stairs ≤ 3 stories</b>	1-hour [1014.11]	1-hour [1014.11]	1-hour [1019.1]	1-hour [1021.1]	1-hour [1022.1]	1-hour [1023]	

Room or Area	BOCA 1993 (a)(e)	BOCA 1996 (a)(f)	ICC 2003 (a)(g)	ICC 2006 (a)(h)	ICC 2009 (a)(p)	ICC 2015 (a)(r)	Comments
<b>Part 180</b>	On or after 3/24/95 but before 7/6/98	On or after 7/6/98 but before 10/3/05	On or after 10/3/05 but before 9/25/07	On or after 9/25/07 but before 1/1/10	On or after 1/1/10 but before 7/1/16	On or after 7/1/16	
<b>Stairs ≤ 3 stories Opening Protectives</b>	1-hour [Table 716.1]	1-hour [Table 716.1]	1-hour [Table 715.3]	1-hour [Table 715.4]	1-hour [Table 715.4]	1-hour [Table 716.5]	<b>(d)(t)</b>
<b>Stairs ≥ 4 stories</b>	2-hours [1014.11]	2-hours [1014.11]	2-hour [1019.1]	2-hours [1020.1]	2-hours [1022.1]	2-hours [1023]	
<b>Stairs ≥ 4 stories Opening Protectives</b>	1½-hours [Table 716.1]	1½-hours [Table 716.1]	1½-hour [Table 715.3]	1½-hours [Table 715.4]	1½-hours [Table 715.4]	1½-hours [Table 716.5]	<b>(d)</b>
<b>Stairs with Storage Underneath</b>	NP	NP	2-hours or 1-hour depending upon enclosure requirement for stairway [1019.1.5]	2-hours or 1-hour depending upon enclosure requirement for stairway [1009.5.3]	2-hours or 1-hour depending upon enclosure requirement for stairway [1009.6.3]	2-hours or 1-hour depending upon enclosure requirement for stairway [1011.7.3]	
<b>Stairs with Storage Underneath Opening Protectives</b>	NP	NP	1½-hours or 1-hour depending upon enclosure requirement for stairway [1019.1.5] [715.3]	1½-hours or 1-hour depending upon enclosure requirement for stairway [1009.5.3] [715.4]	1 or 1½-hours depending upon enclosure requirement for stairway [1009.6.3] [Table 715.4]	1 or 1½-hours depending upon enclosure requirement for stairway [1009.6.3] [Table 716.5]	Access to storage area cannot be from within the stairway. <b>(d)(t)</b>

Room or Area	BOCA 1993 (a)(e)	BOCA 1996 (a)(f)	ICC 2003 (a)(g)	ICC 2006 (a)(h)	ICC 2009 (a)(p)	ICC 2015 (a)(r)	Comments
<b>Part 180</b>	On or after 3/24/95 but before 7/6/98	On or after 7/6/98 but before 10/3/05	On or after 10/3/05 but before 9/25/07	On or after 9/25/07 but before 1/1/10	On or after 1/1/10 but before 7/1/16	On or after 7/1/16	
<b>Storage Room &gt; 50 ft<sup>2</sup> but ≤ 100 ft<sup>2</sup></b>	1-hour or sprinklers [Table 302.1.1]	1-hour or sprinklers [Table 302.1.1]	NR	NR	NR if does not occupy > 10% of the building area of the story in which they are located or is not > tabular value in Table 503	NR if does not occupy > 10% of the building area of the story in which they are located or is not > tabular value in Table 504	If > 10% or 503 then 1 hour or sprinklers <b>(j)</b>
<b>Storage Room &gt; 50 ft<sup>2</sup> but ≤ 100 ft<sup>2</sup> Opening Protectives</b>	¾-hour or with sprinklers, prevent the spread of smoke [Table 302.1.1]	¾-hour or with sprinklers, prevent the spread of smoke [Table 302.1.1]	NR	NR	(see above)	(see above)	If > 10% ¾-hour or sprinklers [Table 715.4] <b>(d)(j)(t)</b>
<b>Storage Room &gt; 100ft<sup>2</sup></b>	Sprinklers and smoke partitions [Table 302.1.1]	Sprinklers and smoke partitions [Table 302.1.1]	1-hour or sprinklers [Table 302.1.1]	1-hour or sprinklers [Table 508.2]	NR if does not occupy > 10% of the building area of the story in which they are located or is not > tabular value in Table 503	NR if does not occupy > 10% of the building area of the story in which they are located or is not > tabular value in Table 504	If > 10% or 503 then 1 hour or sprinklers <b>(j)</b>

<b>Room or Area</b>	<b>BOCA 1993 (a)(e)</b>	<b>BOCA 1996 (a)(f)</b>	<b>ICC 2003 (a)(g)</b>	<b>ICC 2006 (a)(h)</b>	<b>ICC 2009 (a)(p)</b>	<b>ICC 2015 (a)(r)</b>	<b>Comments</b>
<b>Part 180</b>	<b>On or after 3/24/95 but before 7/6/98</b>	<b>On or after 7/6/98 but before 10/3/05</b>	<b>On or after 10/3/05 but before 9/25/07</b>	<b>On or after 9/25/07 but before 1/1/10</b>	<b>On or after 1/1/10 but before 7/1/16</b>	<b>On or after 7/1/16</b>	
<b>Storage Room &gt; 100ft<sup>2</sup> Opening Protectives</b>	Prevent spread of smoke [Table 302.1.1]	Prevent spread of smoke [Table 302.1.1]	¾-hour or sprinklers [Table 715.3]	¾-hour or sprinklers [Table 715.4]	(see above)	(see above)	If > 10% ¾-hour or sprinklers [Table 715.4] <b>(d)(j)(t)</b>
<b>Swimming Pools (Assembly Use)</b>	2-hours, 1-hour and sprinklers [Table 313.1.2]	2-hours, 1-hour and sprinklers <sup>(i)</sup> [Table 313.1.2]	2-hours or 1-hour with sprinklers [Table 302.3.2]	NR	NR	NR	<b>(j)</b>
<b>Swimming Pool Opening Protectives (Assembly Use)</b>	1½-hours or ¾-hour and sprinklers <sup>j</sup> [Table 716.1]	1½-hours or ¾-hour and sprinklers <sup>j</sup> [Table 716.1]	1 ½-hours or ¾-hour with sprinklers <sup>j</sup> [Table 715.3]	NR	NR	NR	<b>(d)(j)(t)</b>
<b>Teacher's Workrooms and Lounges (with cooking or heating appliances)</b>	NR	NR	1-hour or sprinklers [Table 302.1.1]	1-hour or sprinklers [Table 508.2]	1-hour or sprinklers [Table 508.2.5]	1-hour or sprinklers [Table 509]	<b>(j)</b>
<b>Teachers' Workrooms and Lounge (with cooking or heating appliances) Opening Protectives</b>	NR	NR	¾-hour or sprinklers [Table 715.3]	¾-hour or sprinklers [Table 715.4]	¾-hour or sprinklers [Table 715.4]	¾-hour or sprinklers [Table 716.5]	<b>(d)(j)(t)</b>

Room or Area	BOCA 1993 (a)(e)	BOCA 1996 (a)(f)	ICC 2003 (a)(g)	ICC 2006 (a)(h)	ICC 2009 (a)(p)	ICC 2015 (a)(r)	Comments
<b>Part 180</b>	On or after 3/24/95 but before 7/6/98	On or after 7/6/98 but before 10/3/05	On or after 10/3/05 but before 9/25/07	On or after 9/25/07 but before 1/1/10	On or after 1/1/10 but before 7/1/16	On or after 7/1/16	
<b>Trash and Laundry Chute <math>\leq 3</math> stories</b>	1-hour [710.3]	1-hour [710.3]	1-hour [707.4]	1-hour [707.13.1]	1-hour [708.13]	1-hour [713.4]	Sprinklers at top of chute and at alternate floor levels within chute and in the collection room
<b>Trash and Laundry Chute <math>\leq 3</math> stories Opening Protectives</b>	1-hour [Table 716.1]	1-hour [Table 717.1]	1-hour [715.3]	1-hour [Table 715.4]	1-hour [Table 715.4]	1-hour [Table 716.5]	These doors are not permitted to be located exit access corridors or in exit enclosures <b>(d)(t)</b>
<b>Trash and Laundry Chute <math>\geq 4</math> stories</b>	2-hours [710.3]	2-hours [710.3]	2-hours [707.4]	2-hours [707.13.1]	2-hours [708.13]	2-hours [713.13]	Sprinklers at top of chute and at alternate floor levels within chute and in the collection room



Room or Area	BOCA 1993 (a)(e)	BOCA 1996 (a)(f)	ICC 2003 (a)(g)	ICC 2006 (a)(h)	ICC 2009 (a)(p)	ICC 2015 (a)(r)	Comments
<b>Part 180</b>	On or after 3/24/95 but before 7/6/98	On or after 7/6/98 but before 10/3/05	On or after 10/3/05 but before 9/25/07	On or after 9/25/07 but before 1/1/10	On or after 1/1/10 but before 7/1/16	On or after 7/1/16	
Trash and Laundry Chute $\geq 4$ stories Opening Protectives	1 ½-hours [Table 716.1]	1 ½-hours [Table 717.1]	1½-hours [715.3]	1½-hours [Table 715.4]	1½-hours [Table 715.4]	1½-hours [Table 716.5]	These doors are not permitted to be located exit access corridors or in exit enclosures <b>(d)(t)</b>
Trash and Laundry Chute Access Rooms	1-hour [2807.3]	1-hour [2807.3]	1-hour [707.13.3]	1-hour [707.13.3]	1-hour [708.13.3]	1-hour [713.13.3]	
Trash and Laundry Chute Access Room Opening Protectives	¾-hour [Table 716.1]	¾-hour [Table 717.1]	¾-hour [707.13.3]	¾-hour [707.13.3]	¾-hour [Table 715.4]	¾-hour [Table 716.5]	<b>(d)(t)</b>
Trash and Laundry Collection Room > 100ft <sup>2</sup>	1-hour and sprinklers [2807.4]	1-hour and sprinklers [2807.4]	1-hour [707.13.4]	1-hour [707.13.4]	1-hour [708.13.4]	1-hour [708.13.4]	

Room or Area	BOCA 1993 (a)(e)	BOCA 1996 (a)(f)	ICC 2003 (a)(g)	ICC 2006 (a)(h)	ICC 2009 (a)(p)	ICC 2015 (a)(r)	Comments
<b>Part 180</b>	On or after 3/24/95 but before 7/6/98	On or after 7/6/98 but before 10/3/05	On or after 10/3/05 but before 9/25/07	On or after 9/25/07 but before 1/1/10	On or after 1/1/10 but before 7/1/16	On or after 7/1/16	
<b>Trash and Laundry Collection Room Opening Protectives</b>	$\frac{3}{4}$ -hour [Table 716.1]	$\frac{3}{4}$ -hour [Table 717.1]	$\frac{3}{4}$ -hour [707.13.4]	$\frac{3}{4}$ -hour [707.13.4]	$\frac{3}{4}$ -hour [Table 715.4]	$\frac{3}{4}$ -hour [Table 716.5]	Heat activated device for closing the opening protective between the shaft and the collection room is permitted <b>(d)(t)</b>
<b>Utility Tunnels used for combustible storage &gt; 100 ft<sup>2</sup></b>	Sprinklers and smoke partitions [Table 302.1.1]	Sprinklers and smoke partitions [Table 302.1.1]	1-hour or sprinklers [413.2]	1-hour or sprinklers [413.2]	1-hour or sprinklers [413.2]	1-hour or sprinklers [413.2]	<b>(j)</b>
<b>Utility Tunnels used for combustible storage &gt; 100 ft<sup>2</sup> Opening Protectives</b>	Prevent the spread of smoke [Table 302.1.1]	Prevent the spread of smoke [Table 302.1.1]	Self-closing 1 $\frac{3}{4}$ " SC wood doors or N/C construction [413.2]	Self-closing 1 $\frac{3}{4}$ " SC wood doors or N/C construction [413.2]	Self-closing 1 $\frac{3}{4}$ " SC wood doors or N/C construction [413.2]	Self-closing 1 $\frac{3}{4}$ " SC wood doors or N/C construction [413.2]	<b>(d)(t)</b>

Room or Area	BOCA 1993 (a)(e)	BOCA 1996 (a)(f)	ICC 2003 (a)(g)	ICC 2006 (a)(h)	ICC 2009 (a)(p)	ICC 2015 (a)(r)	Comments
<b>Part 180</b>	On or after 3/24/95 but before 7/6/98	On or after 7/6/98 but before 10/3/05	On or after 10/3/05 but before 9/25/07	On or after 9/25/07 but before 1/1/10	On or after 1/1/10 but before 7/1/16	On or after 7/1/16	
Utility Tunnels used for combustible storage > 50 ft <sup>2</sup> but ≤ 100 ft <sup>2</sup>	1-hour or sprinklers [Table 302.1.1]	1-hour or sprinklers [Table 302.1.1]	NR	NR	1-hour or sprinklers [413.2]	1-hour or sprinklers [413.2]	<b>(j)</b>
Utility Tunnels used for combustible storage > 50 ft <sup>2</sup> but ≤ 100 ft <sup>2</sup> Opening Protectives	¾-hour or with sprinklers prevent the spread of smoke [Table 302.1.1] [Table 716.1]	¾-hour or with sprinklers prevent the spread of smoke [Table 302.1.1] [Table 717.1]	NR	NR	Self-closing 1¾" SC wood doors or N/C construction [413.2]	Self-closing 1¾" SC wood doors or N/C construction [413.2]	<b>(d)(t)</b>
Ventilation Equipment Rooms	NR	NR	NR	NR	NR	NR	
Ventilation Equipment Room Opening Protective	NR	NR	NR	NR	NR	NR	

Room or Area	BOCA 1993 (a)(e)	BOCA 1996 (a)(f)	ICC 2003 (a)(g)	ICC 2006 (a)(h)	ICC 2009 (a)(p)	ICC 2015 (a)(r)	Comments
<b>Part 180</b>	On or after 3/24/95 but before 7/6/98	On or after 7/6/98 but before 10/3/05	On or after 10/3/05 but before 9/25/07	On or after 9/25/07 but before 1/1/10	On or after 1/1/10 but before 7/1/16	On or after 7/1/16	
<b>Woodworking Shops</b>	2-hours or 1-hour and sprinklers [Table 302.1.1]	2-hours or 1-hour and sprinklers [Table 302.1.1]	1-hour or sprinklers [Table 302.1.1]	1-hour or sprinklers [Table 508.2]	1-hour or sprinklers [Table 508.2.5]	1-hour or sprinklers [Table 509]	<b>(b)(j)</b>
<b>Woodworking Shop Opening Protectives</b>	1½-hours or ¾-hour with sprinklers [Table 716.1]	1½-hours or ¾-hour with sprinklers [Table 717.1]	¾-hour or sprinklers [Table 715.3]	¾-hour or sprinklers [Table 715.4]	¾-hour or sprinklers [Table 715.4]	¾-hour or sprinklers [Table 716.5]	<b>(b)(d)(j)(t)</b>

HP = Horsepower

N/C = Noncombustible Construction

SC = Solid Core

(a) Designed after March 24, 1995 but before July 6, 1998, use BOCA 1993  
Designed on or after July 6, 1998 but before October 3, 2005, use BOCA 1996  
Designed on or after October 3, 2005 but before September 25, 2007, table uses IBC 2003 unless otherwise noted  
Designed on or after September 25, 2007, but before January 1, 2010, table uses IBC 2006 unless otherwise noted  
Designed on or after January 1, 2010, but before July 1, 2016, table uses IBC 2009 unless otherwise noted  
Designed on or after July 1, 2016, table uses IBC 2015 unless otherwise noted

(b) = If classified as Group H, then Group H requirements must apply.

(c) = Projection rooms using/storing cellulose nitrate film shall comply with NFPA 40

(d) = Unless otherwise noted, opening protectives are to have automatic closing devices and positive latching. Additionally opening protectives, including glazing, must comply with NFPA 80.

(e) = Assumes building constructed using BOCA Building Code (1993) and those requirements must be maintained

(f) = Assumes building constructed using BOCA Building Code (1996) and those requirements must be maintained

(g) = Assumes building constructed using International Building Code (2003) and those requirements must be maintained

(h) = Assumes building constructed using International Building Code (2006) and those requirements must be maintained

(i) = Sprinklers not required for stages ≤ 1,000 ft² and < 50 ft. in height where curtains, scenery or other combustible hangings are not retractable vertically. Combustible hangings shall be limited to a single main curtain, borders, legs and a single backdrop.

(j) = If sprinkler option used, building must be protected throughout by approved, automatic sprinkler system in accordance with related chapter in applicable building code

(k) = Requirements from NFPA 70 – *National Electrical Code* (2002) as referenced by the ICC Electrical Code (2003)

(l) = Requirements from NFPA 70 – *National Electrical Code* (2005) as referenced by the ICC Electrical Code (2006)  
(m) = Requirements from NFPA 70 – *National Electrical Code* (1993) as referenced by BOCA Building Code (1993)  
(n) = Requirements from NFPA 70 – *National Electrical Code* (1996) as reference by BOCA Building Code (1996)  
(o) = Requirements from NFPA 70 – *National Electrical Code* (2008) as referenced by the International Building Code (2009)  
(p) = Assumes building constructed using International Building Code (2009) and those requirements must be maintained  
(q) = 1993 BOCA was the last edition the term “Legitimate Stage” was used  
(r) = Assumes building constructed using International Building Code (2015) and those requirements must be maintained  
(s) = Requirements from NFPA 70 – *National Electrical Code* (2014) as referenced by the International Building Code (2015)  
(t) = New technology permits higher hourly ratings in some cases. Confirm requirements for fire-protection-rated glazing or wired glazing in applicable ICC or BOCA code which may make a reference to NFPA 80-*Standard for Fire Doors and Fire Windows* whatever the applicable edition would be.

